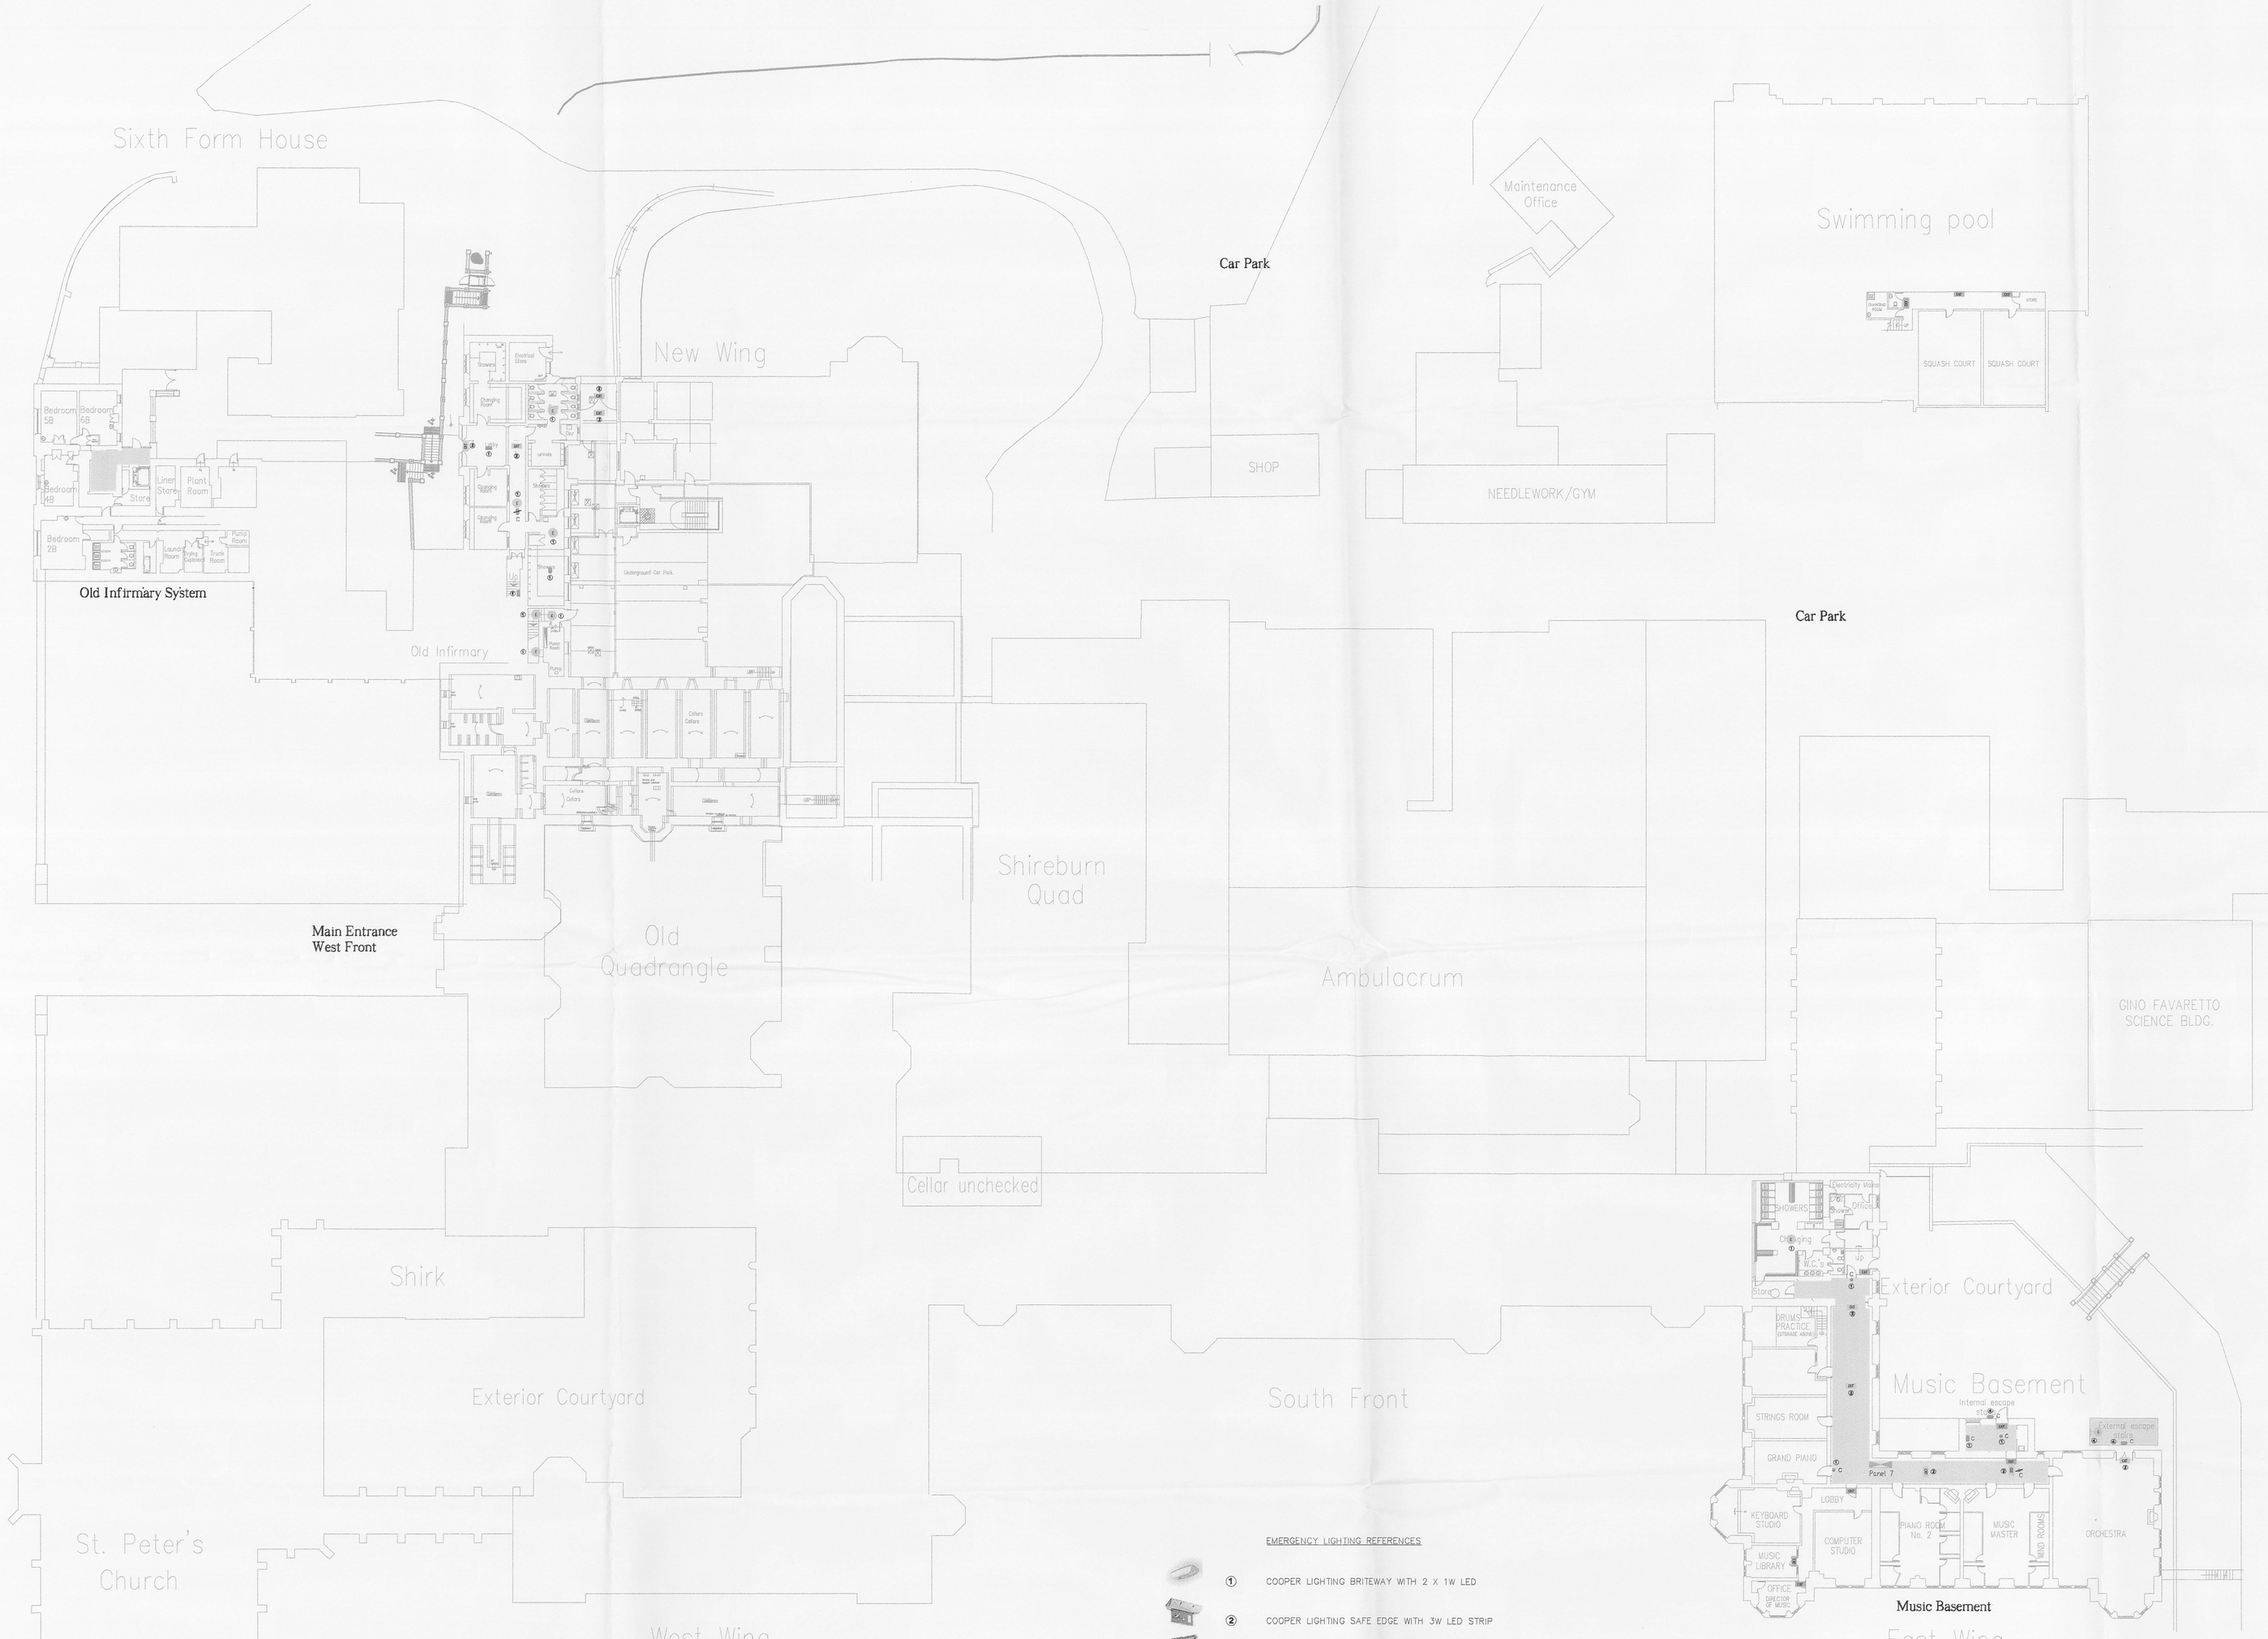

EMERGENCY LIGHTING REFERENCES

① COOPER LIGHTING BRITEWAY WITH 2 X 1W LED

② COOPER LIGHTING SAFE EDGE WITH 3W LED STRIP

③ COOPER LIGHTING ROYALUX 2 WITH 3W LED STRIP

④ THORLUX LIGHTING COBALT IP66 HOOD & GRILL

⑤ COOPER LIGHTING METROLITE WITH 12V, 12W TUNGSTEN HALOGEN LAMP

⑥ COOPER LIGHTING NEW SAFE 8 WITH 8W T5 FLUORESCENT

EMERGENCY LIGHTING LEGEND

- EXISTING 110V RECTANGLE BULKHEAD EMERGENCY LIGHTING
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (COMPLETE FITTING)
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (PIGMY BAYONET)
- EXISTING 110V SQUARE BULKHEAD EMERGENCY LIGHTING
- NEW TWIN SPOT EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW WALL MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW CEILING MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY EXIT SIGN AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY LIGHT
- EXISTING BULKHEAD EMERGENCY EXIT SIGN

LUMINAIRES WITH 'C' TO BE CHANGED FOR NEW FITTINGS TO REPLACE EXISTING 15W PIGMY

STONYHURST COLLEGE

Rev	Date	Amendment
B	20.12.11	EMERGENCY LIGHTING REFERNCES ADDED
A	07.11.11	EMERGENCY LIGHTING UPDATED

Drn: LB	Date: AUG'11	Scale: NTS@A0	
Chkd: BH	Date: AUG'11		

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
BASEMENT FLOOR LEVEL
EMERGENCY LIGHTING BATTERY SYSTEM

JRB
ENVIRONMENTAL DESIGN LTD
M&E BUILDING SERVICES CONSULTING ENGINEERS
Mobile Office Park, 10 Eaton Avenue, Bickerton Village, Chorley, PR7 7NA
tel - (01772) 320780 fax - (01772) 458468
e-mail - mail@jrbe.co.uk

Drg. No. 010.012.BATT.E1 Rev. B

320111047P

PRELIMINARY

Basement