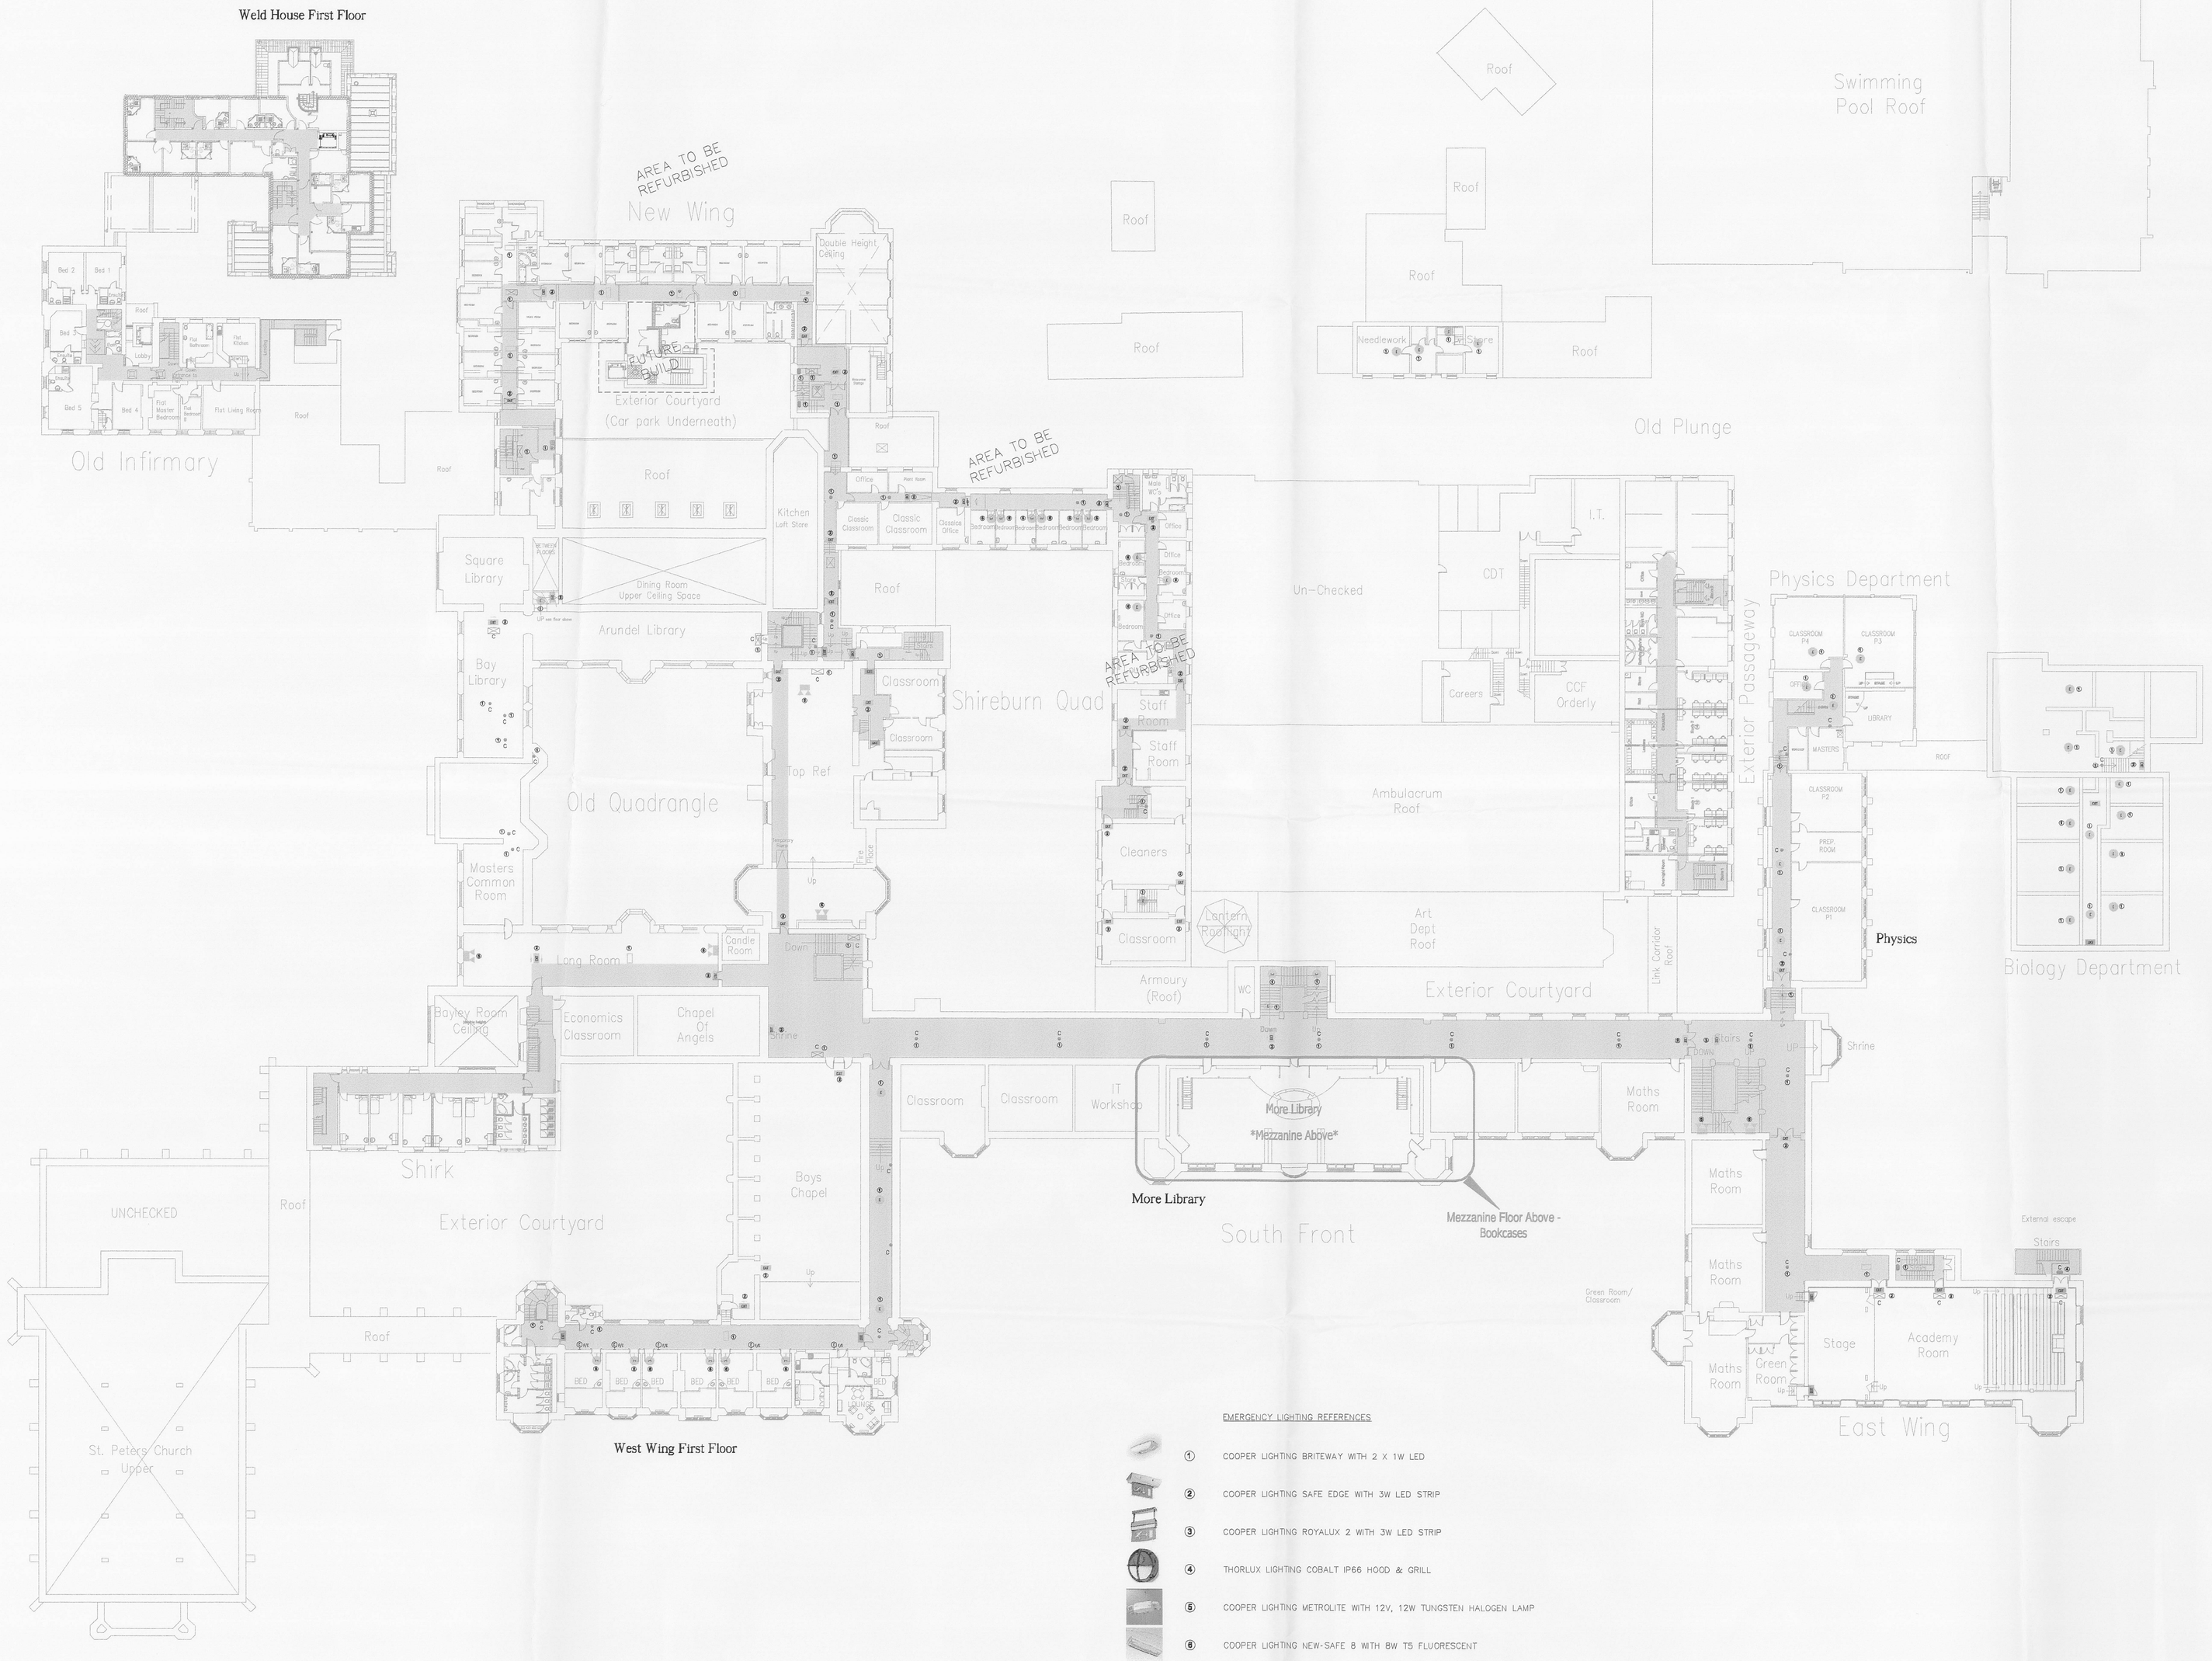


EMERGENCY LIGHTING REFERENCES

① COOPER LIGHTING BRITEWAY WITH 2 X 1W LED

② COOPER LIGHTING SAFE EDGE WITH 3W LED STRIP

③ COOPER LIGHTING ROYALUX 2 WITH 3W LED STRIP

④ THORLUX LIGHTING COBALT IP66 HOOD & GRILL

⑤ COOPER LIGHTING METROLITE WITH 12V, 12W TUNGSTEN HALOGEN LAMP

⑥ COOPER LIGHTING NEW-SAFE 8 WITH 8W T5 FLUORESCENT

EMERGENCY LIGHTING LEGEND

- EXISTING 110V RECTANGLE BULKHEAD EMERGENCY LIGHTING
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (COMPLETE FITTING)
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (PIGMY BAYONET)
- EXISTING 110V SQUARE BULKHEAD EMERGENCY LIGHTING
- NEW TWIN SPOT EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW WALL MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW CEILING MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY EXIT SIGN AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY LIGHT
- EXISTING BULKHEAD EMERGENCY EXIT SIGN

LUMINAIRES WITH 'C' TO BE CHANGED FOR NEW FITTINGS TO REPLACE EXISTING 15W PIGMY

First floor

PRELIMINARY

320111047P

Rev.	Date	Amendment
B	20.12.11	EMERGENCY LIGHTING REFERNCES ADDED
A	07.11.11	EMERGENCY LIGHTING UPDATED

Drn: LB Date: AUG.11 Scale: NTS@A0
Chkd: BH Date: AUG.11

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
FIRST FLOOR LEVEL
EMERGENCY BATTERY LIGHTING SYSTEM

JRB
ENVIRONMENTAL DESIGN LTD
M&E BUILDING SERVICES CONSULTING ENGINEERS
Mobile Office Park, 16 Eldon Avenue, Buckshaw Village, Chorley PR7 7NA
Tel : 01772 257701 Fax : 01772 456448
e-mail : mail@jrbe.co.uk

Drg. No: 010.012.BATT.E3 Rev: B

STONYHURST
COLLEGE