




- LEGEND**
- R (C) Denotes call point (Radio)
 - S (C) Denotes sounder (Hardwired)
 - R (S) Denotes sounder (Radio)
 - R (B) Denotes sounder beacon (Radio)
 - R (A) Denotes beacon (Radio)
 - R (SD) Denotes smoke detector (Radio)
 - R (SD) Denotes smoke sounder base detector (Radio)
 - R (SD) Denotes smoke detector in Ceiling Void (Radio)
 - R (HD) Denotes heat detector
 - R (HD) Denotes heat detector
 - R (HD) Denotes heat detector sounder base
- Panel 2 - Adjacent to boiler house / maintenance block
Denotes alarm indicator panels with visual display.
Panel 6 - Main communication at main reception (South Fronts)
- Panel 1, 2, 4 & 5
Denotes Sub-Main Alarm Indicator Panel
Provided with local 230V supply
- Panel 7-36
Denotes Radio Repeater Panel
Non-Indicator
- Denotes Sounder Circuit Booster
Supplied by local 230V single phase supply
- Fire hydrant
- Hose reel location
- Fire alarm door actuator
- Fire alarm Vibrating pillow
- Door Detente hold back magnet
- Refuge alerter panel
- Electric door keep
- Fire alarm interface unit
- New Fire Alarm devices

STONYHURST

COLLEGE

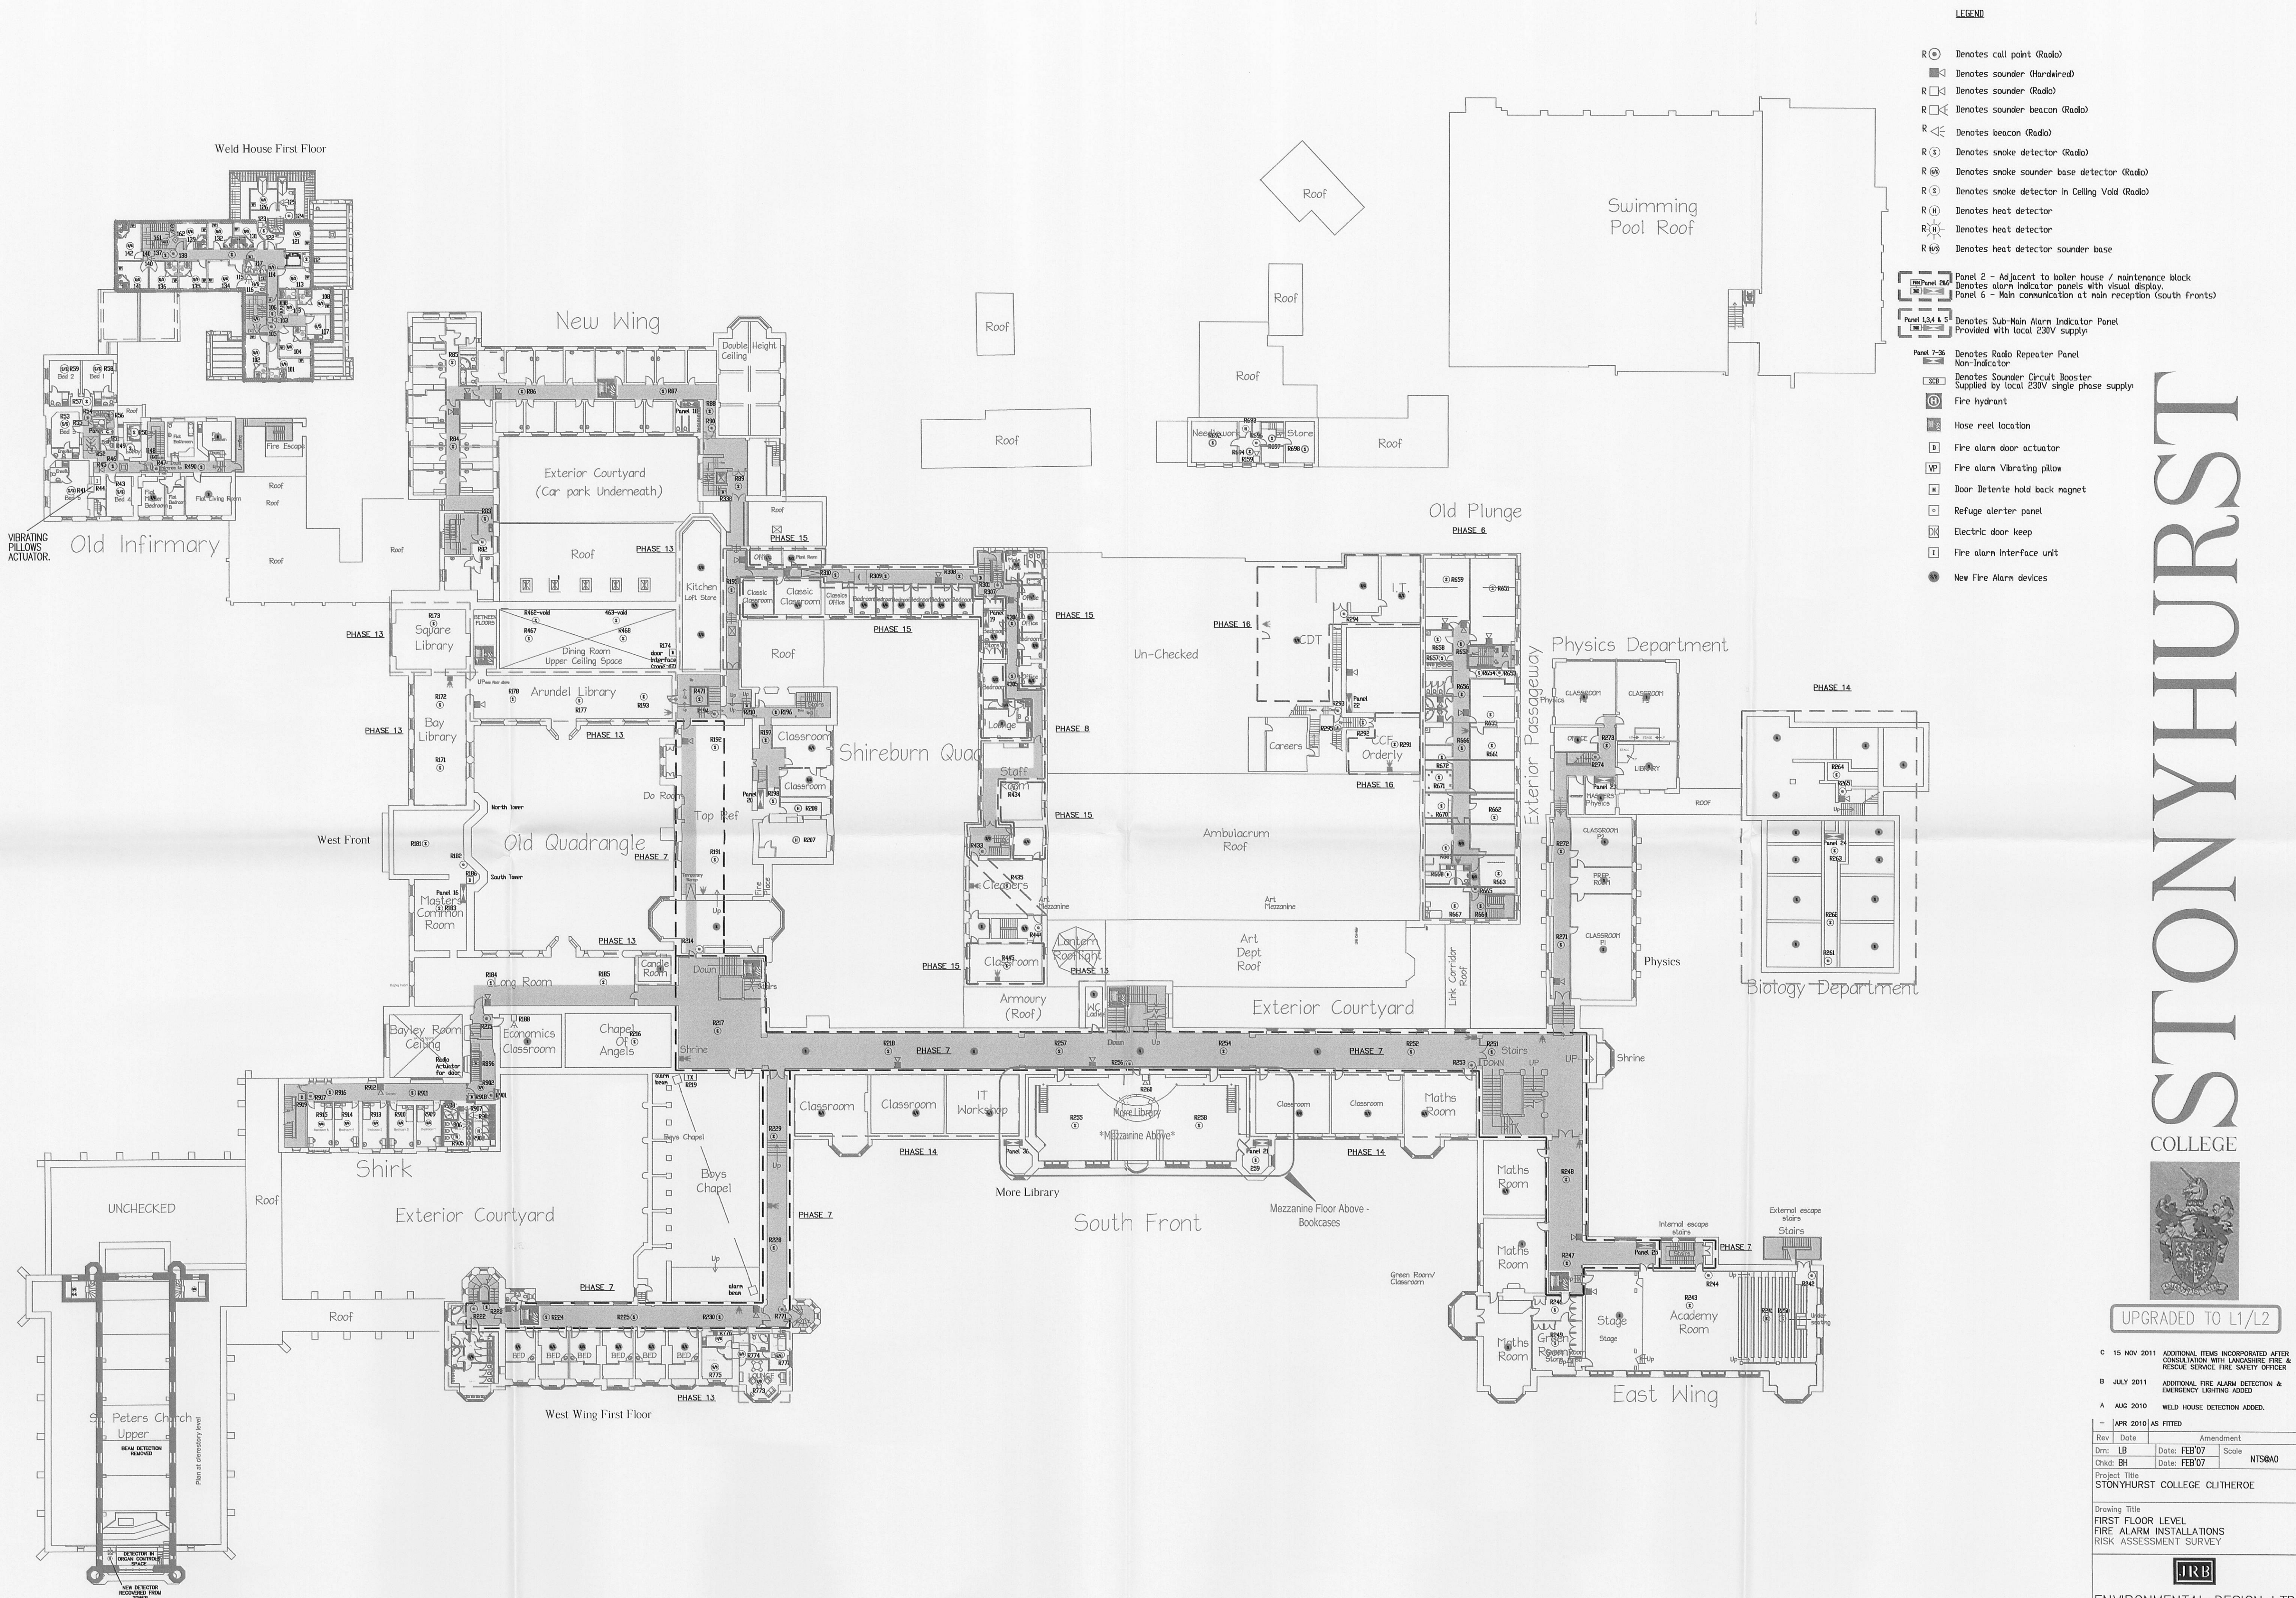

UPGRADED TO L1/L2

C	15 NOV 2011	ADDITIONAL ITEMS INCORPORATED AFTER CONSULTATION WITH LANCASHIRE FIRE & RESCUE SERVICE FIRE SAFETY OFFICER		
B	JULY 2011	ADDITIONAL FIRE ALARM DETECTION & EMERGENCY LIGHTING ADDED		
A	AUG 2010	WELD HOUSE DETECTION ADDED.		
- APR 2010 AS FITTED				
Rev	Date	Amendment		
Dwn: LB	Date: FEB'07	Scale		NTS/MO
Chkd: BH	Date: FEB'07			
Project Title				
STONYHURST COLLEGE CLUTHEROE				
Drawing Title				
FIRST FLOOR LEVEL				
FIRE ALARM INSTALLATIONS				
RISK ASSESSMENT SURVEY				
				
ENVIRONMENTAL DESIGN LTD				
M&E BUILDING SERVICES CONSULTING ENGINEERS				
M&E Office Park, 10 Eden Avenue, Baddiley Village, Chorley, PR7 7N. Tel: (01773) 331700 Fax: (01773) 434466 email: info@edl.co.uk				
Dwg. No.		010.025.FA9		Rev. C