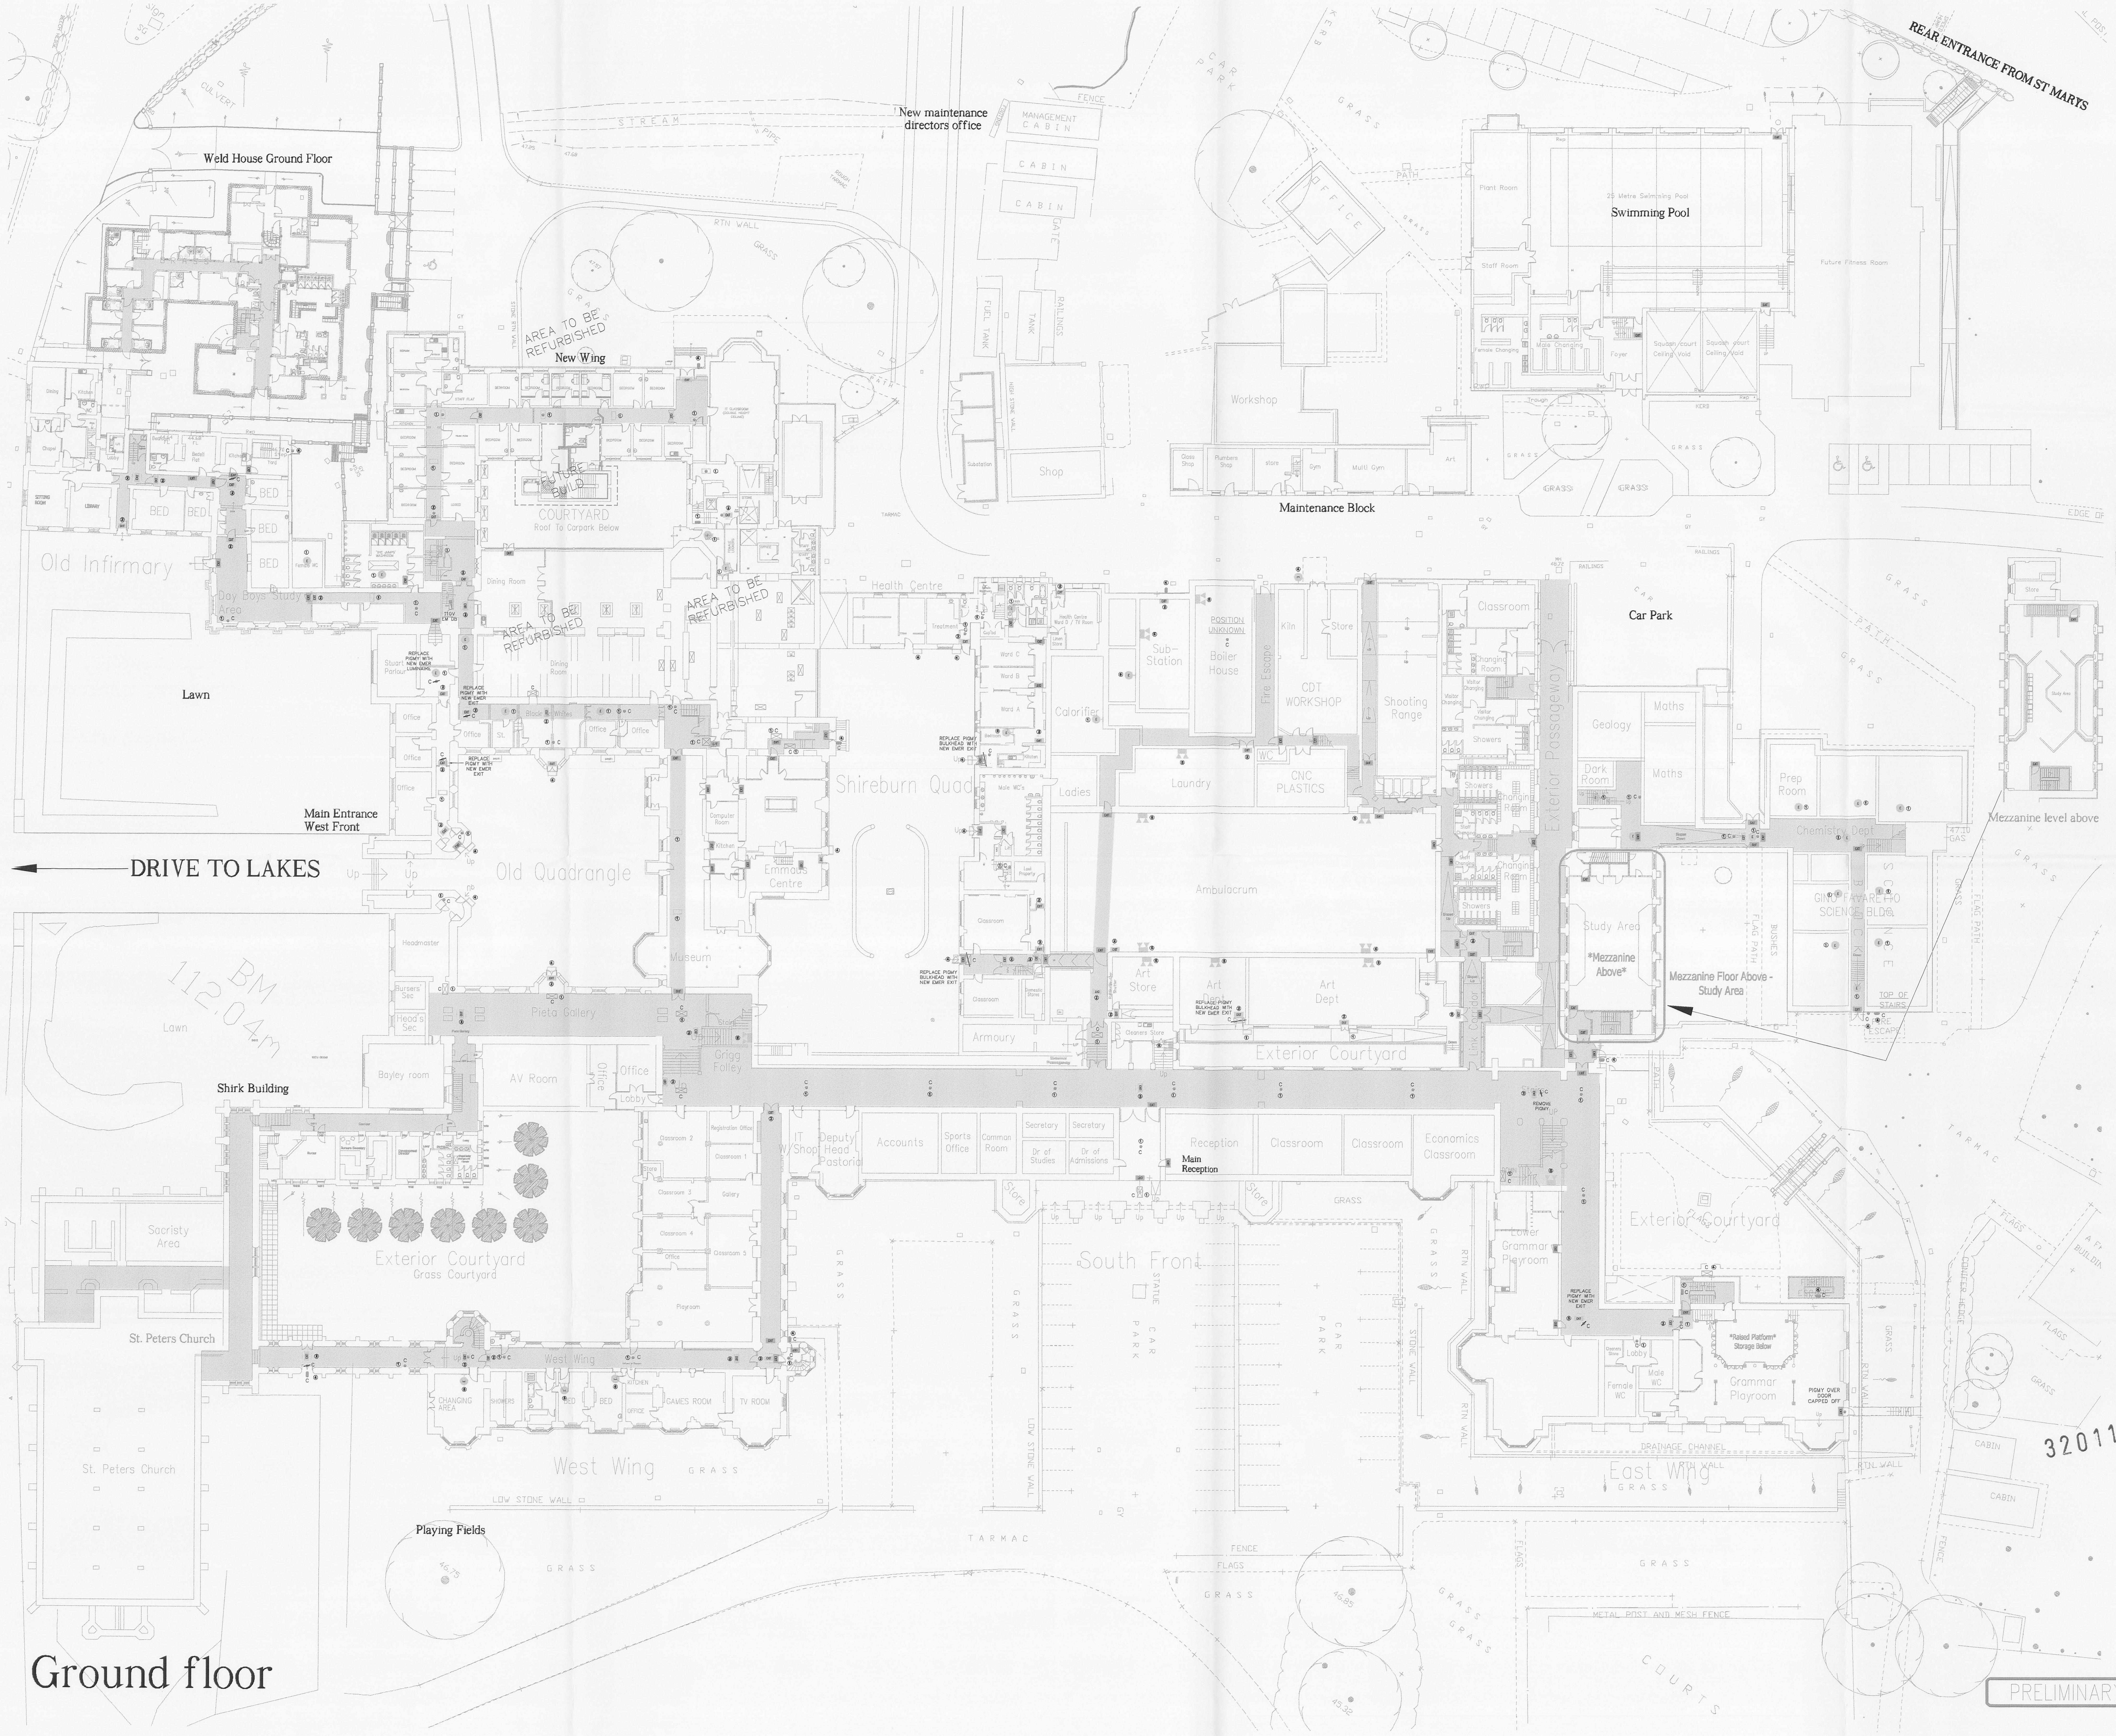

EMERGENCY LIGHTING LEGEND

- EXISTING 110V RECTANGLE BULKHEAD EMERGENCY LIGHTING
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (COMPLETE FITTING)
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (PIGMY BAYONET)
- EXISTING 110V SQUARE BULKHEAD EMERGENCY LIGHTING
- NEW TWIN SPOT EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW WALL MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW CEILING MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY EXIT SIGN AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY LIGHT
- EXISTING BULKHEAD EMERGENCY EXIT SIGN

LUMINAIRES WITH 'C' TO BE CHANGED FOR NEW FITTINGS TO REPLACE EXISTING 15W PIGMY

EMERGENCY LIGHTING REFERENCES

1. COOPER LIGHTING BRITEWAY WITH 2 X 1W LED
2. COOPER LIGHTING SAFE EDGE WITH 3W LED STRIP
3. COOPER LIGHTING ROYALUX 2 WITH 3W LED STRIP
4. THORLUX LIGHTING COBALT IP66 HOOD & GRILL
5. COOPER LIGHTING METROLITE WITH 12V, 12W TUNGSTEN HALOGEN LAMP
6. COOPER LIGHTING NEW SAFE 8 WITH 8W T5 FLUORESCENT

STONYHURST
COLLEGE

320111047P

Rev	Date	Amendment
B	20.12.11	EMERGENCY LIGHTING REFERNCES ADDED
A	07.11.11	EMERGENCY LIGHTING UPDATED

Drn: LB	Date: AUG'11	Scale NTS@A0
Chkd: BH	Date: AUG'11	

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
GROUND FLOOR LEVEL
EMERGENCY LIGHTING BATTERY SYSTEM

JRB
ENVIRONMENTAL DESIGN LTD
M&E BUILDING SERVICES CONSULTING ENGINEERS
Matrix Office Park, 10 Eaton Avenue, Buckshaw Village, Chorley. PR7 7NA
Tel : (01772) 331790 Fax : (01772) 458466
e:mail : mail@jrbe.co.uk

PRELIMINARY

Drg. No. 010.012.BATT.E2 Rev. B