




- LEGEND**
- R ○ Denotes call point (Radio)
 - R ■ Denotes sounder (Hardwired)
 - R □ Denotes sounder (Radio)
 - R □ Denotes sounder beacon (Radio)
 - R ◁ Denotes beacon (Radio)
 - R (S) Denotes smoke detector (Radio)
 - R (S) Denotes smoke detector in Ceiling Void (Radio)
 - R (H) Denotes heat detector
 - R (H) Denotes heat detector
 - R (H) Denotes heat detector sounder base
- Panel 2 - Adjacent to boiler house / maintenance block
Denotes alarm indicator panels with visual display
Panel 6 - Main communication at main reception (South Fronts)
- Panel 1, 2, 4, 5, 6 Denotes Sub-Main Alarm Indicator Panel
Provided with local 230V supply
- Panel 7-36 Denotes Radio Repeater Panel
Non-Indicator
- SB Denotes Sounder Circuit Booster
Supplied by local 230V single phase supply
- Denotes Fire hydrant
- Denotes Hose reel location
- Denotes Fire alarm door actuator
- VP Denotes Fire alarm Vibrating pillow
- Denotes Door Detente hold back magnet
- Denotes Refuge alerter panel
- Denotes Electric door keep
- Denotes Fire alarm interface unit
- Denotes New Fire Alarm devices as per risk assessment

STONYHURST COLLEGE

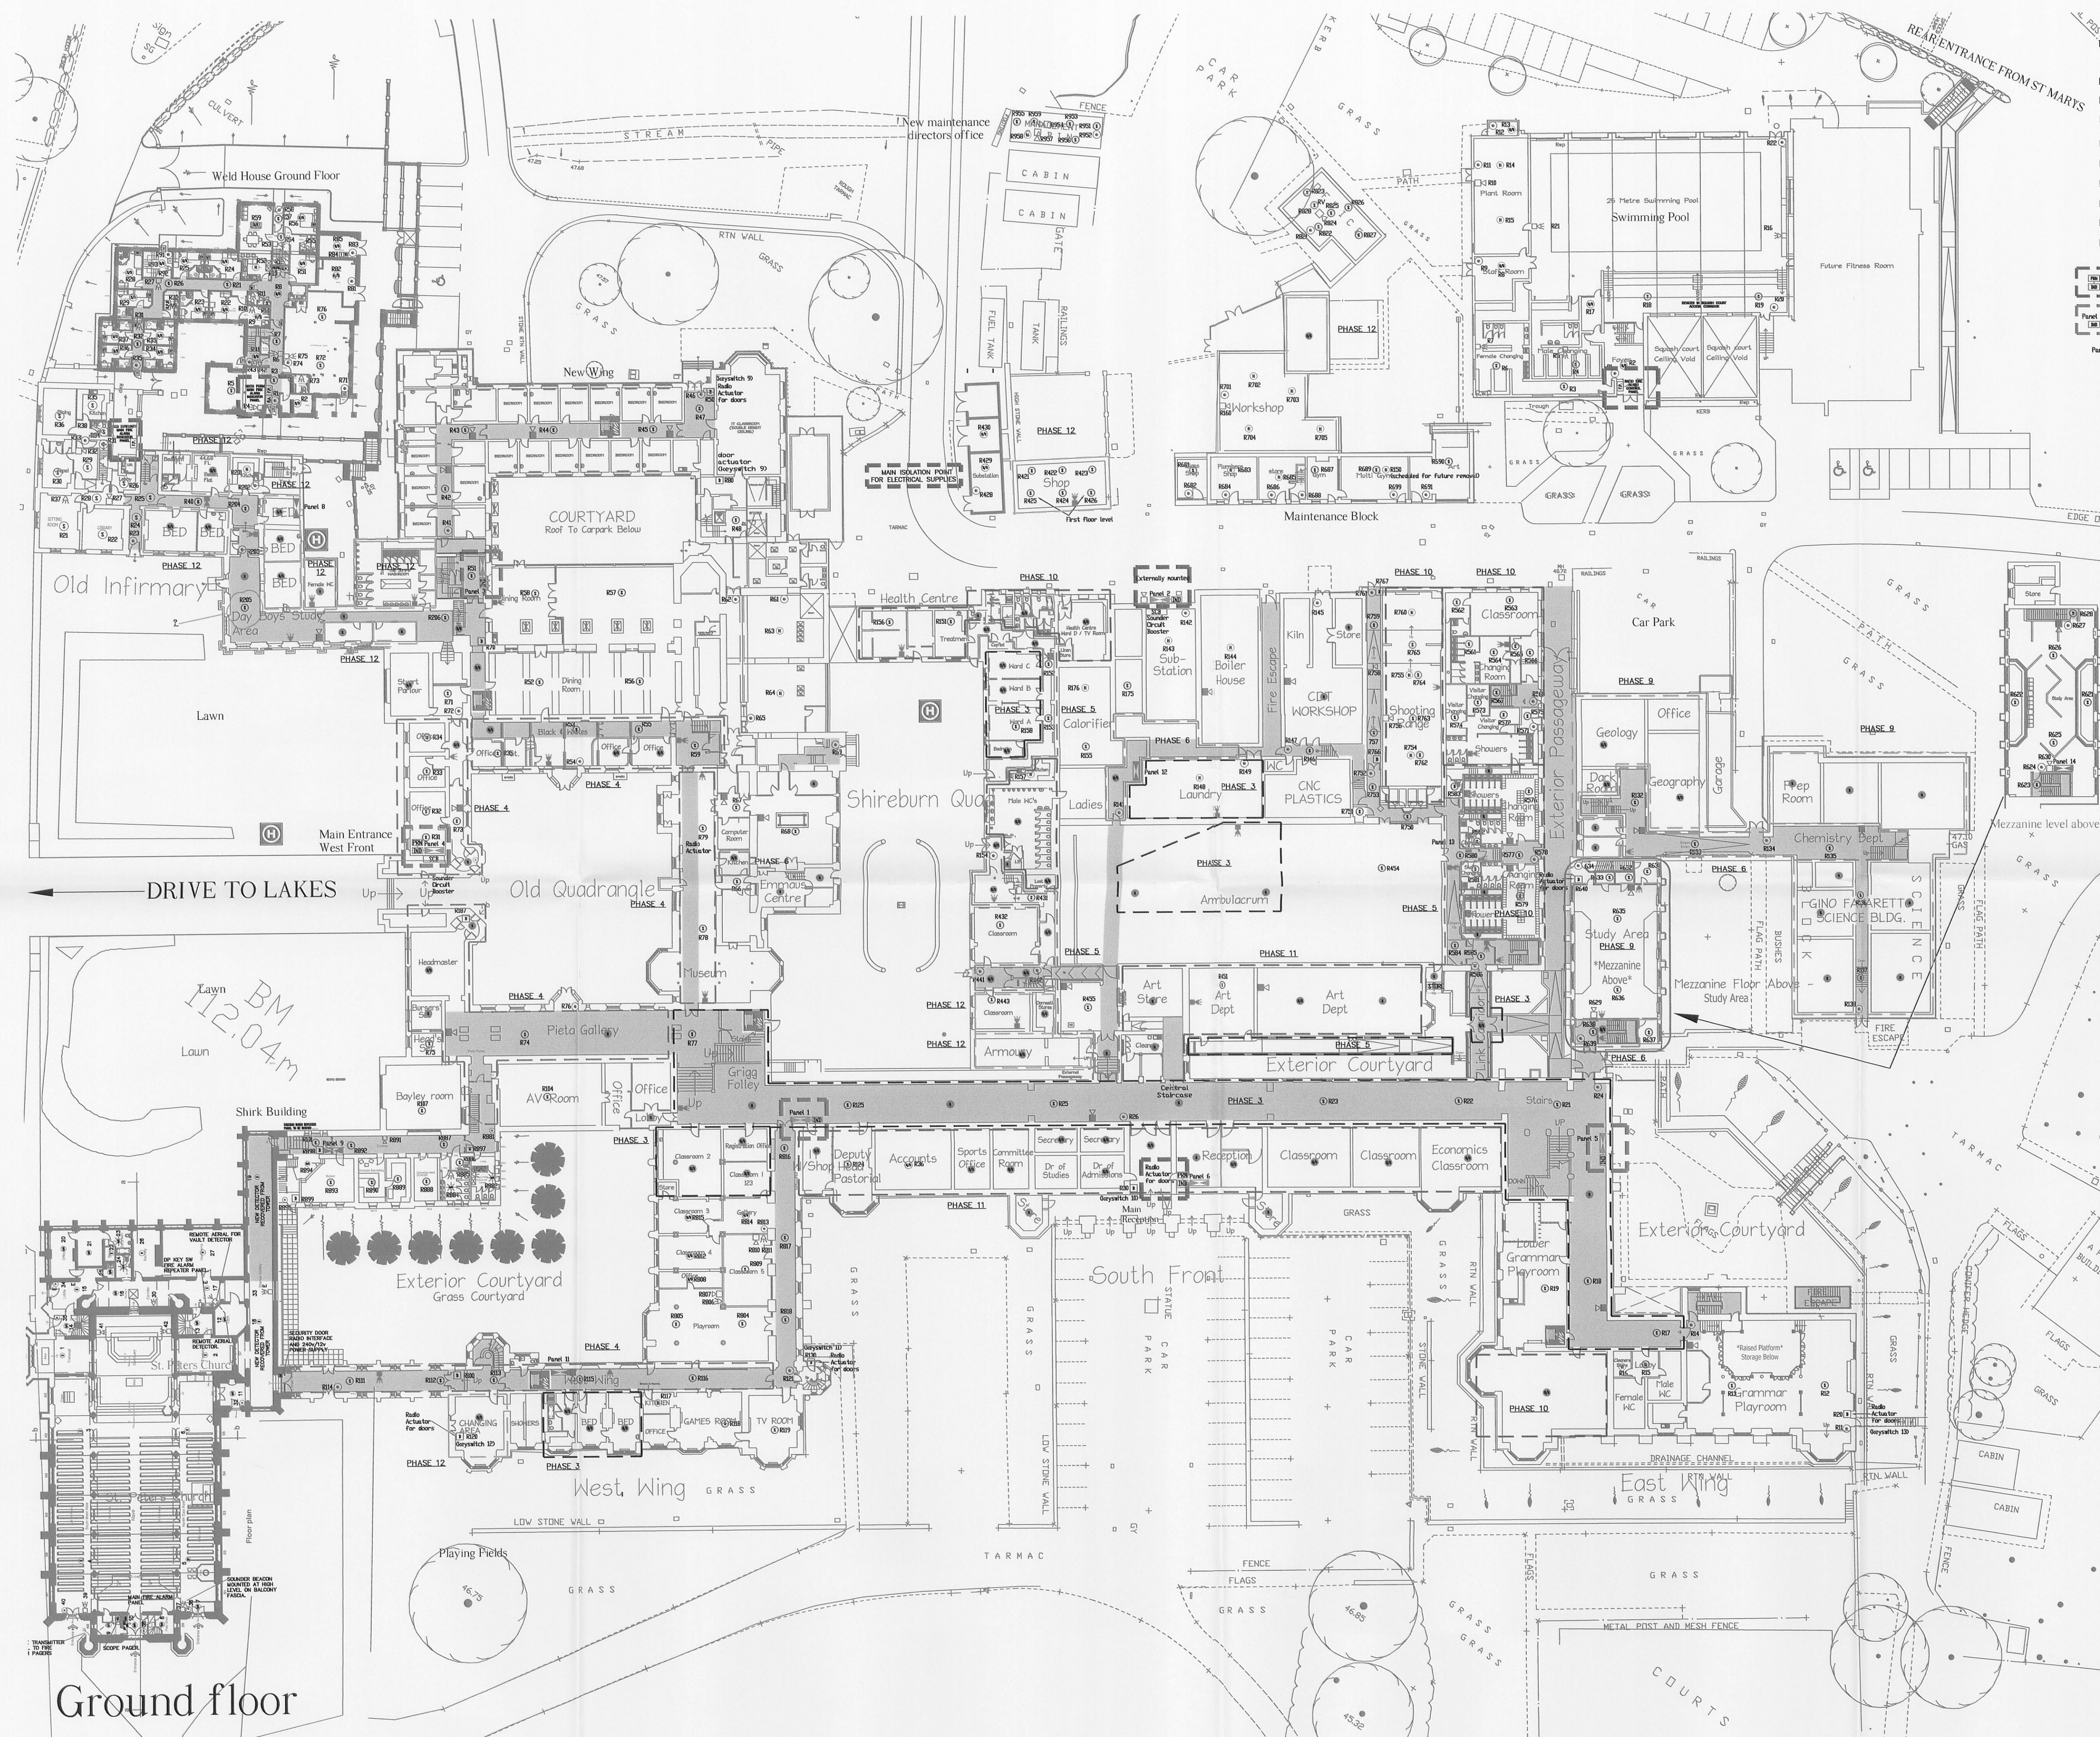

UPGRADED TO L1/L2

- C 15 NOV 2011 ADDITIONAL ITEMS INCORPORATED AFTER CONSULTATION WITH LANCSHIRE FIRE & RESCUE SERVICE FIRE SAFETY OFFICER
- B JULY 2011 ADDITIONAL FIRE ALARM DETECTION & EMERGENCY LIGHTING ADDED IN ACCORDANCE WITH RISK ASSESSMENTS
- A AUG 2010 WELD HOUSE DETECTION ADDED.

Rev	Date	Amendment
Dm: LB	Date: FEB'07	Scale: NTS@A0
Chkd: BH	Date: FEB'07	

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
GROUND FLOOR LEVEL
FIRE ALARM INSTALLATIONS
RISK ASSESSMENT SURVEY



ENVIRONMENTAL DESIGN LTD
M&E BUILDING SERVICES CONSULTING ENGINEERS

Mobile Office Park, 10 Eddon Avenue, Bamberley Village, Clitheroe, PR7 7BN
Tel : (01773) 331790 Fax : (01773) 438468
email : info@edl.co.uk

Drg. No.	010.025.FA8	Rev.	C
----------	-------------	------	---

Ground floor