




- LEGEND
- Denotes call point (Radio)
 - Denotes sounder (Hardwired)
 - Denotes sounder (Radio)
 - Denotes sounder beacon (Radio)
 - Denotes beacon (Radio)
 - Denotes smoke detector (Radio)
 - Denotes smoke sounder base detector (Radio)
 - Denotes smoke detector in Ceiling Void (Radio)
 - Denotes heat detector
 - Denotes heat detector
 - Denotes heat detector sounder base
 - Panel 2 - Adjacent to boiler house / maintenance block
Denotes alarm indicator panels with visual display.
Panel 6 - Main communication at main reception (south fronts)
 - Denotes Sub-Main Alarm Indicator Panel
Provided with local 230V supply
 - Denotes Radio Repeater Panel
Non-Indicator
 - Denotes Sounder Circuit Booster
Supplied by local 230V single phase supply.
 - Fire hydrant
 - Hose reel location
 - Fire alarm door actuator
 - Fire alarm Vibrating pillow
 - Door Detente hold back magnet
 - Refuge alerter panel
 - Electric door keep
 - Fire alarm interface unit
 - High Sensitive detection
 - New Fire Alarm devices

STONYHURST

COLLEGE

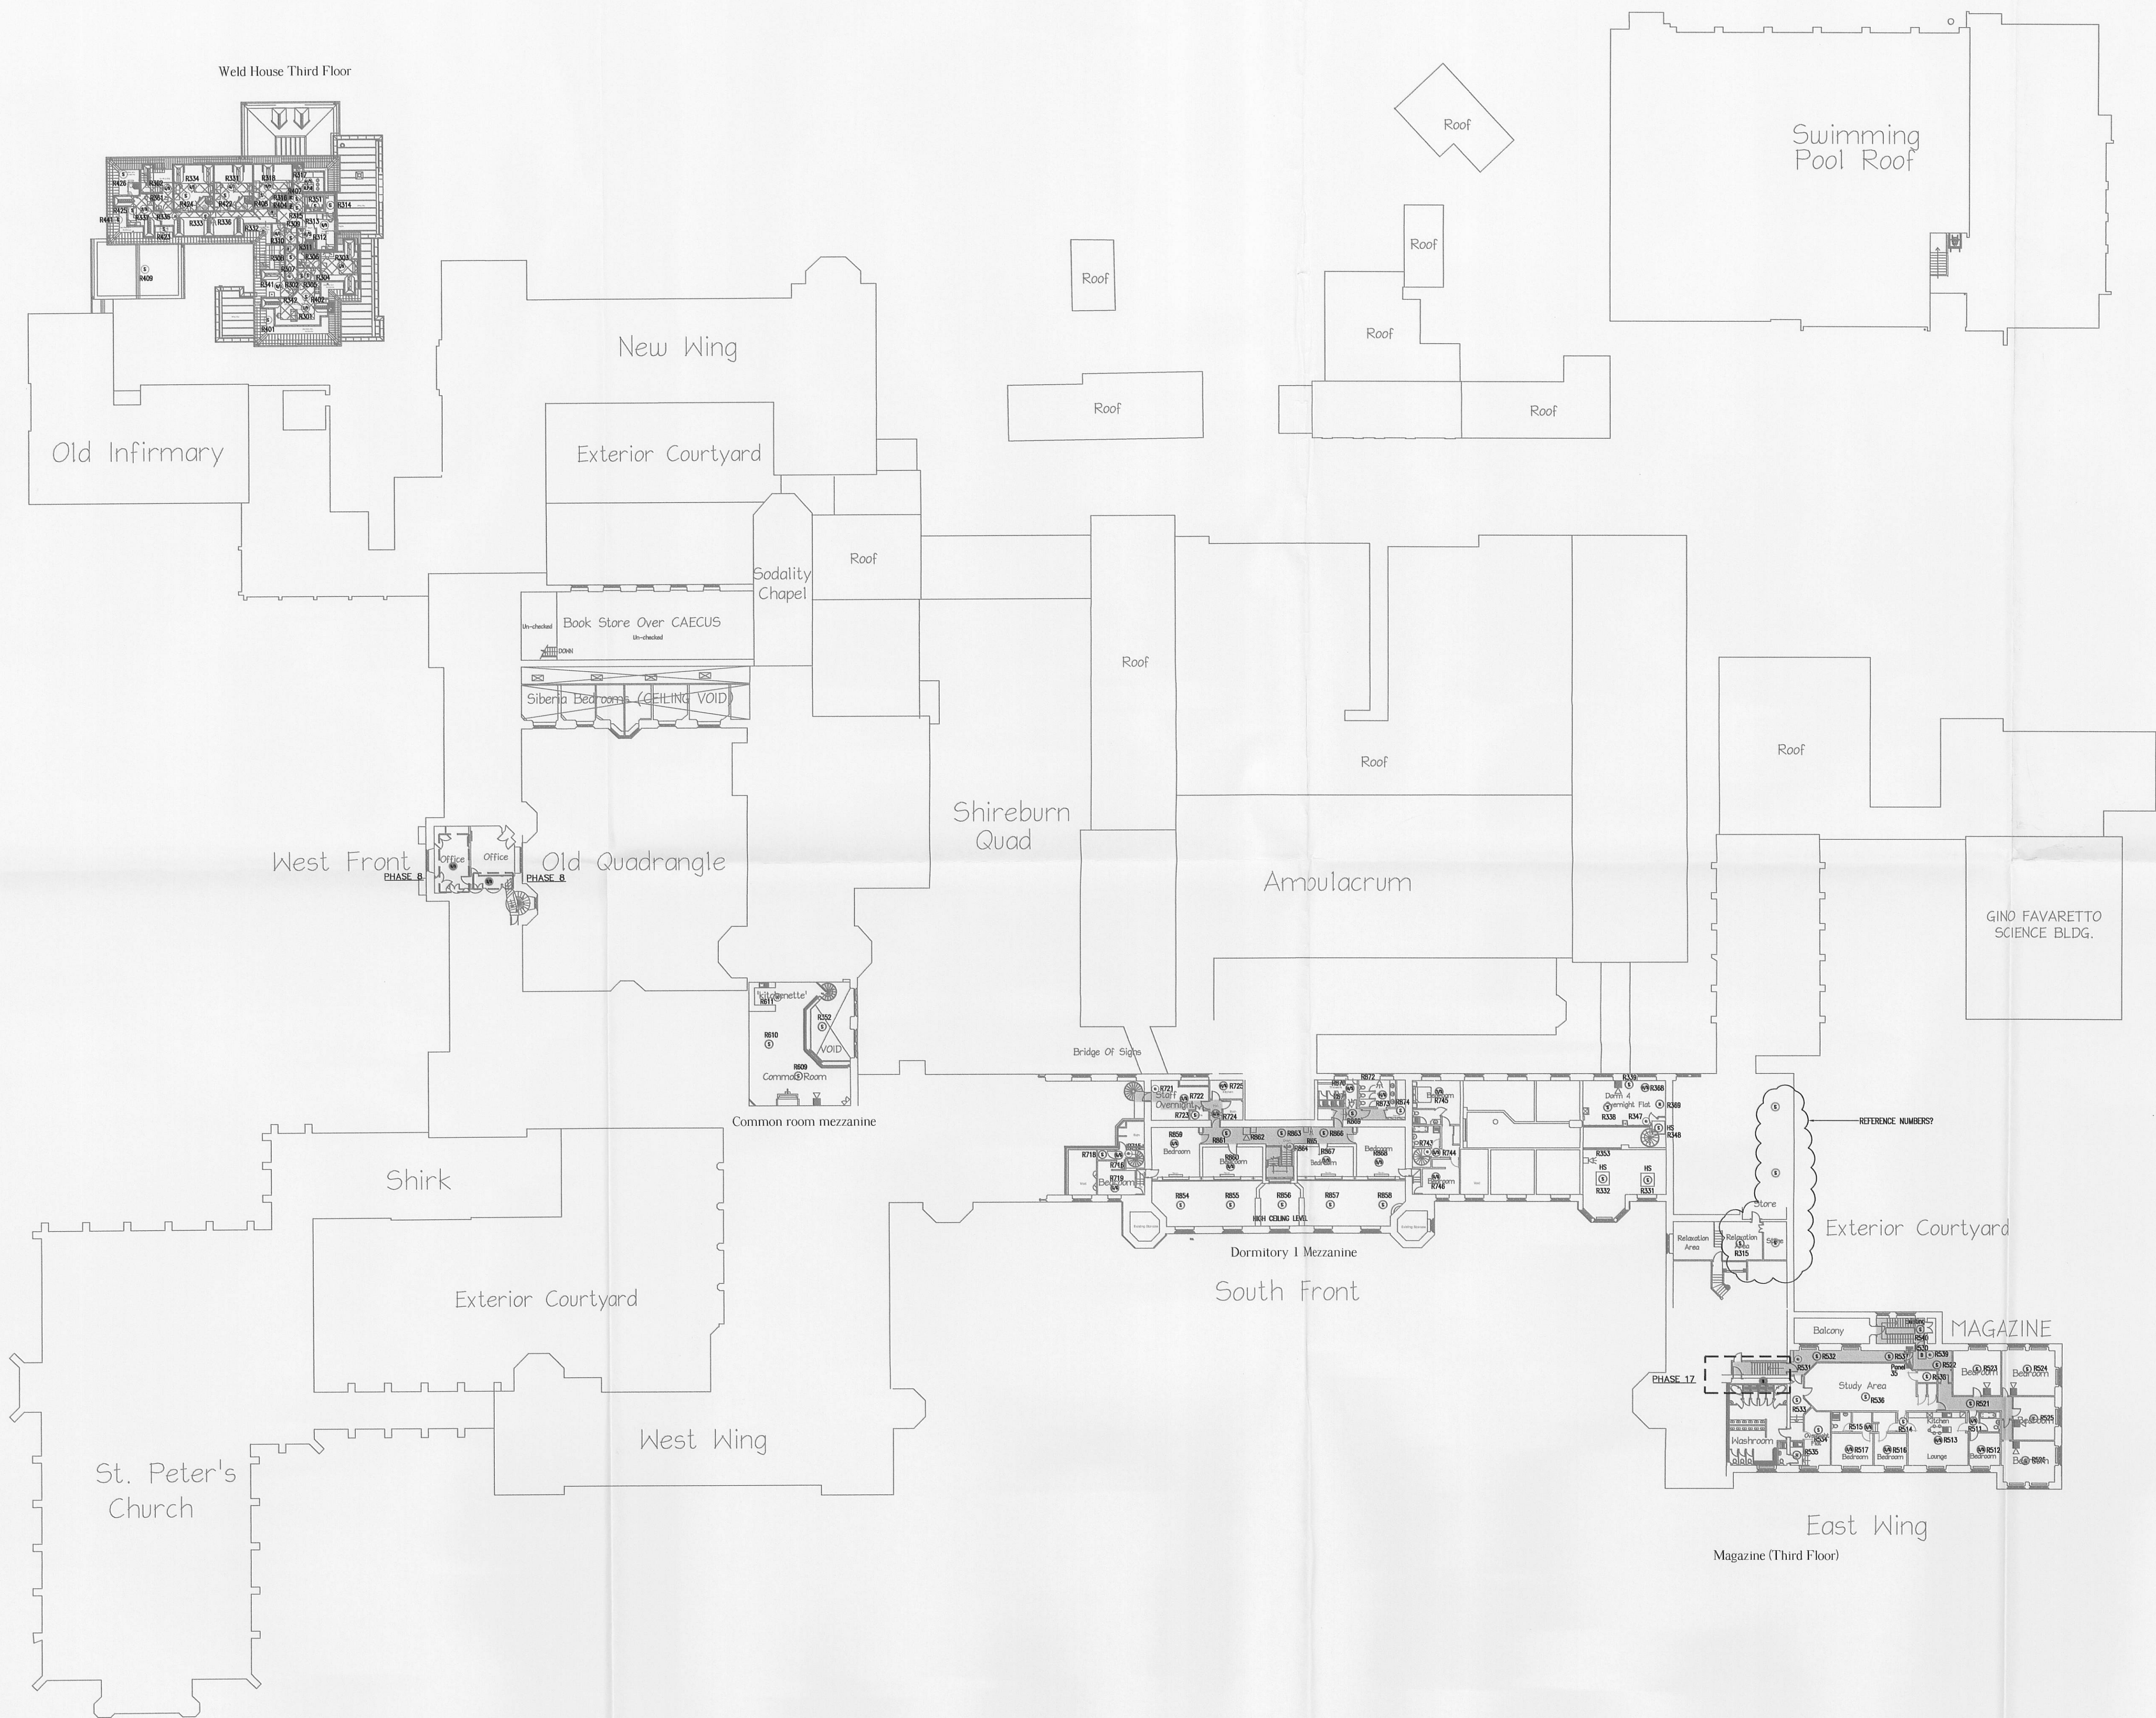

UPGRADED TO L1/L2

C 15 NOV 2011 ADDITIONAL ITEMS INCORPORATED AFTER CONSULTATION WITH LANCASHIRE FIRE & RESCUE SERVICE FIRE SAFETY OFFICER

B JULY 2011 ADDITIONAL FIRE ALARM DETECTION & EMERGENCY LIGHTING ADDED IN ACCORDANCE WITH RISK ASSESSMENTS

A AUG 2010 WELD HOUSE DETECTION ADDED.

Rev Date AS FITTED

Drn: LB Date: FEB07 Amendment

Chkd: BH Date: FEB07 Scale NTS@A0

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
MEZZANINE 2ND FLOOR
FIRE ALARM INSTALLATIONS
RISK ASSESSMENT SURVEY



ENVIRONMENTAL DESIGN LTD

M&E BUILDING SERVICES CONSULTING ENGINEERS

Works Office Park, 10 Eaton Avenue, Baddalona Village, Chorley, PR7 7NA

Tel : (01772) 331700 Fax : (01772) 426466

email : enquiries@edltd.co.uk

Dwg. No. 010.025.FA12 Rev. C