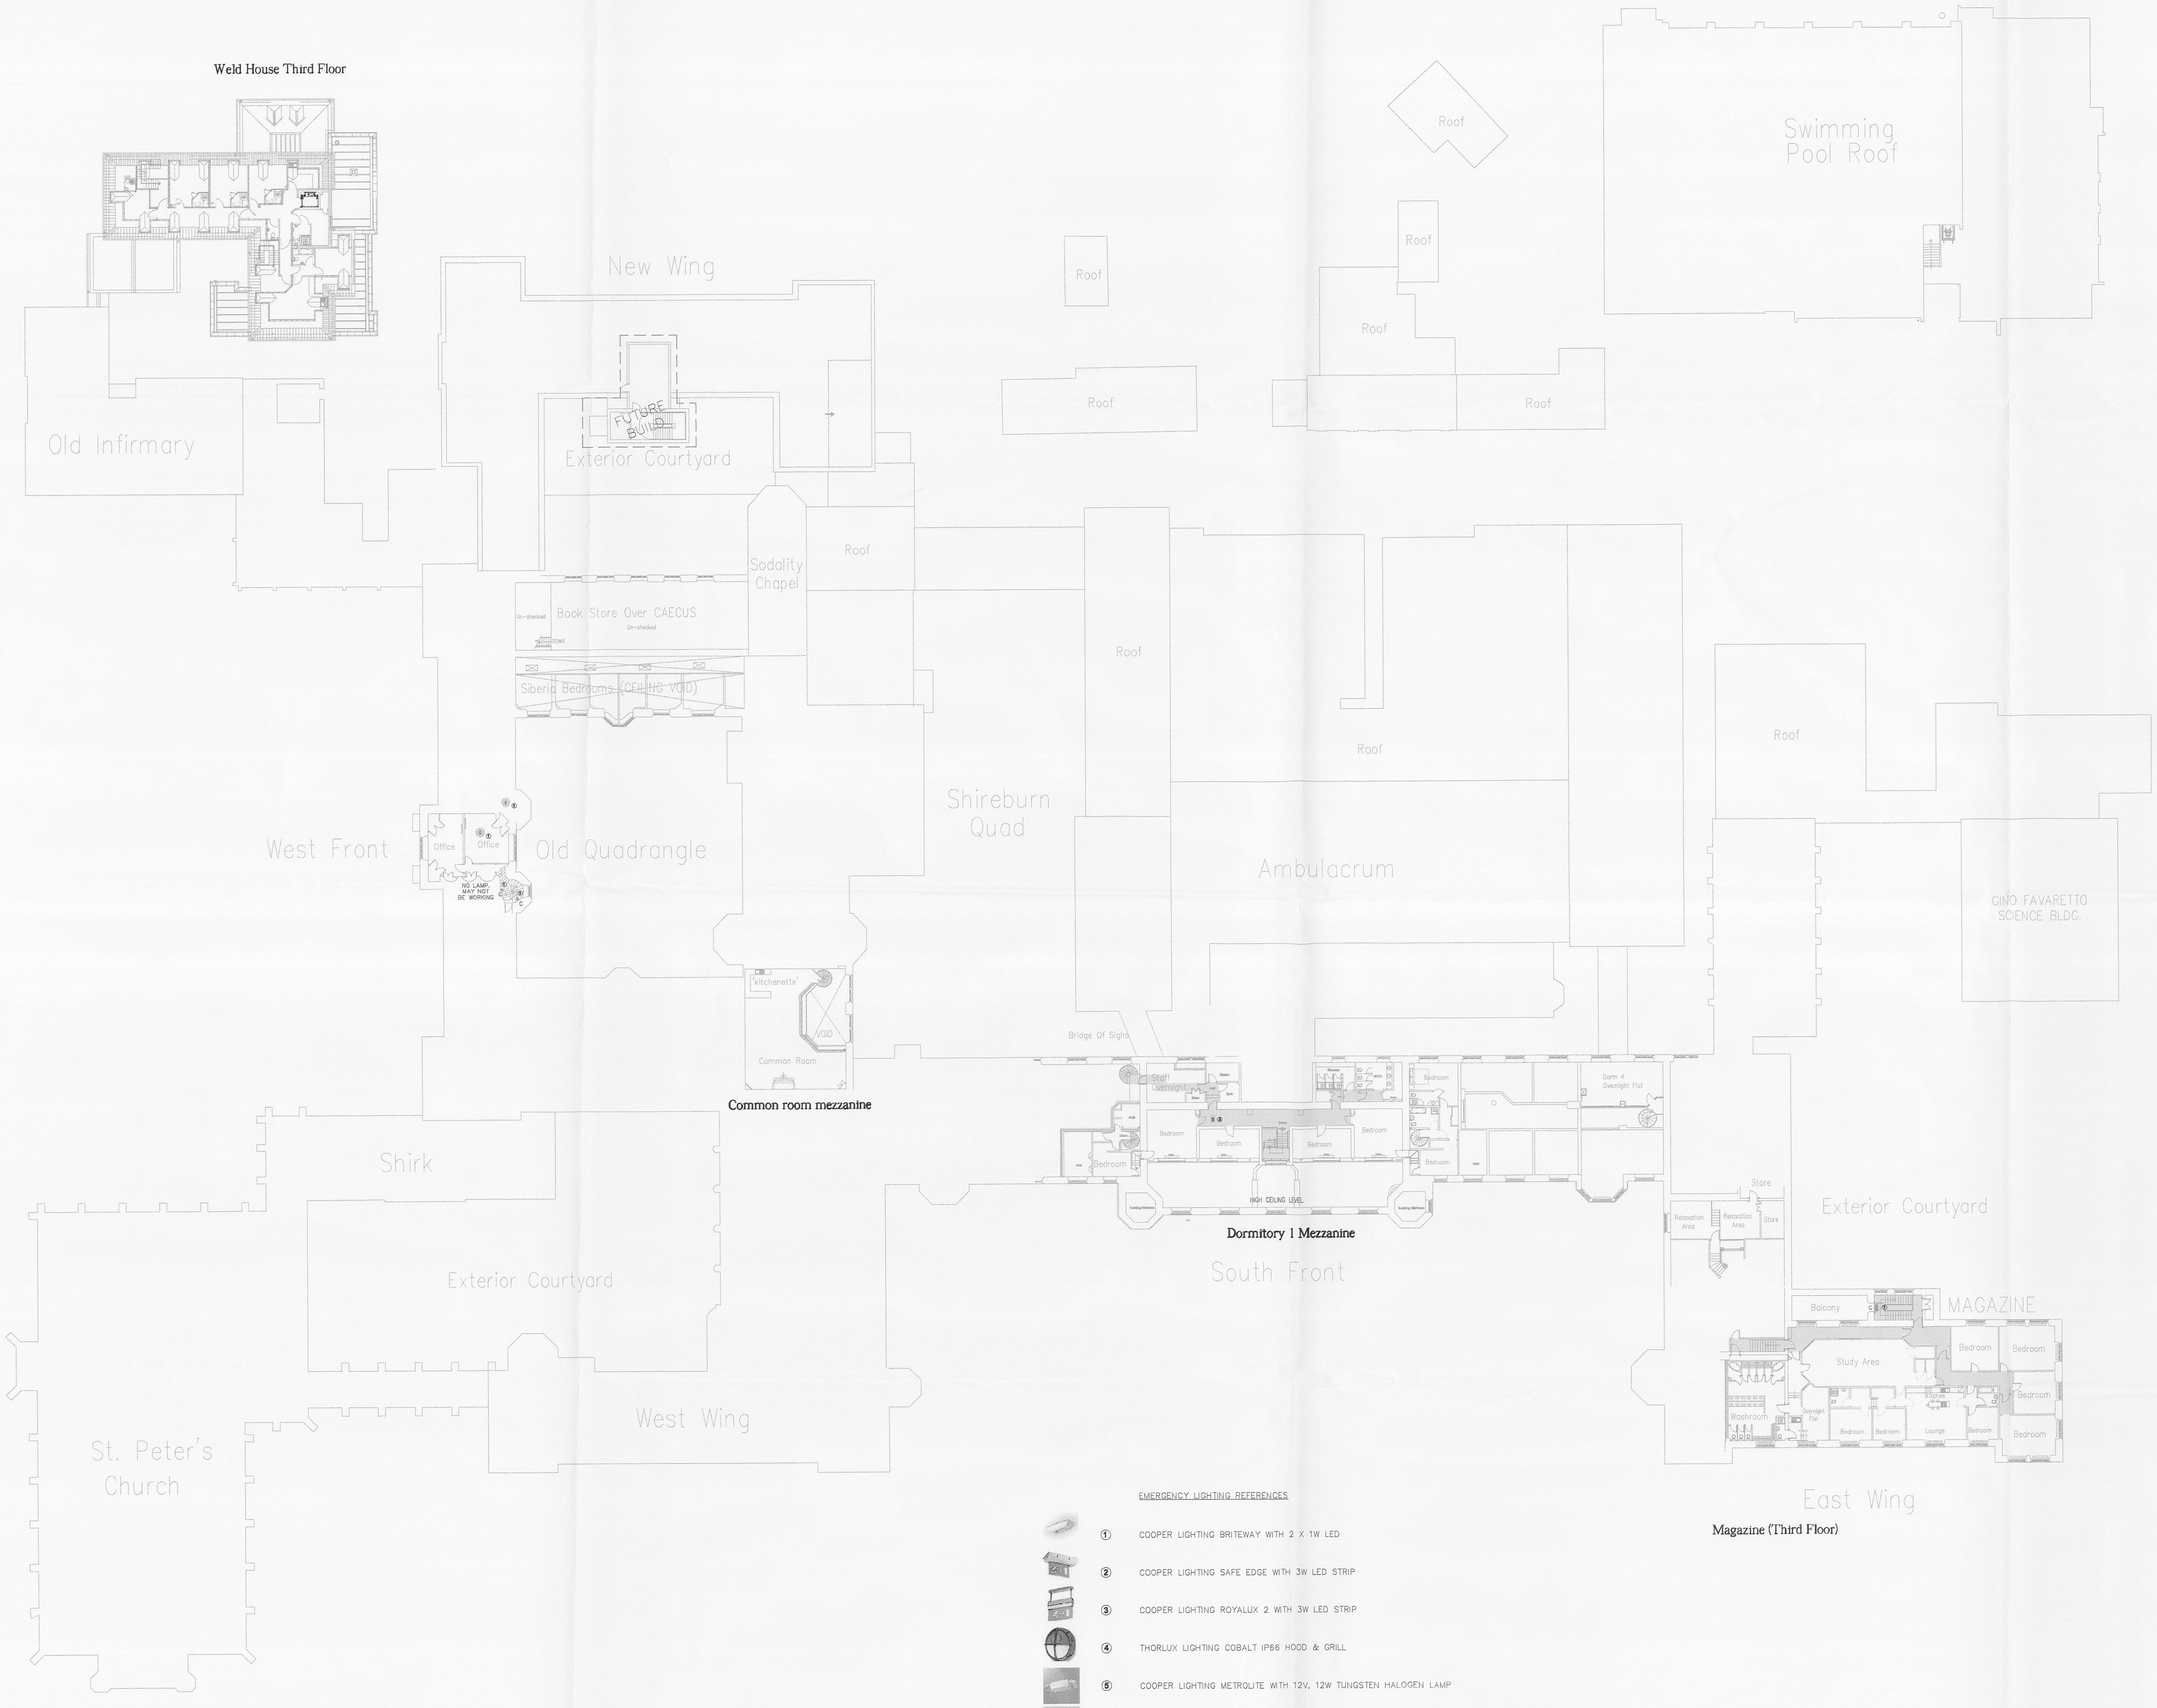

2nd Floor mezzanine

EMERGENCY LIGHTING LEGEND

- EXISTING 110V RECTANGLE BULKHEAD EMERGENCY LIGHTING
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (COMPLETE FITTING)
- EXISTING 110V PIGMEY EMERGENCY LIGHTING (PIGMY BAYONET)
- EXISTING 110V SQUARE BULKHEAD EMERGENCY LIGHTING
- NEW TWIN SPOT EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW WALL MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW CEILING MOUNTED EMERGENCY LIGHT AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY EXIT SIGN AS PER RISK ASSESSMENT
- NEW BULKHEAD EMERGENCY LIGHT
- EXISTING BULKHEAD EMERGENCY EXIT SIGN

LUMINAIRES WITH "C" TO BE CHANGED FOR NEW FITTINGS TO REPLACE EXISTING 15W PIGMY

EMERGENCY LIGHTING REFERENCES

1. COOPER LIGHTING BRITEWAY WITH 2 X 1W LED
2. COOPER LIGHTING SAFE EDGE WITH 3W LED STRIP
3. COOPER LIGHTING ROYALUX 2 WITH 3W LED STRIP
4. THORLUX LIGHTING COBALT IP66 HOOD & GRILL
5. COOPER LIGHTING METROLITE WITH 12V, 12W TUNGSTEN HALOGEN LAMP
6. COOPER LIGHTING NEW SAFE 8 WITH 8W T5 FLUORESCENT

STONYHURST COLLEGE

320111047P

Rev	Date	Amendment
B	20.12.11	EMERGENCY LIGHTING REFERNCES ADDED
A	07.11.11	EMERGENCY LIGHTING UPDATED

Drn. LB	Date AUG'11	Scale NTS@A0
Chkd. BH	Date AUG'11	

Project Title
STONYHURST COLLEGE CLITHEROE

Drawing Title
MEZZANINE 2ND FLOOR
EMERGENCY BATTERY LIGHTING SYSTEM

JRB
ENVIRONMENTAL DESIGN LTD
M&E BUILDING SERVICES CONSULTING ENGINEERS

PROVISIONAL

Drg. No. 010.012.BATT.E6 Rev. B