
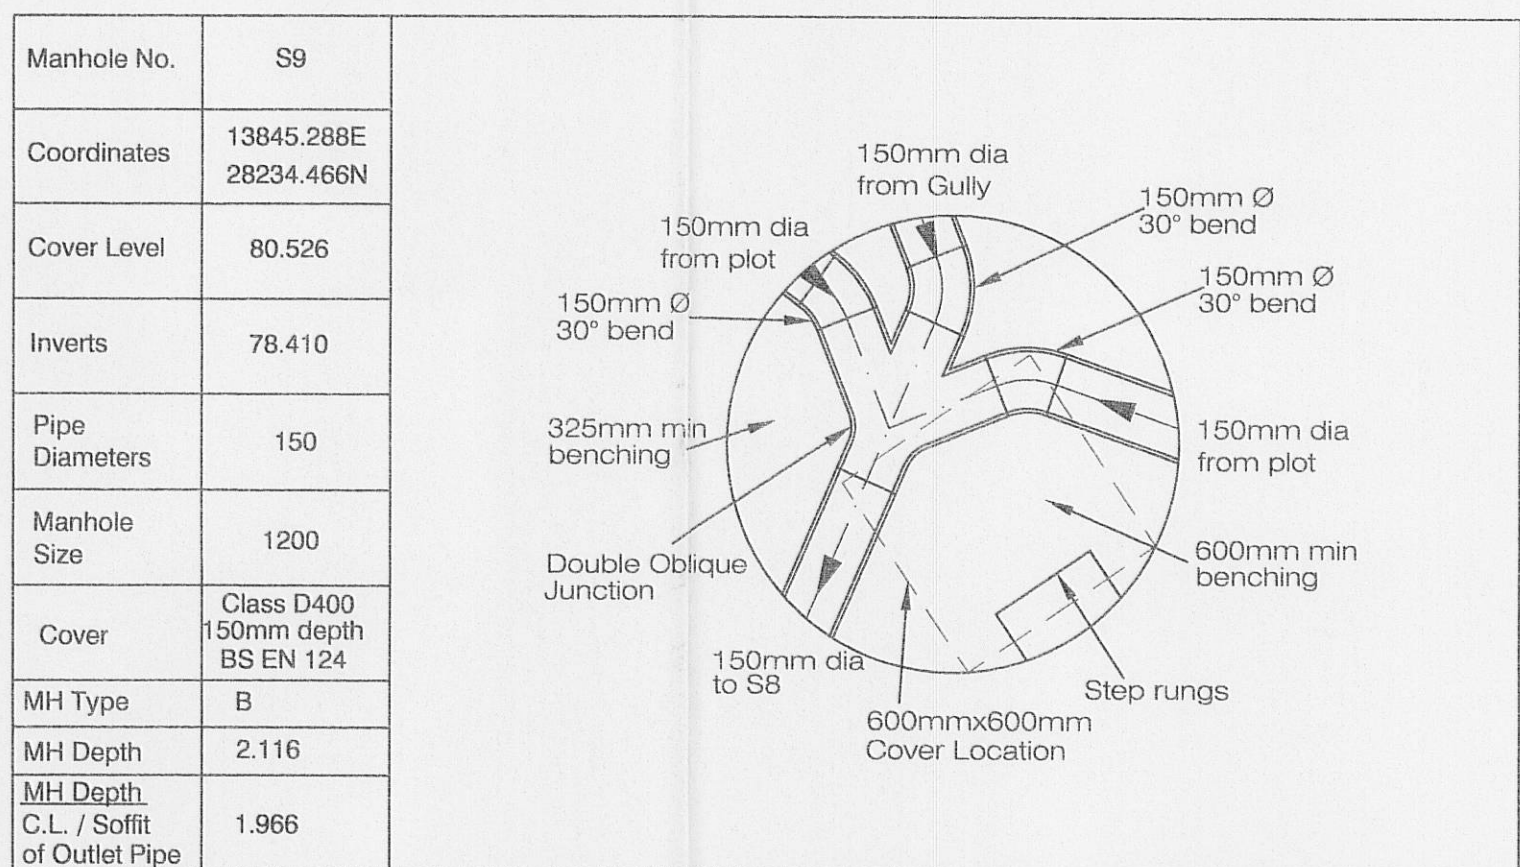
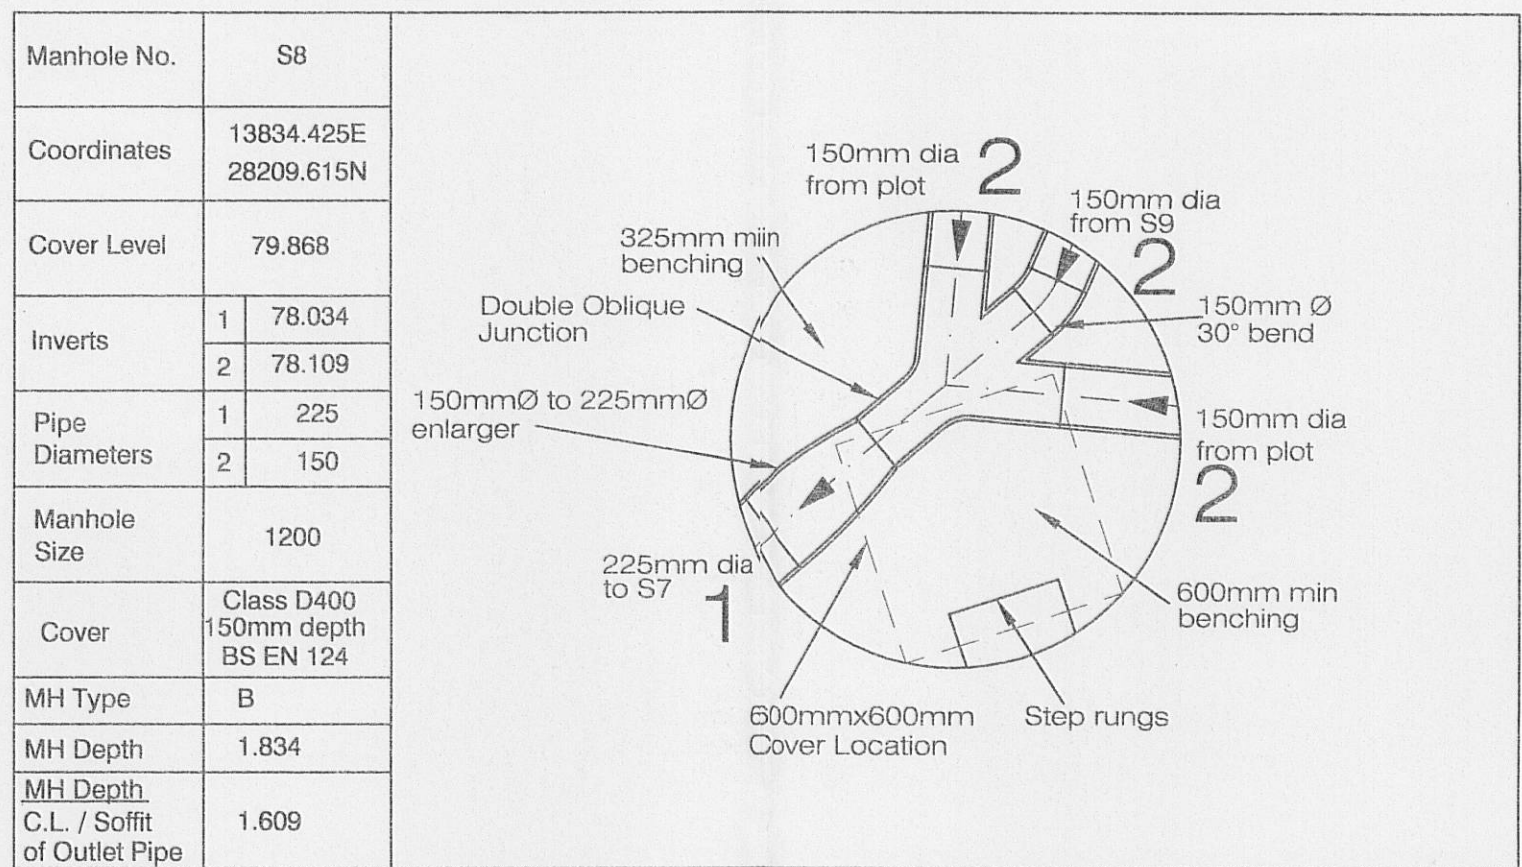
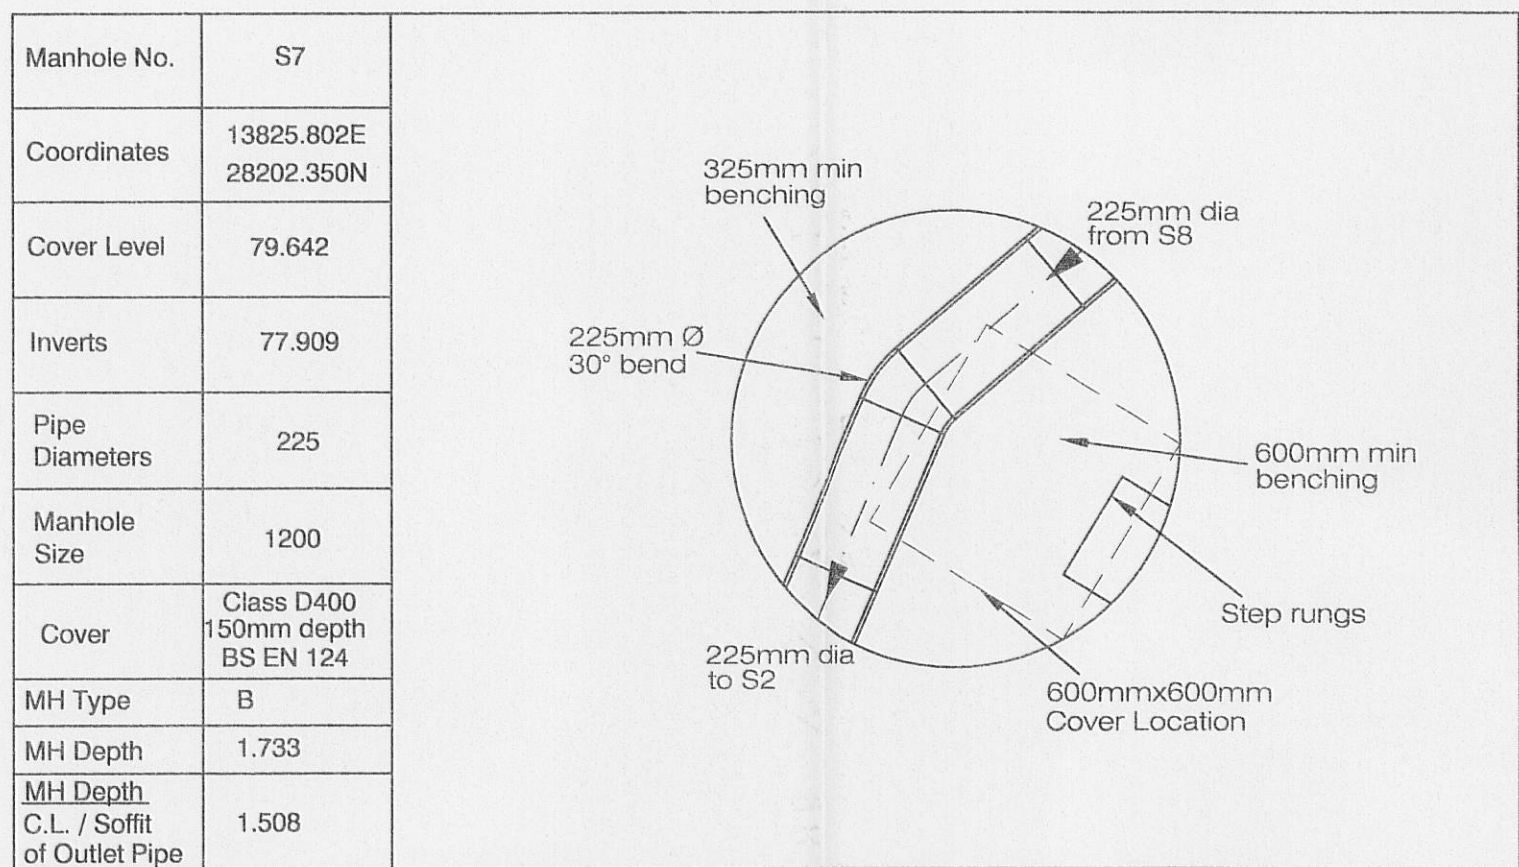
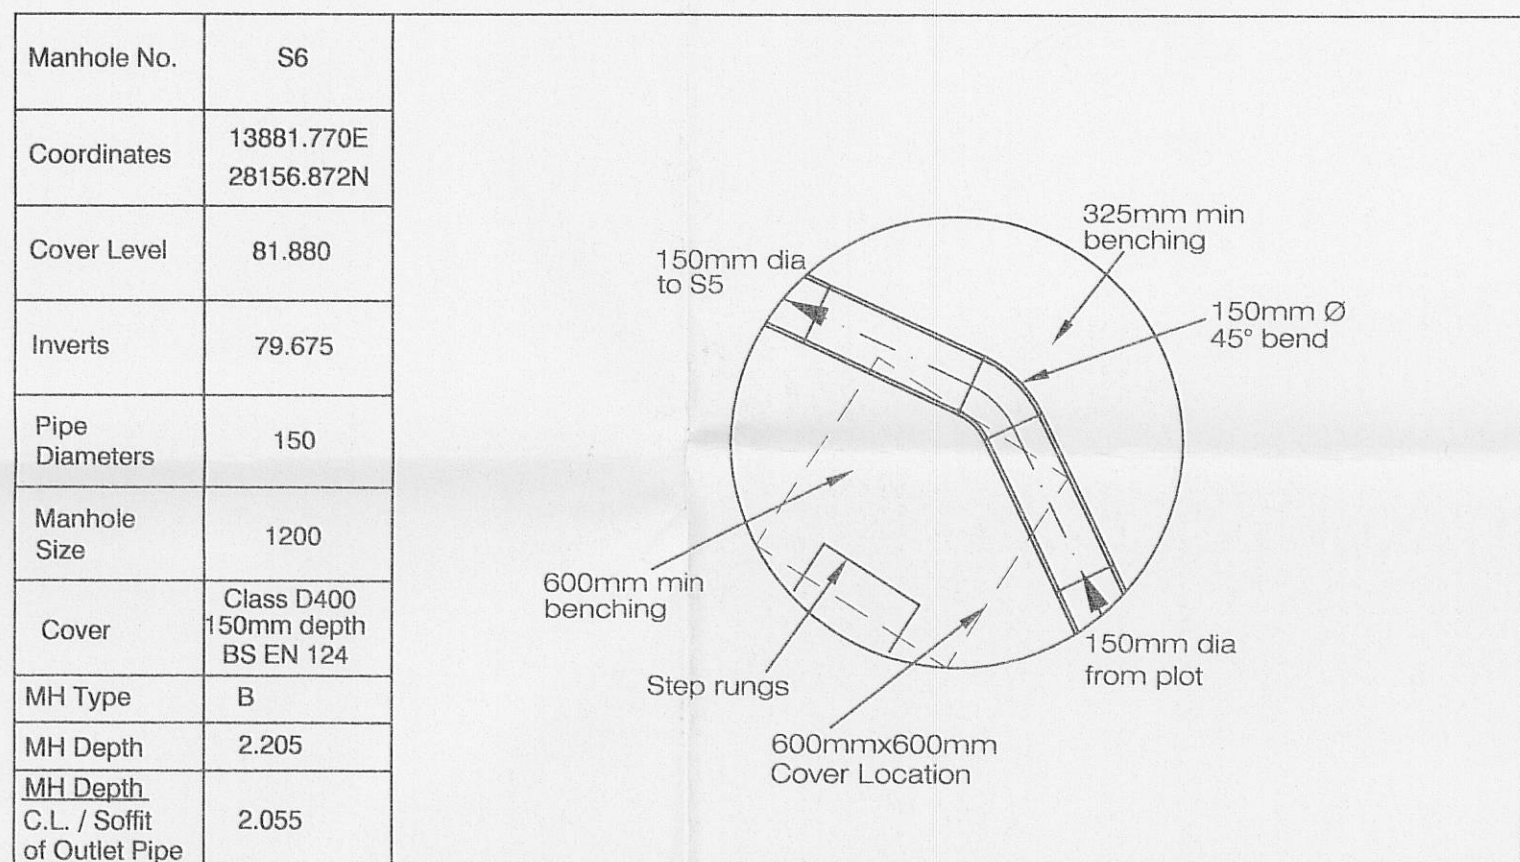
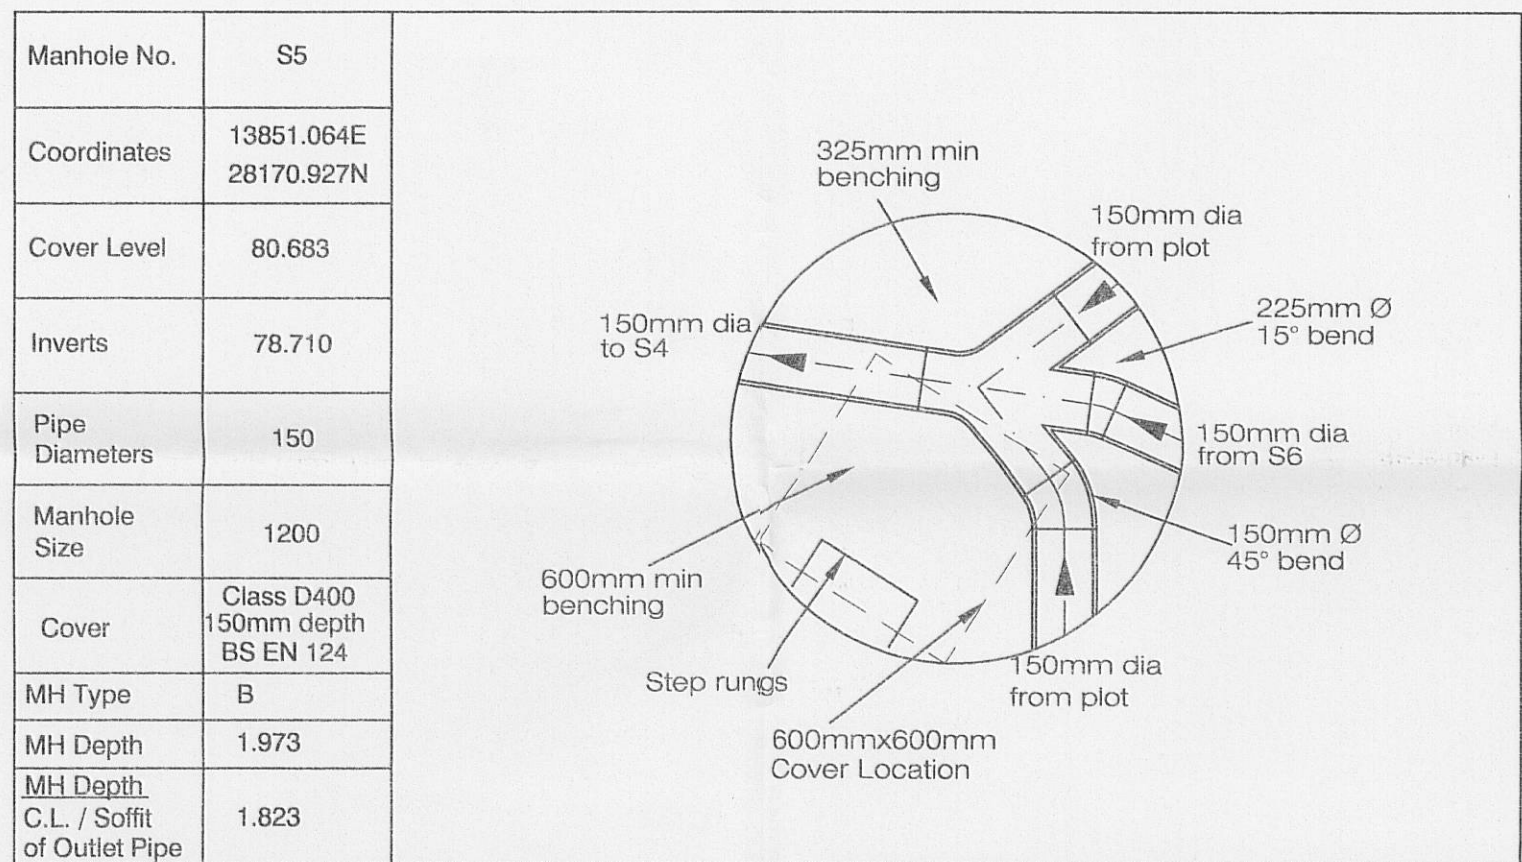
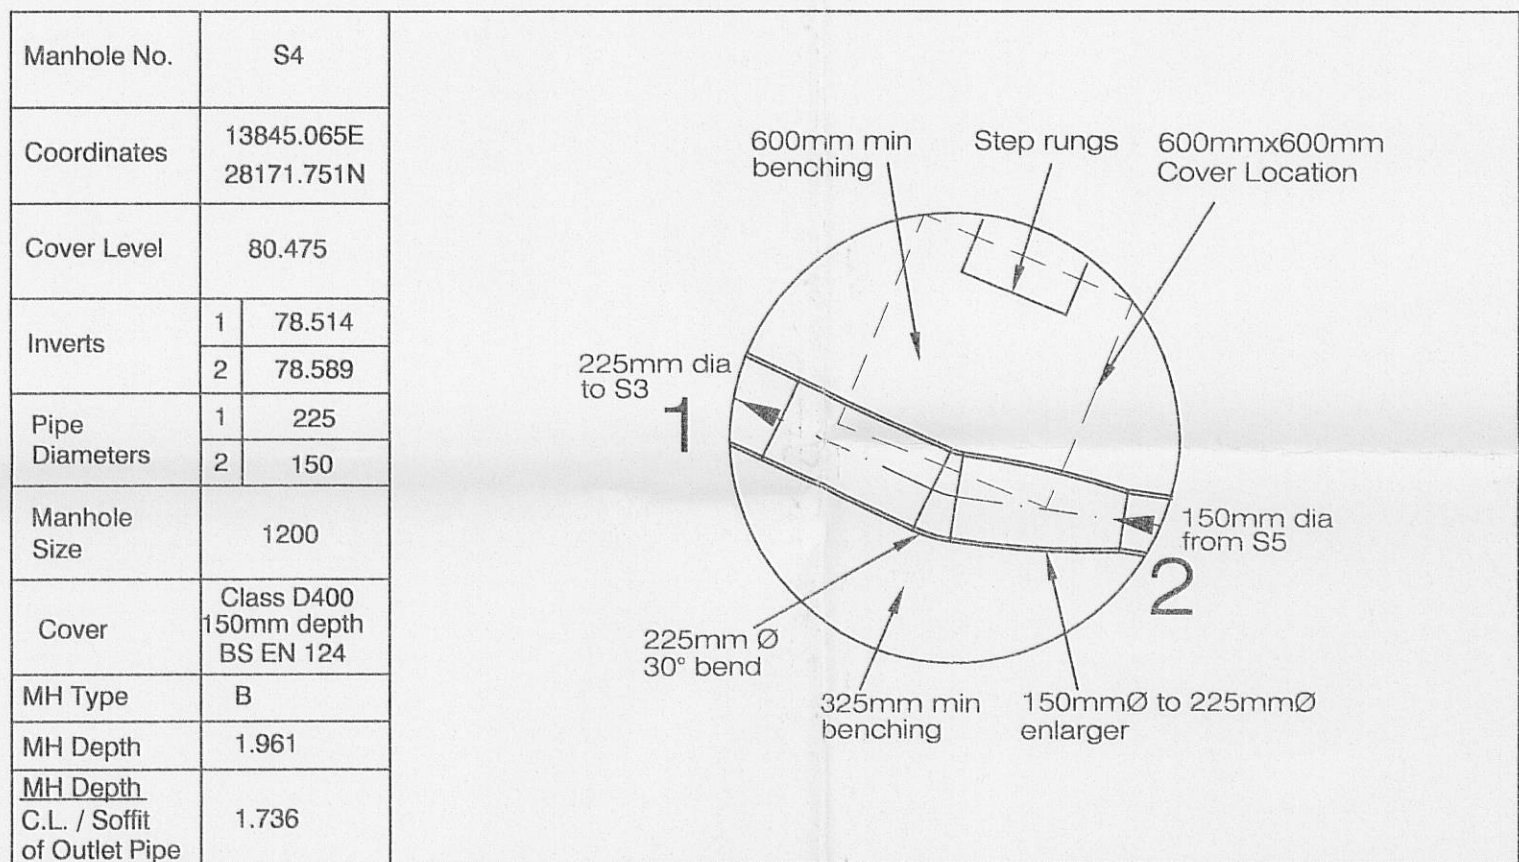
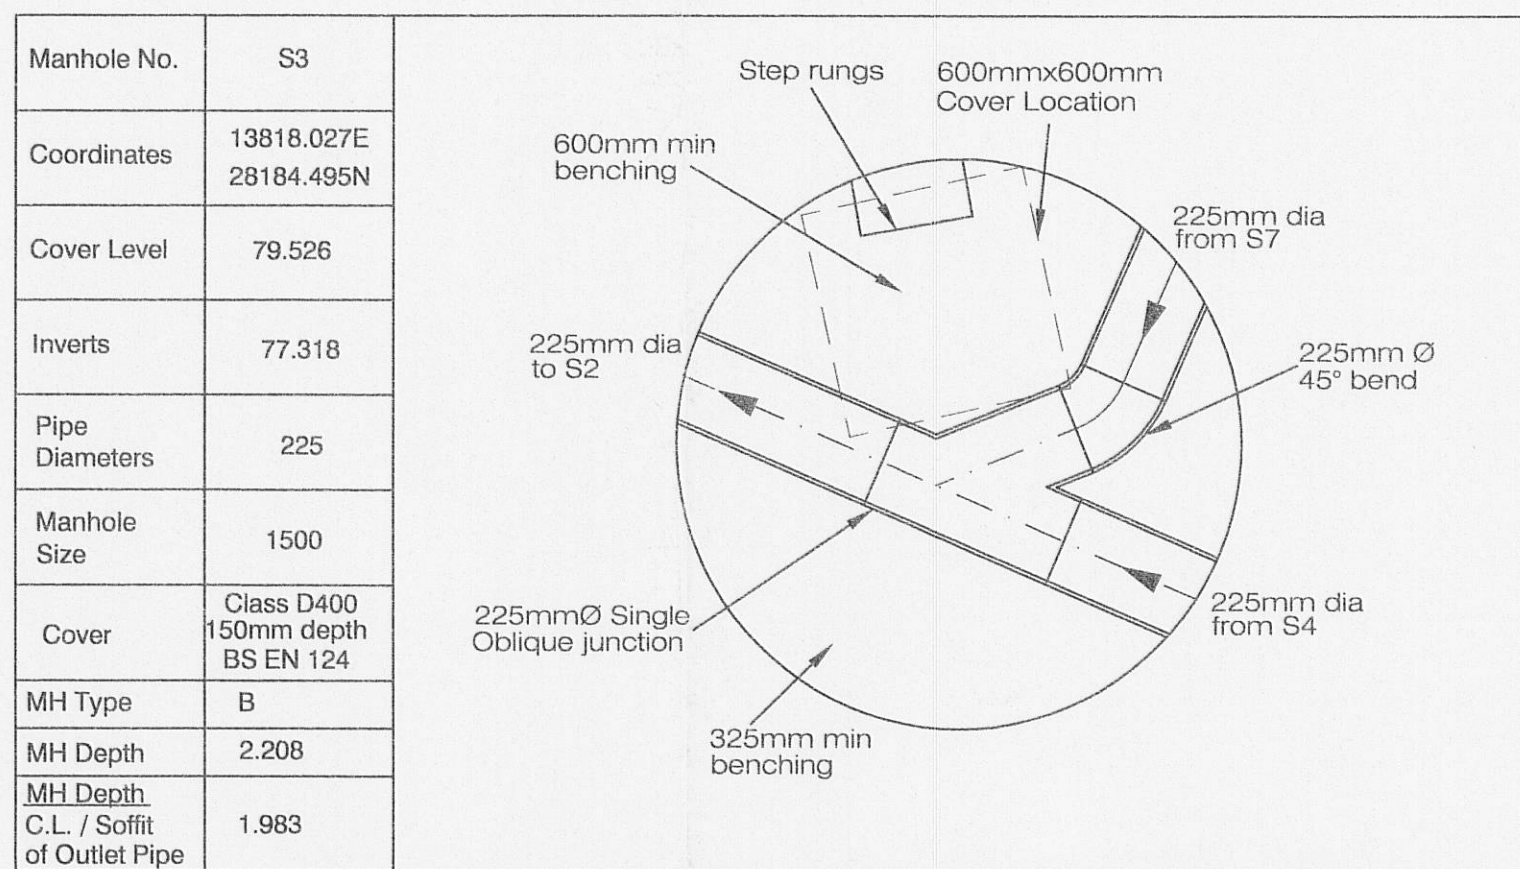
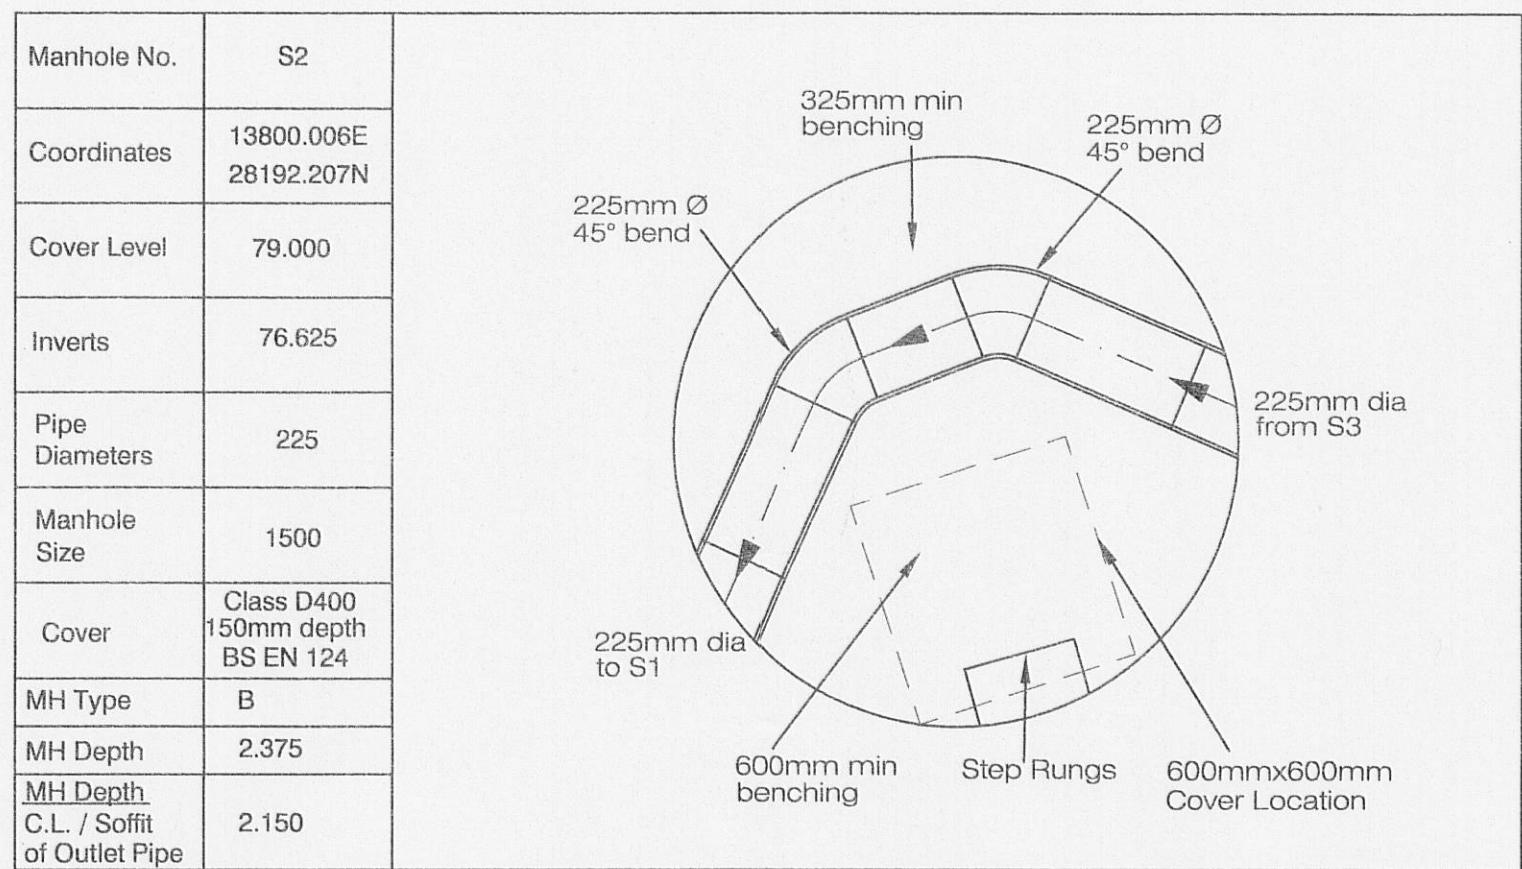


NOTES

1. All works shall be in accordance with Sewers for Adoption 6th Edition and United Utilities Standard Details and Guidelines.
2. Step Rungs shall be used at 300mm Centres.
3. Manholes shall be to Standard Detail STND/01/001. Ladders, Safety chains and Handrailing shall be to Standard Detail STND/01/002. Back-drops shall be to Standard Detail STND/01/003.
4. Co-ordinates are to the Pipe centre-line, not the centre of Manhole.
5. 150mm min concrete surround required for all adopted Manholes.
6. Rocker pipes shall be provided in accordance with United Utilities Standard Details.

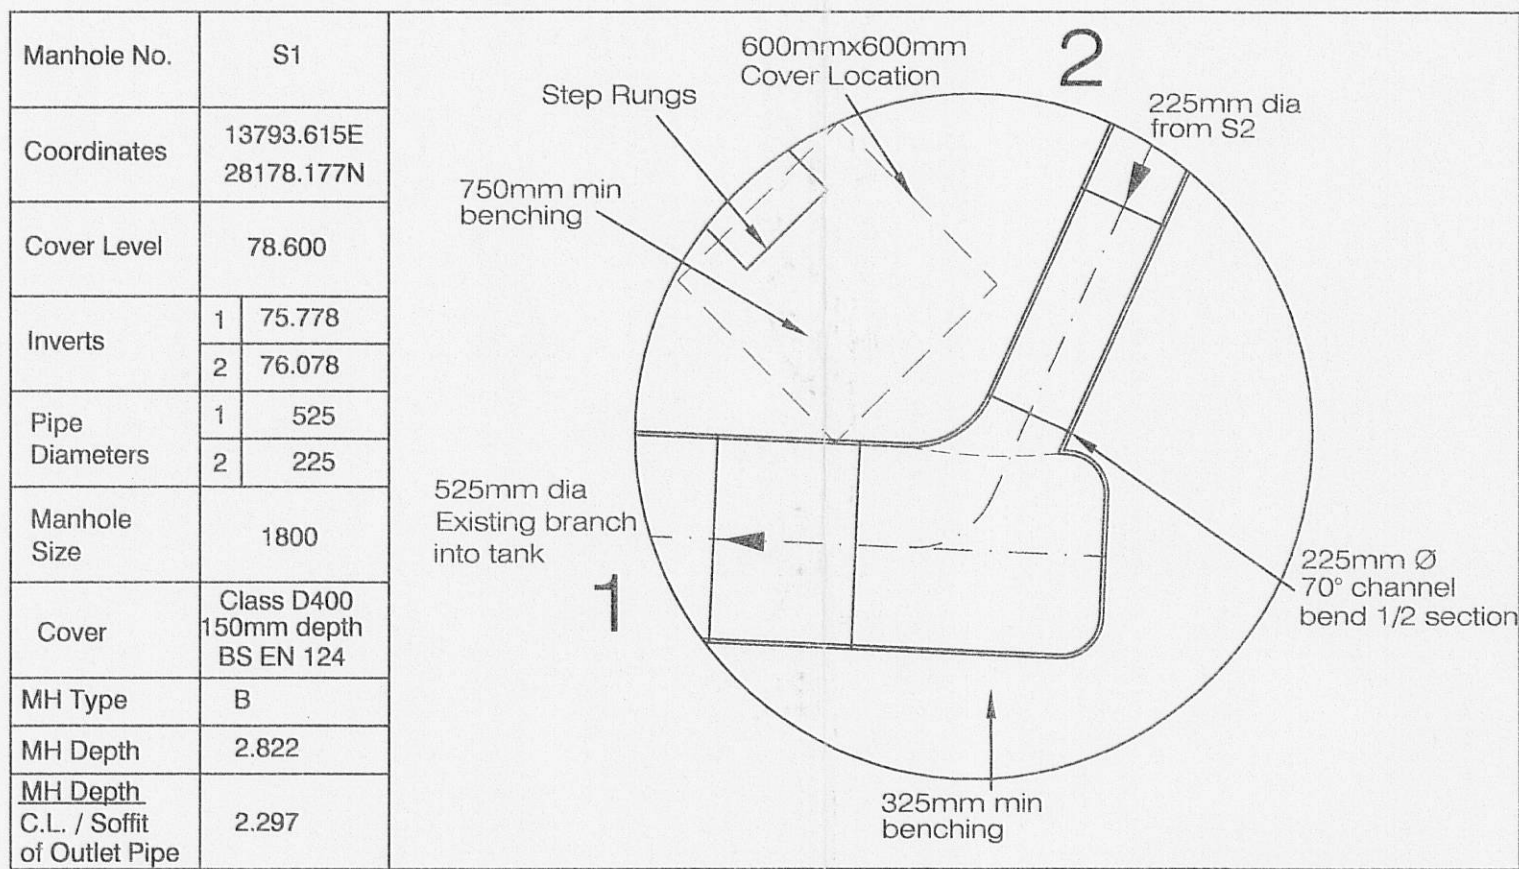

320120273P