



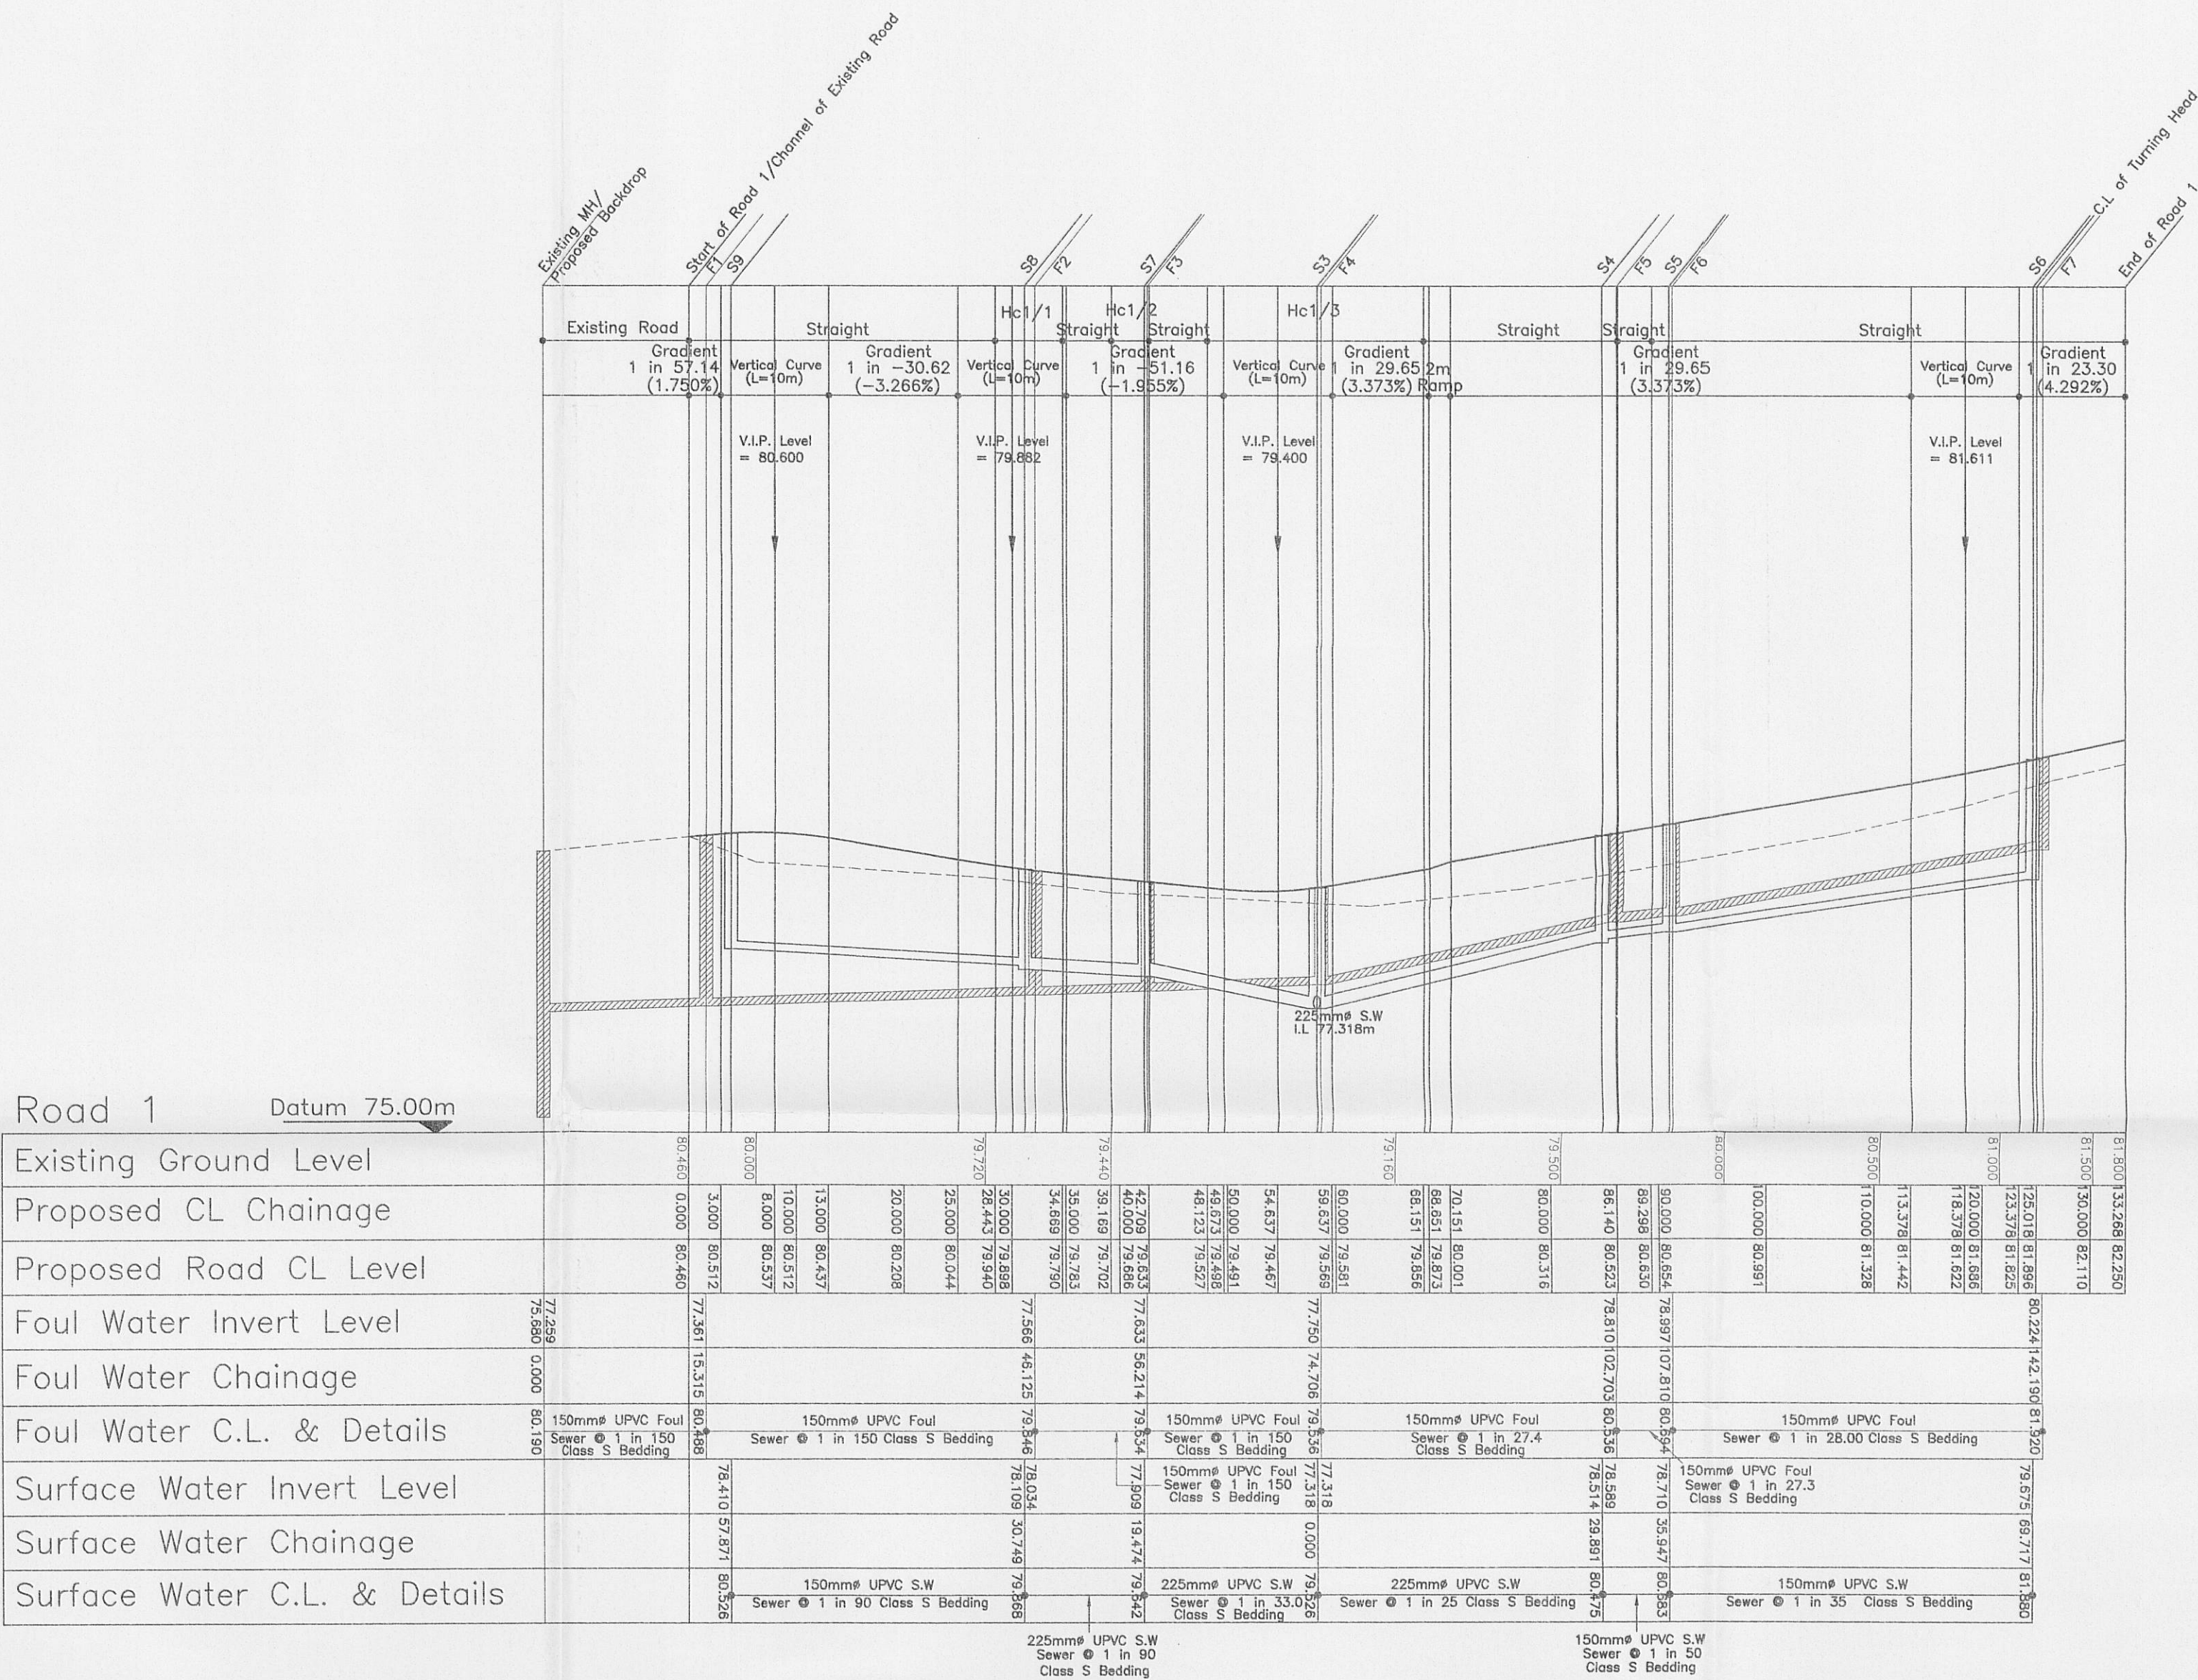

Longitudinal Section Road 1

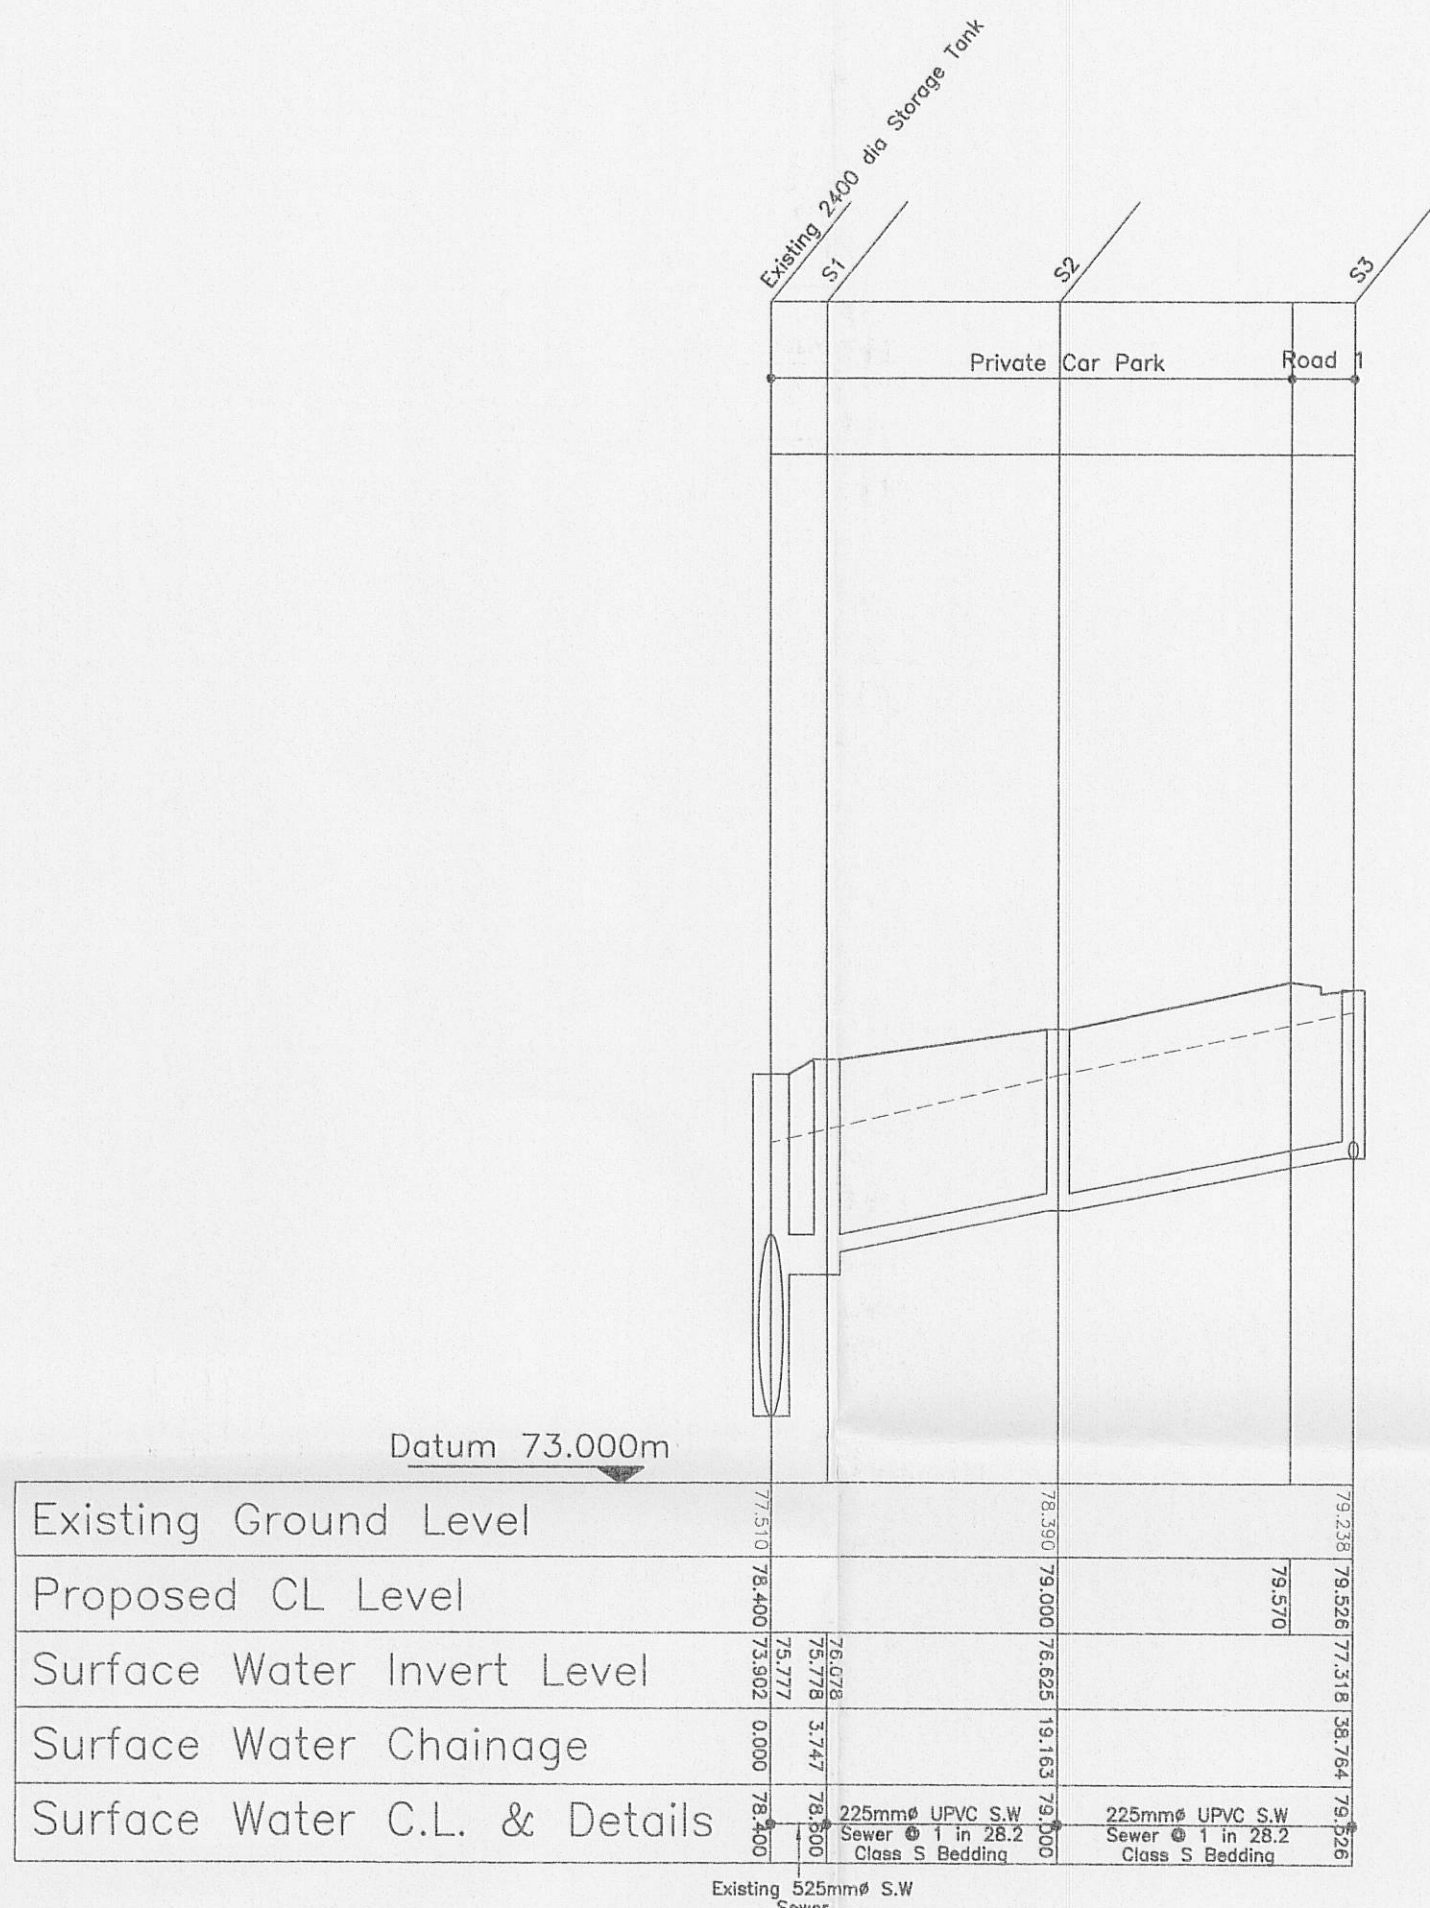

S3 - Storage Tank

320120273P

NOTES

1. Setting out shall be undertaken using only the information given. Distances should not be scaled from this drawing.
2. All sewers and highway drainage shall be constructed in accordance with Sewers for Adoption 6th Edition and United Utilities Details & Guidelines.
3. A minimum 150mm Concrete Protection shall be provided to all sewers with cover of less than 1.2m in highway areas.
4. Sewers shall have a minimum cover of 0.9m.
5. Where "Ultra Rib" UPVC pipes (or similar approved) are used in adoptable drainage they shall still be handled and laid in accordance with the specification and guidance issued by the High performance Pipe Association
6. A Class S Bed and surround must be used for such pipes. Trench backfill in highways to within 1m of highway shall, as directed by the Highway Authority be a suitable granular material all in accordance with Sewers for adoption
7. Plastic pipes must comply with WIS 4-35-01

North Point	Project	Barrow Bridge Clitheroe Phase 2	Ironsides Farrar Experienced Consultants Environmental Planners Civil Engineers Landscape Architects Graphic Design 3 Walsley Court MANCHESTER M26 3NU Tel. 0161 703 8801 Fax. 0161 703 8279 manchester@ironsidesfarrar.com EDINBURGH BELLSHILL			
Quality Ass.	Client	Rowland Homes				
SSS	Title	Longitudinal Sections				
UKAS	Original Set	Approved for Adoption				
A1	Drawn	JCM	Checked By	SRG	Drawing No.	3887/3
	Date	02.11.11	Scale	Horiz 1:500 Vert 1:100	Revision	