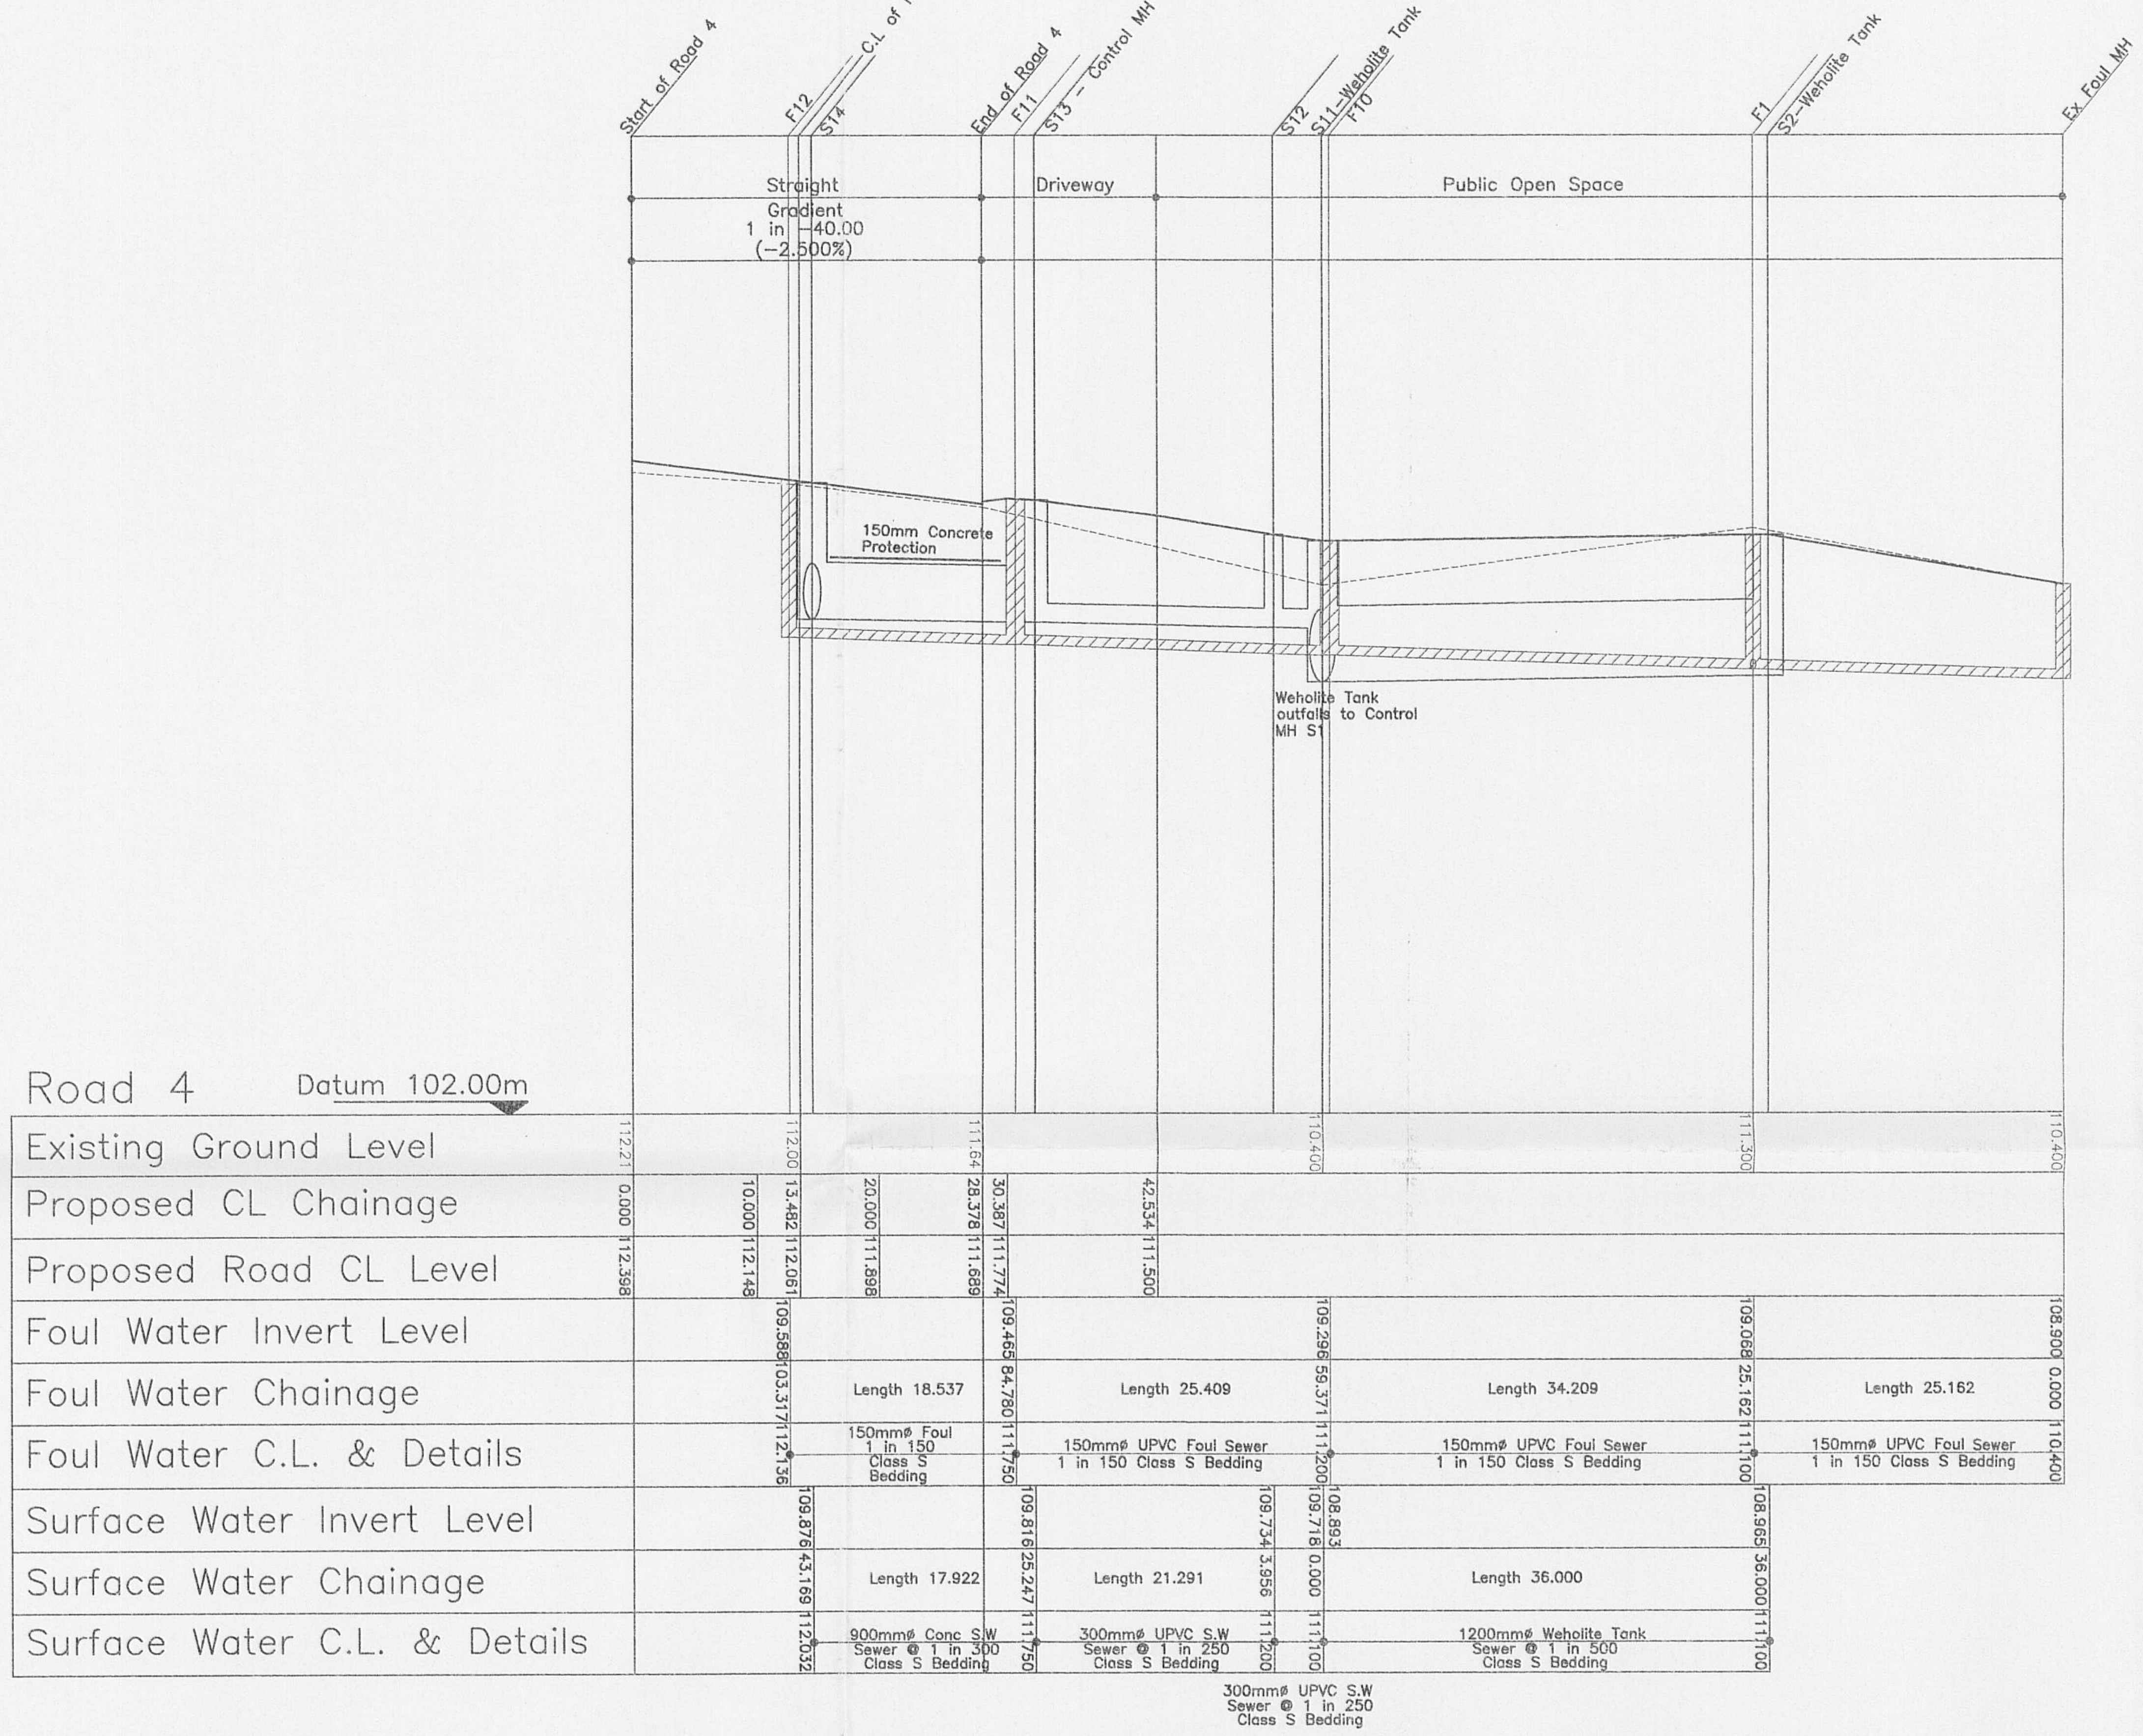

Longitudinal Section Road 4 To Outfall

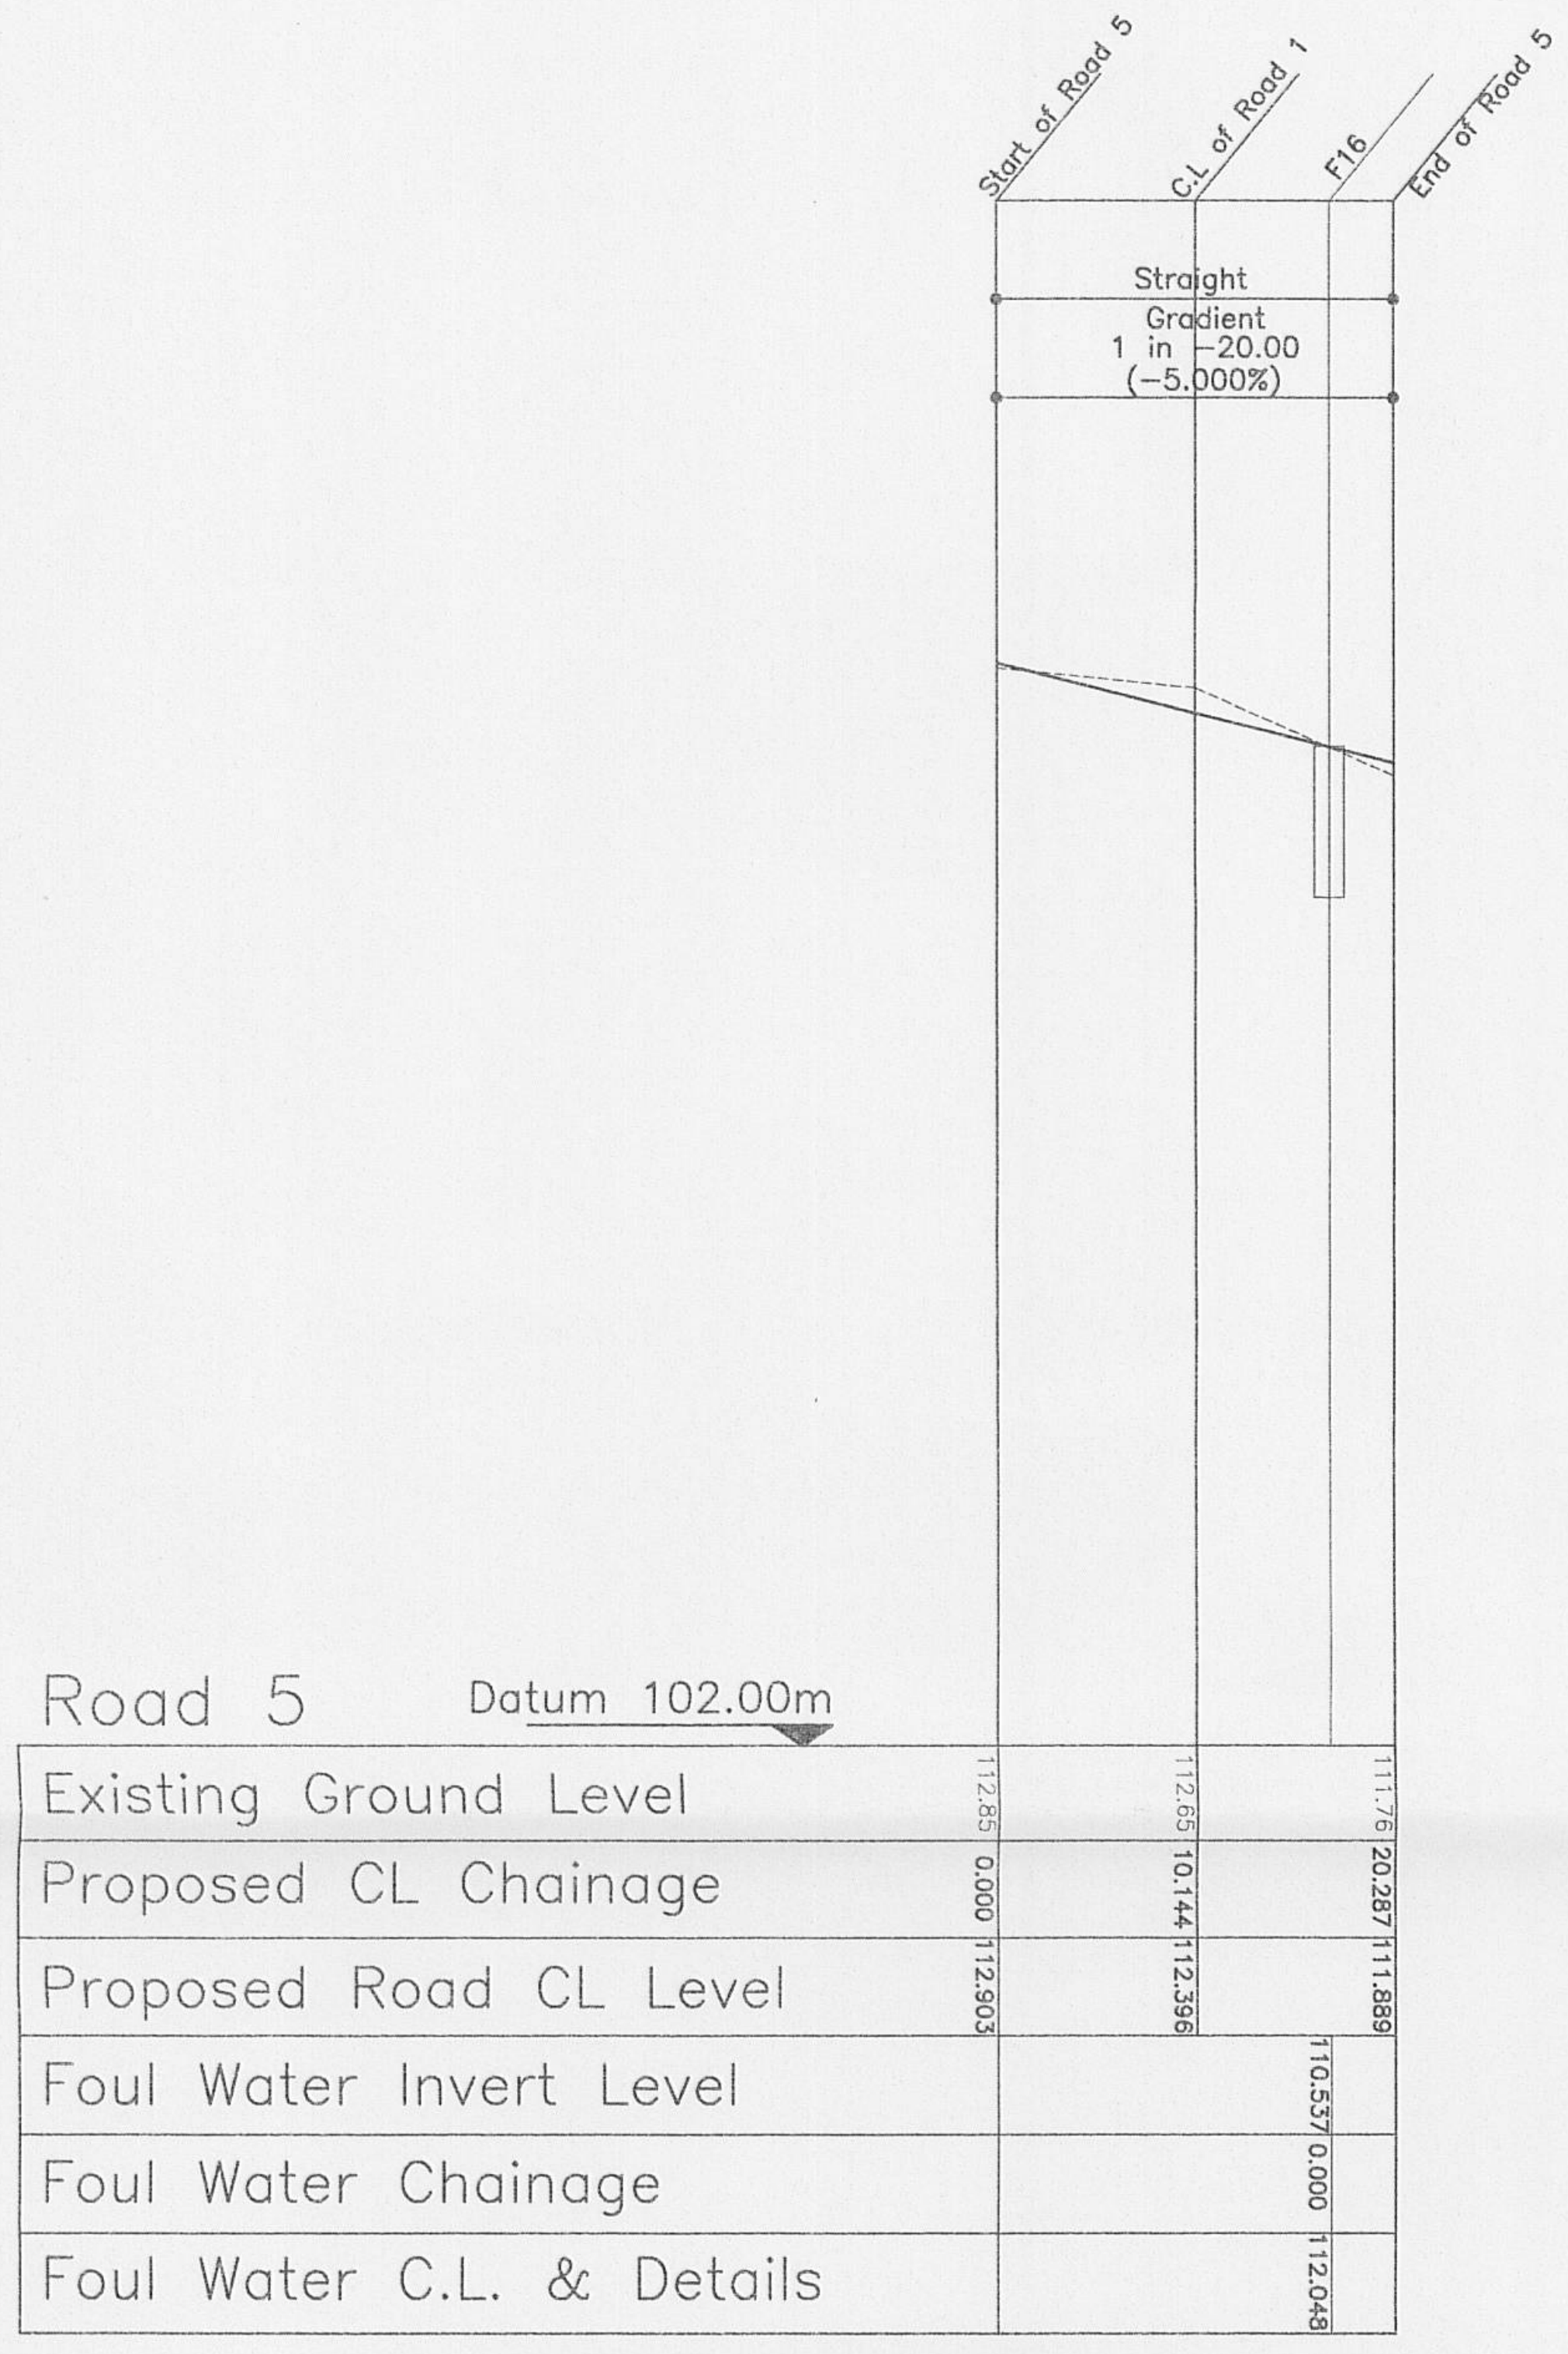

Longitudinal Section Road 5

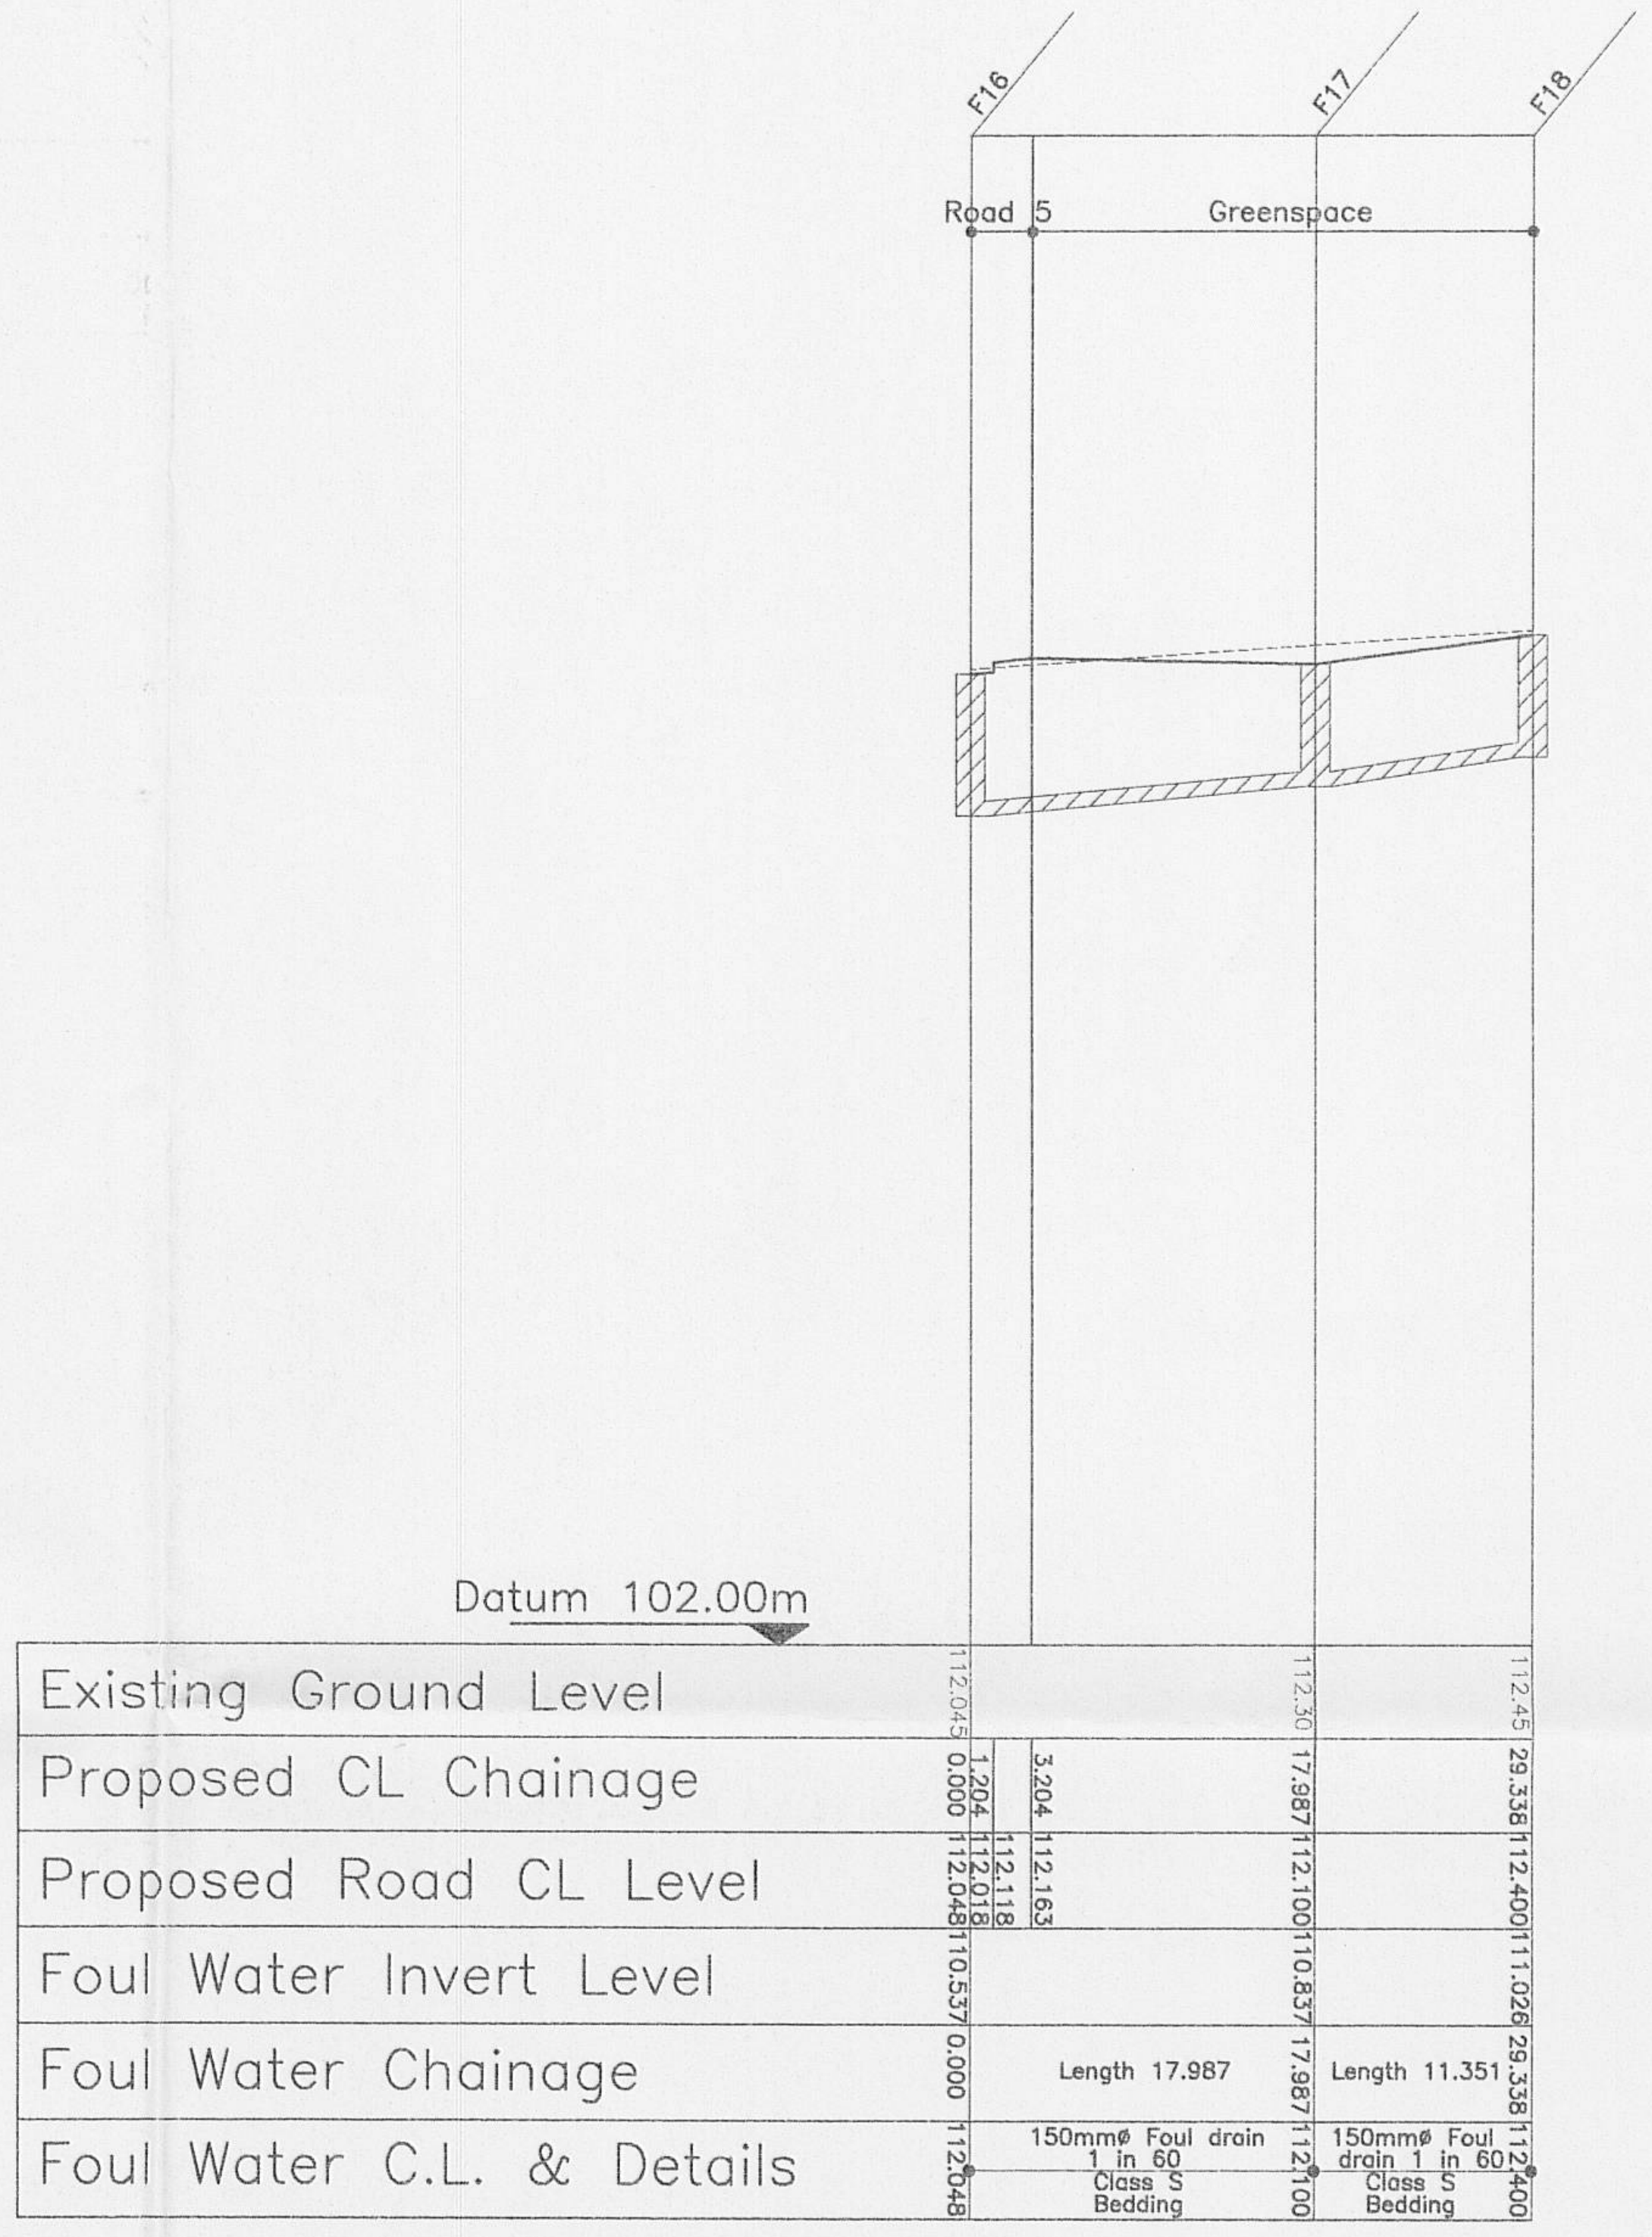

Longitudinal Section F16-F18

320120372P

NOTES

1. Setting out shall be undertaken using only the information given. Distances should not be scaled from this drawing.
2. All sewers and highway drainage shall be constructed in accordance with Sewers for Adoption 6th Edition and United Utilities Details & Guidelines.
3. A minimum 150mm Concrete Protection shall be provided to all sewers with cover of less than 1.2m in highway areas.
4. Sewers shall have a minimum cover of 0.9m.
5. Where "Ultra Rib" UPVC pipes (or similar approved) are used in adoptable drainage they shall still be handled and laid in accordance with the specification and guidance issued by the High performance Pipe Association
6. A Class S Bed and surround must be used for such pipes, Trench backfill in highways to within 1m of highway shall, as directed by the Highway Authority be a suitable granular material all in accordance with Sewers for adoption
7. Plastic pipes must comply with WIS 4-35-01

North Point

Project
Dilworth Lane
Longridge

Quality Ass.

Client
Rowland
Homes

Title
Longitudinal
Sections
Road 4&5

PRELIMINARY

Ironside**Farrar**
Environmental**Consultants**
Environmental**Planners**
Civil**Engineers**
Landscape**Architects**
Graphic**Design**

3 Worsley Court **MANCHESTER** M28 3NJ
Tel. 0161 703 8801 Fax. 0161 703 8279
manchester@ironsidefarrar.com

EDINBURGH BELLSHILL

Original Size	Copyright Acknowledgement	Drawn	Checked By	Drawing No.	Revision
A1	©Crown Copyright. All rights reserved. Licence No. AL1000117966.	JCM		3891/3/3	
		Date	Scale		
		13.01.12	Horiz 1:500 Vert 1:100		