


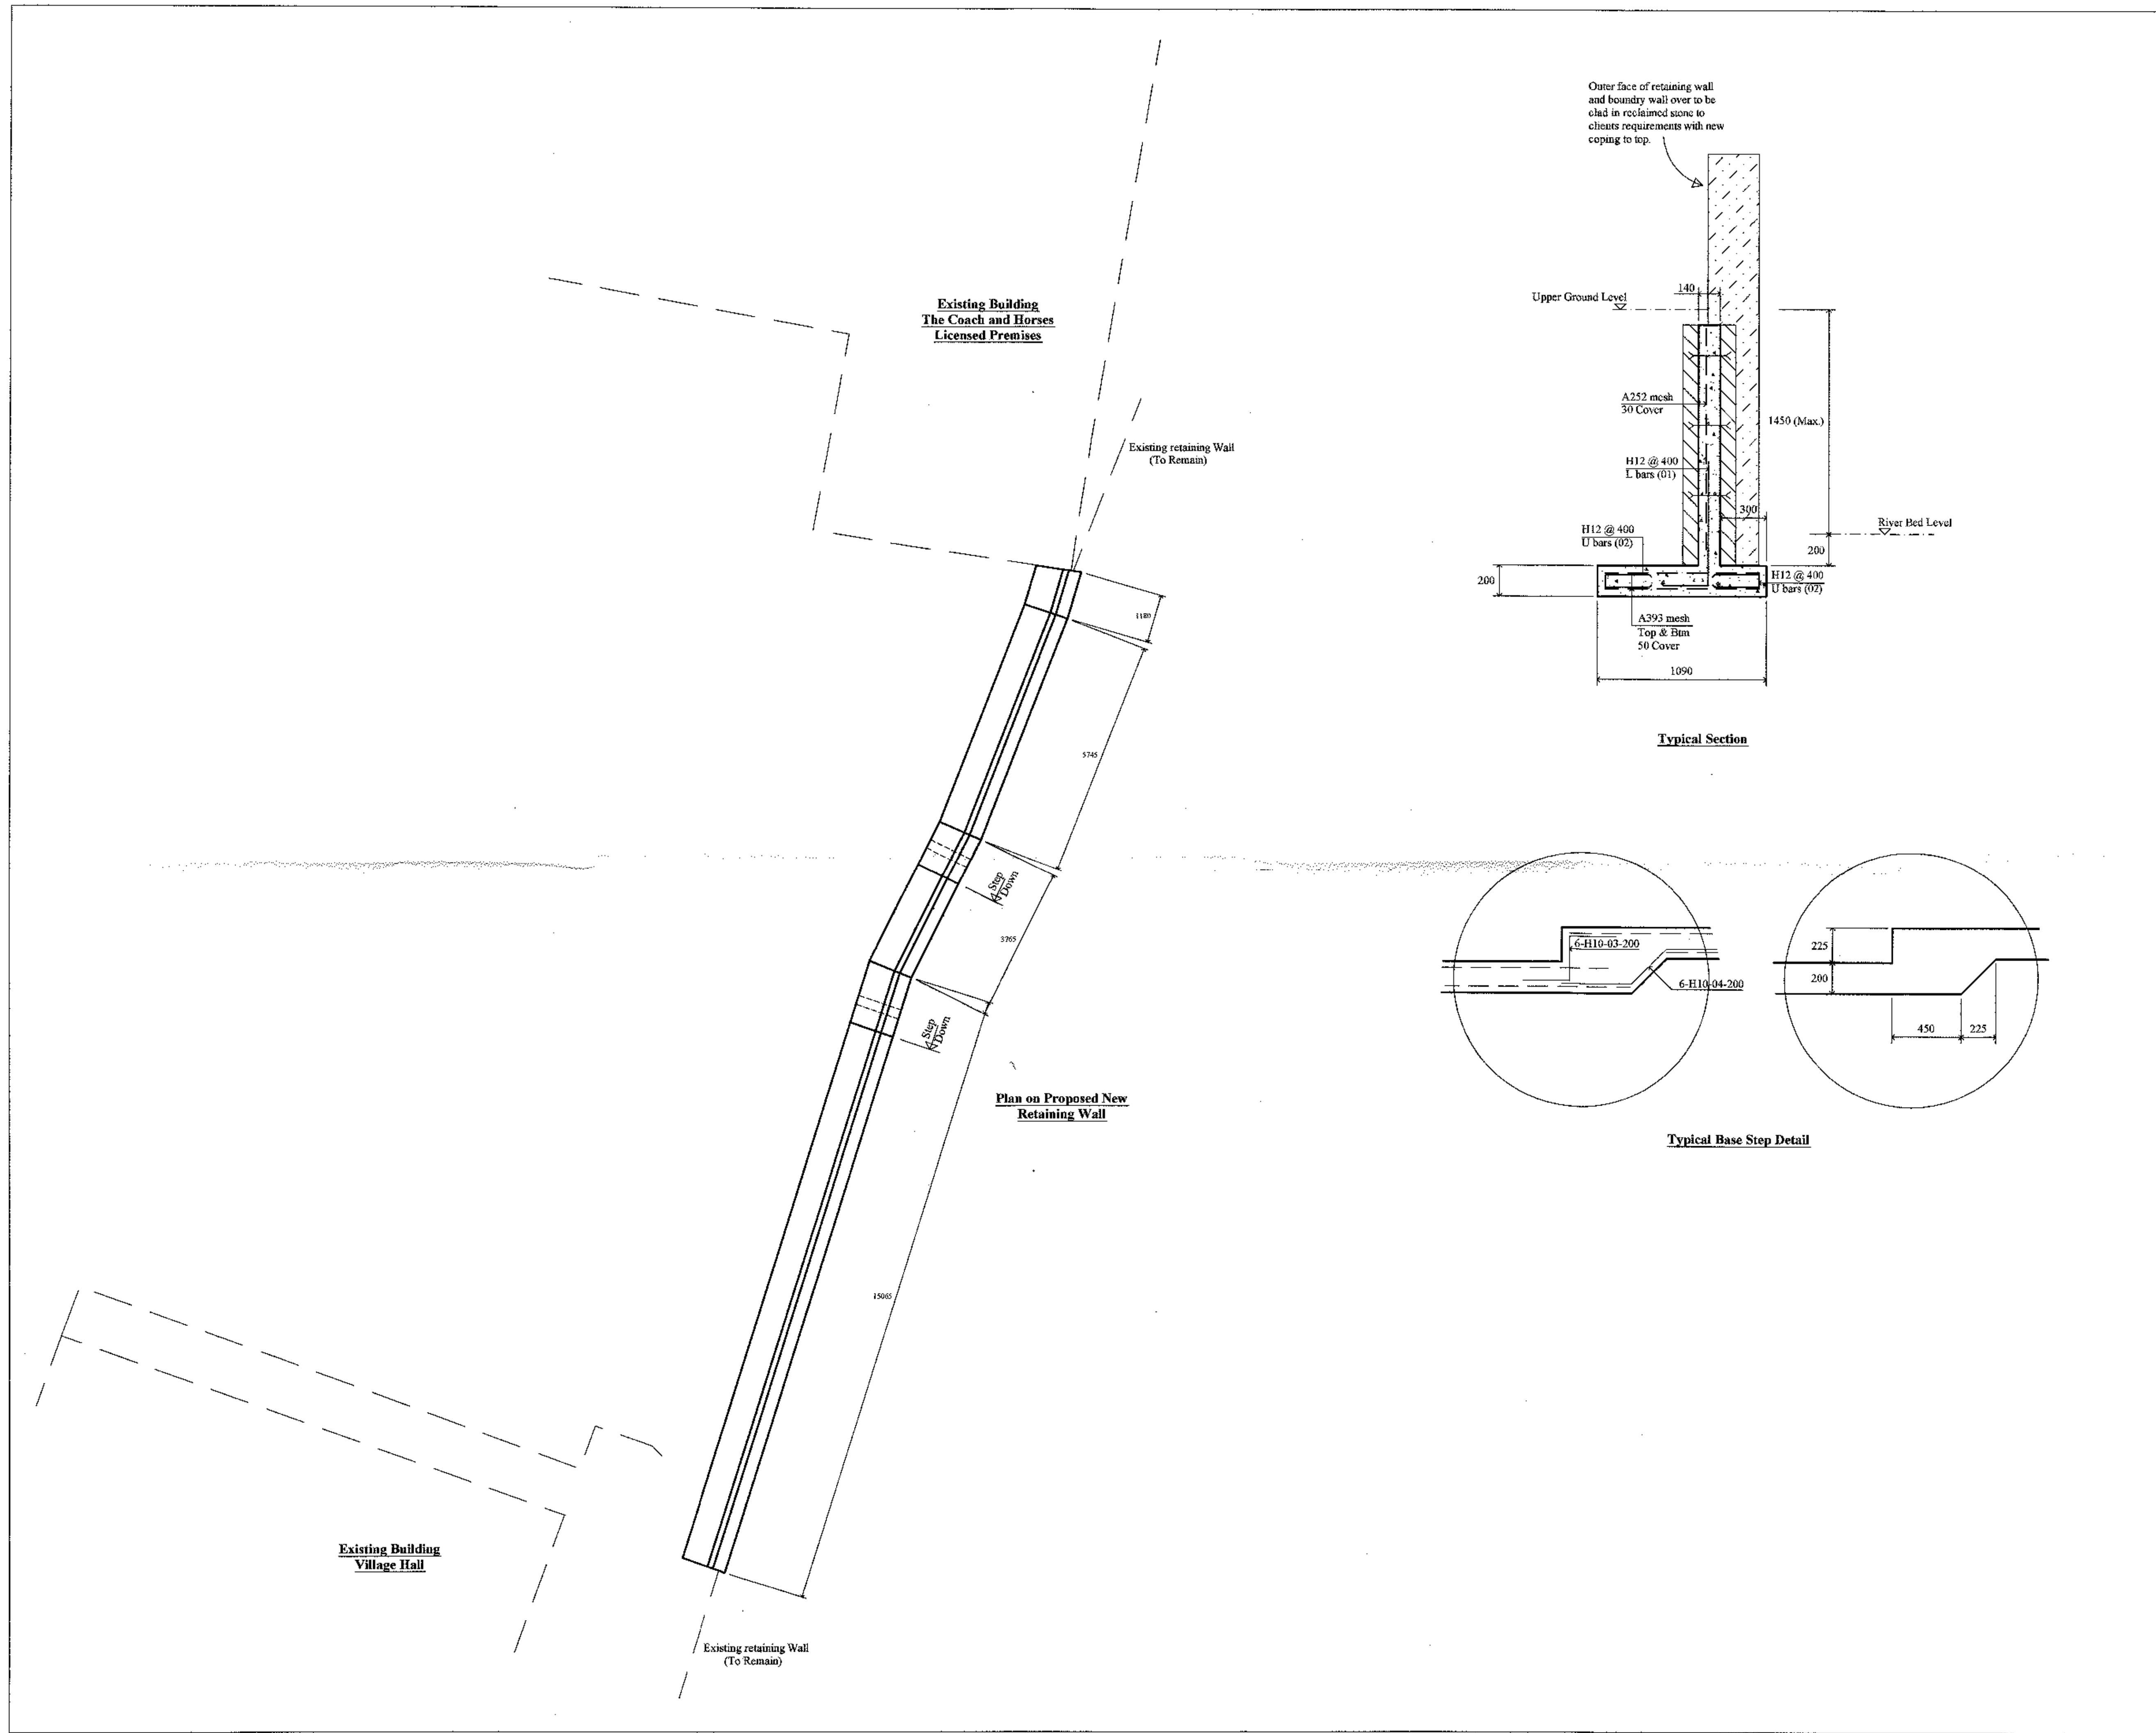

NOTES

Wall Construction:

1. All Concrete to be minimum Grade C35 with:-
Min. cement content 300kg/m³ O.P.C.
Max. Water/Cement Ratio 0.6
Max. aggregate size 20 mm.
2. Blockwork to be 100mm. Thk medium density solid block laid in Des 2 mortar. Provide stainless steel cavity wall ties between skins at 450 c/cv horiz. and vertically.

320120670P

Rev	By	Description	Chk'd	Date
-----	----	-------------	-------	------

Client/Architect

Contract

Proposed New Section of Retaining Wall
Kirk Beck
The Coach & Horses, Bolton-by Bowland

Title

General Arrangement
Plan and details

Date: May 2012
Scale: 1:75, 1:20
Original size A1
Drawn: P.A.
Checked:

ABBOTT & LOMAX
Consulting Engineers
Unit 136 Glenfield Park Business Centre
Phillips Road
Blackburn BB1 5PP
Tel 01254 278495 Fax 01254 278038

Drawing No.

B1796/One

Revision.