



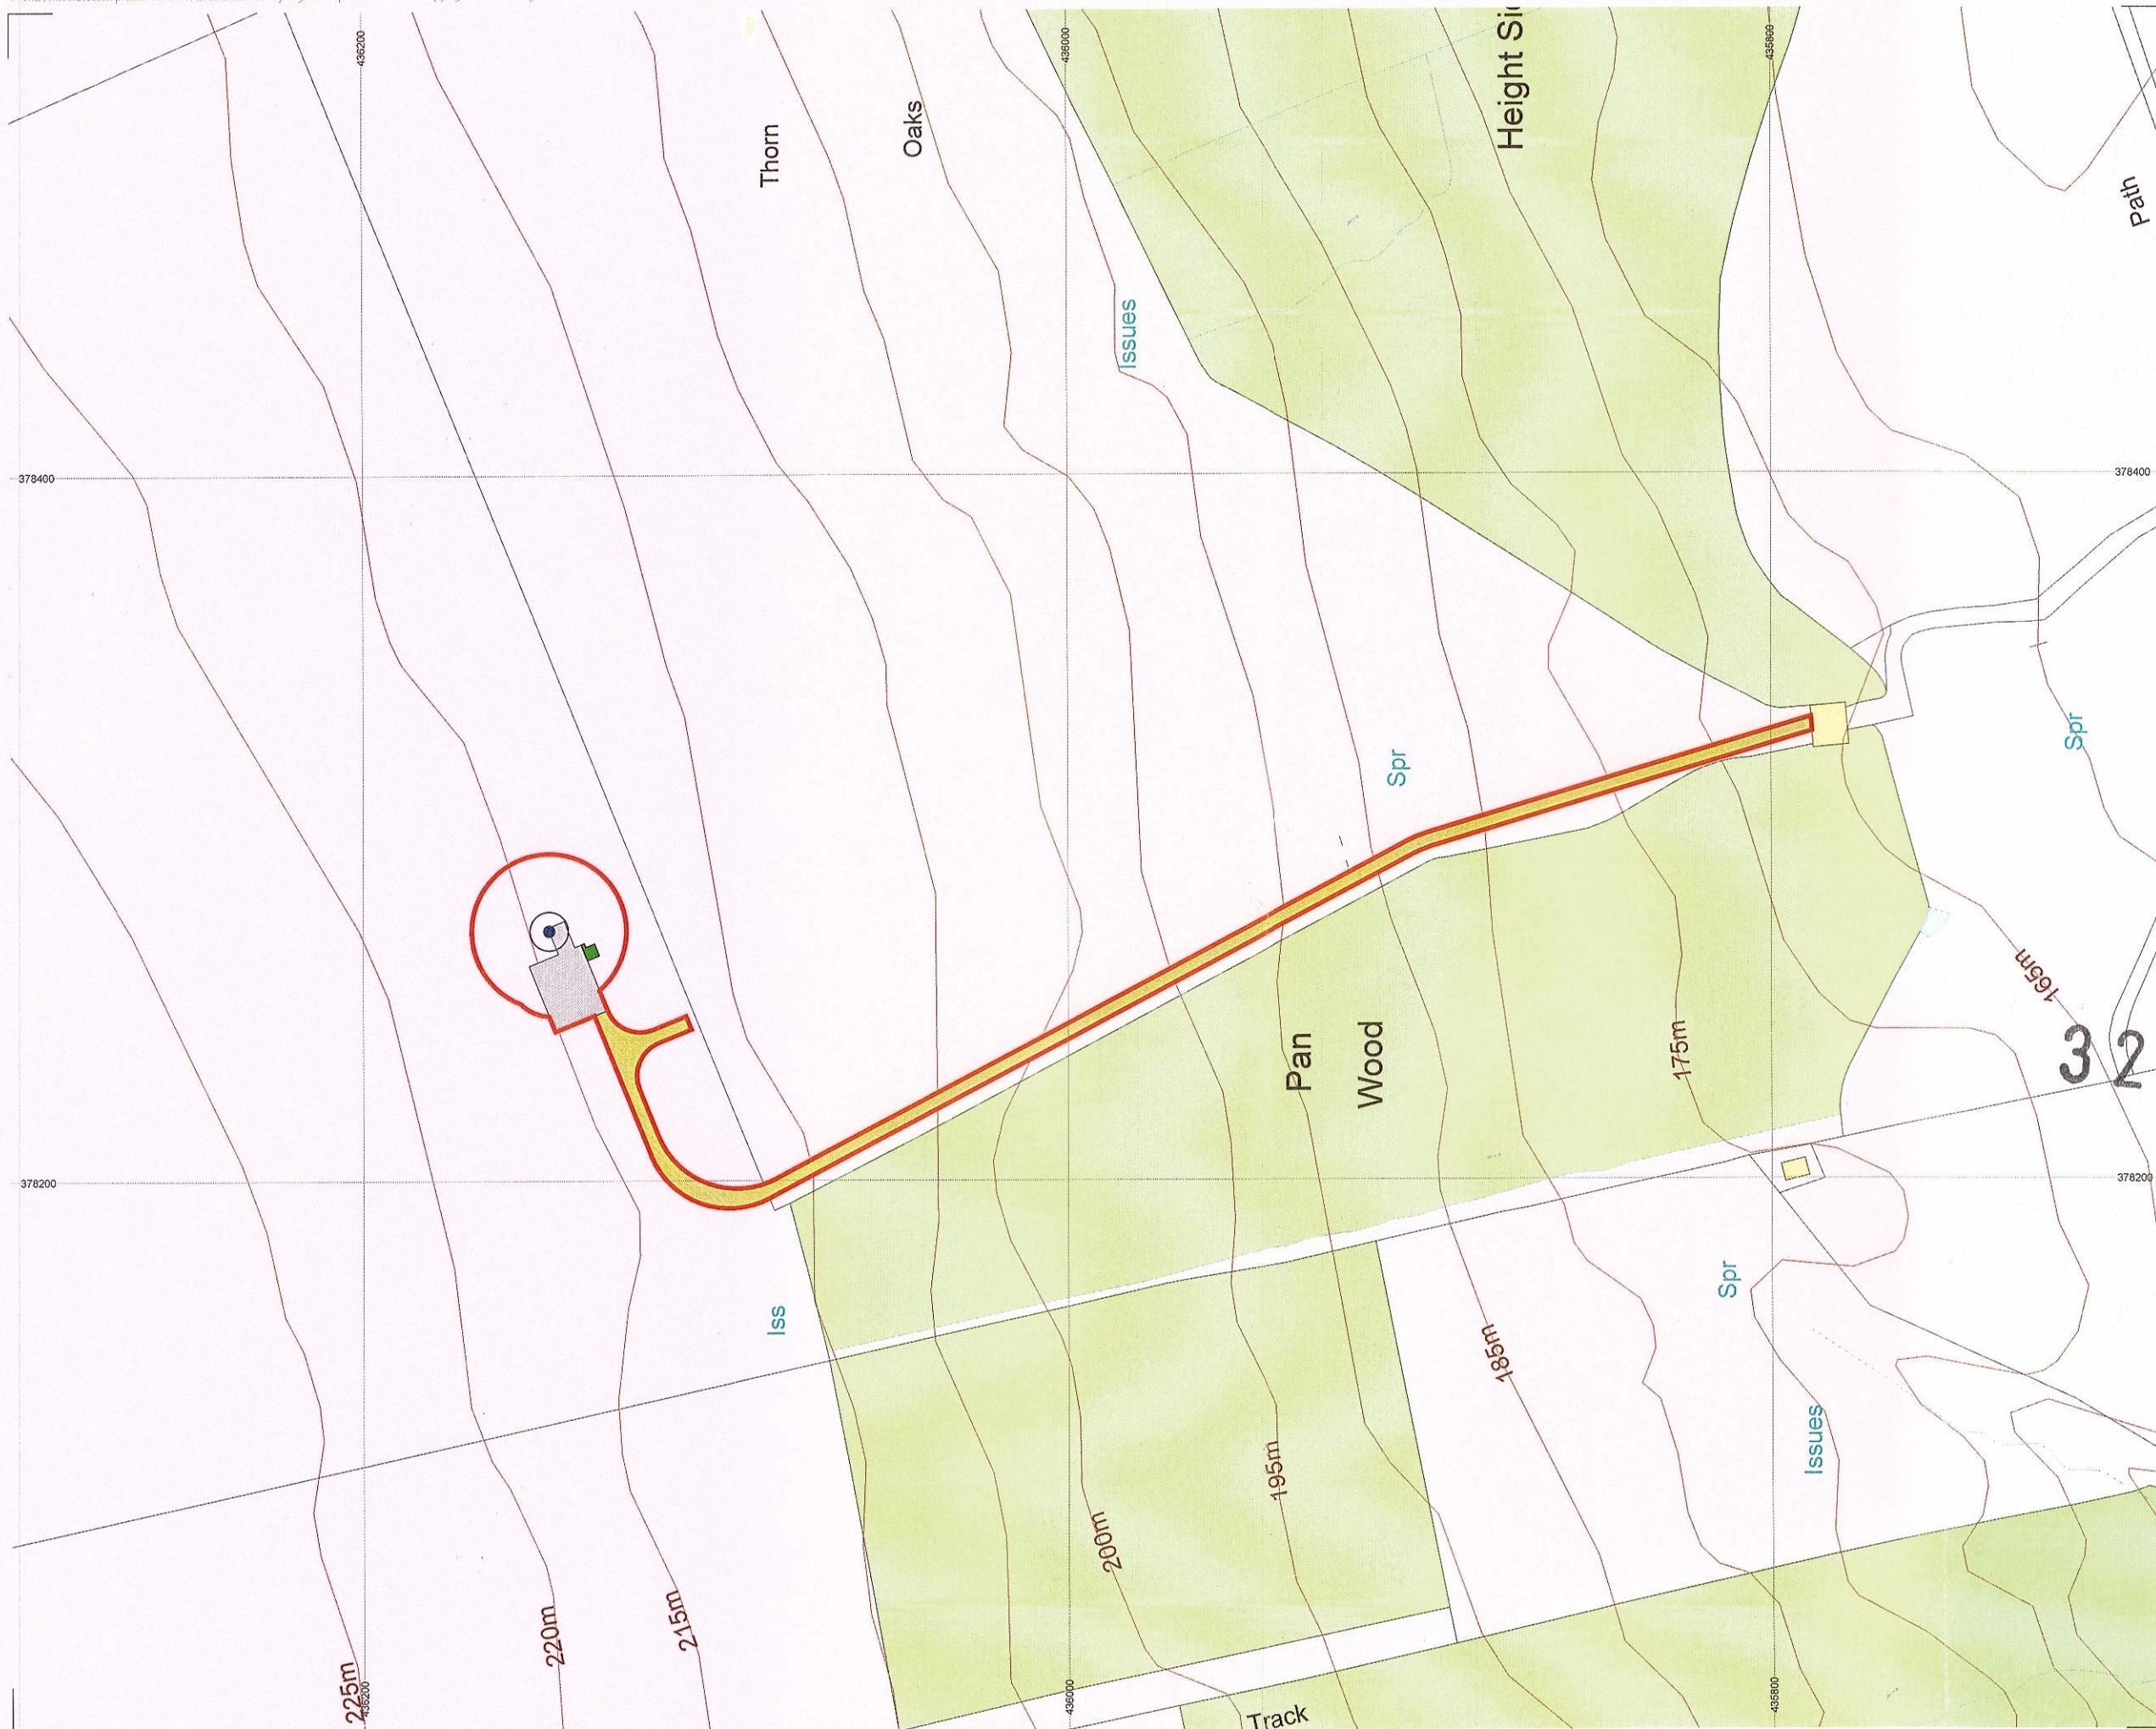

legend

-  Site boundary
-  Turbine location
-  Indicative proposed access track & turning point
-  Crane pad
-  Sub-station

- Notes:
- Information shown relates to Enercon Access Roads and Crane Platforms Specification.
 - Access road to be a minimum of 4m wide and 5.5m wide on curved sections.
 - Minimum clearance width should be 3.5m, and clearance height should be 3.5m.
 - The crane pad shown is 20x16m, however this is subject to specific turbine selection.
 - Access road external radii to be 24m.
 - The sub-station is to be micro-sited within the 22m radius zone of the turbine during construction stage.
 - Proposed turbine coordinates: 378271, 436147
 - Proposed site area = 0.3414ha



0 10 25 50
metres

project title	N160: Huntroyde
figure title	2: Site Layout & Access
figure reference	N160-GR-PA-002B
scale	1:1,250 @ A2
date	August 2012

one •• associates