

- WINDOWS
- polyester powder coated aluminium windows to BS 4873.
 - thermally broken aluminium system.
 - corners to be mitred (45 degree)
 - all mechanical joints shall be sealed against entry of water
 - polyester powder coat finish. colour RAL 9007 - matt (grey aluminium).
 - all fixings to be stainless steel, aluminium alloy or other suitable corrosion resistant material.

- STONE
- stone surrounds to windows.
 - all stone to be sourced from the same quarry (eg Kemple End) - sample to be provided to client for approval prior to ordering.
 - ashlar stone jambs to sliding door be tied to adjacent walls at max 250mm vertical ctrs. supplier to advise on suitable ties for stone thickness.
 - all seen edges to have a finished face, where edges are partially seen finish to extend min. 50mm.
 - cills to be 150x250mm overall with weathering to upper face and drip to bottom face, all arises to be sharp.
 - heads as described.
 - pointing using 1:1:6 (cement:lime:sand) mortar, sand colour to match stonework.

no measured survey of the property has been undertaken by the architect.



this drawing is to be read in conjunction with all relevant consultants and specialist's drawings.

the architect is to be notified of any discrepancies before proceeding.


do not scale from this drawing.

all dimensions are to be checked on site.

this drawing is subject to copyright and is not to be reproduced without the consent of the architect.

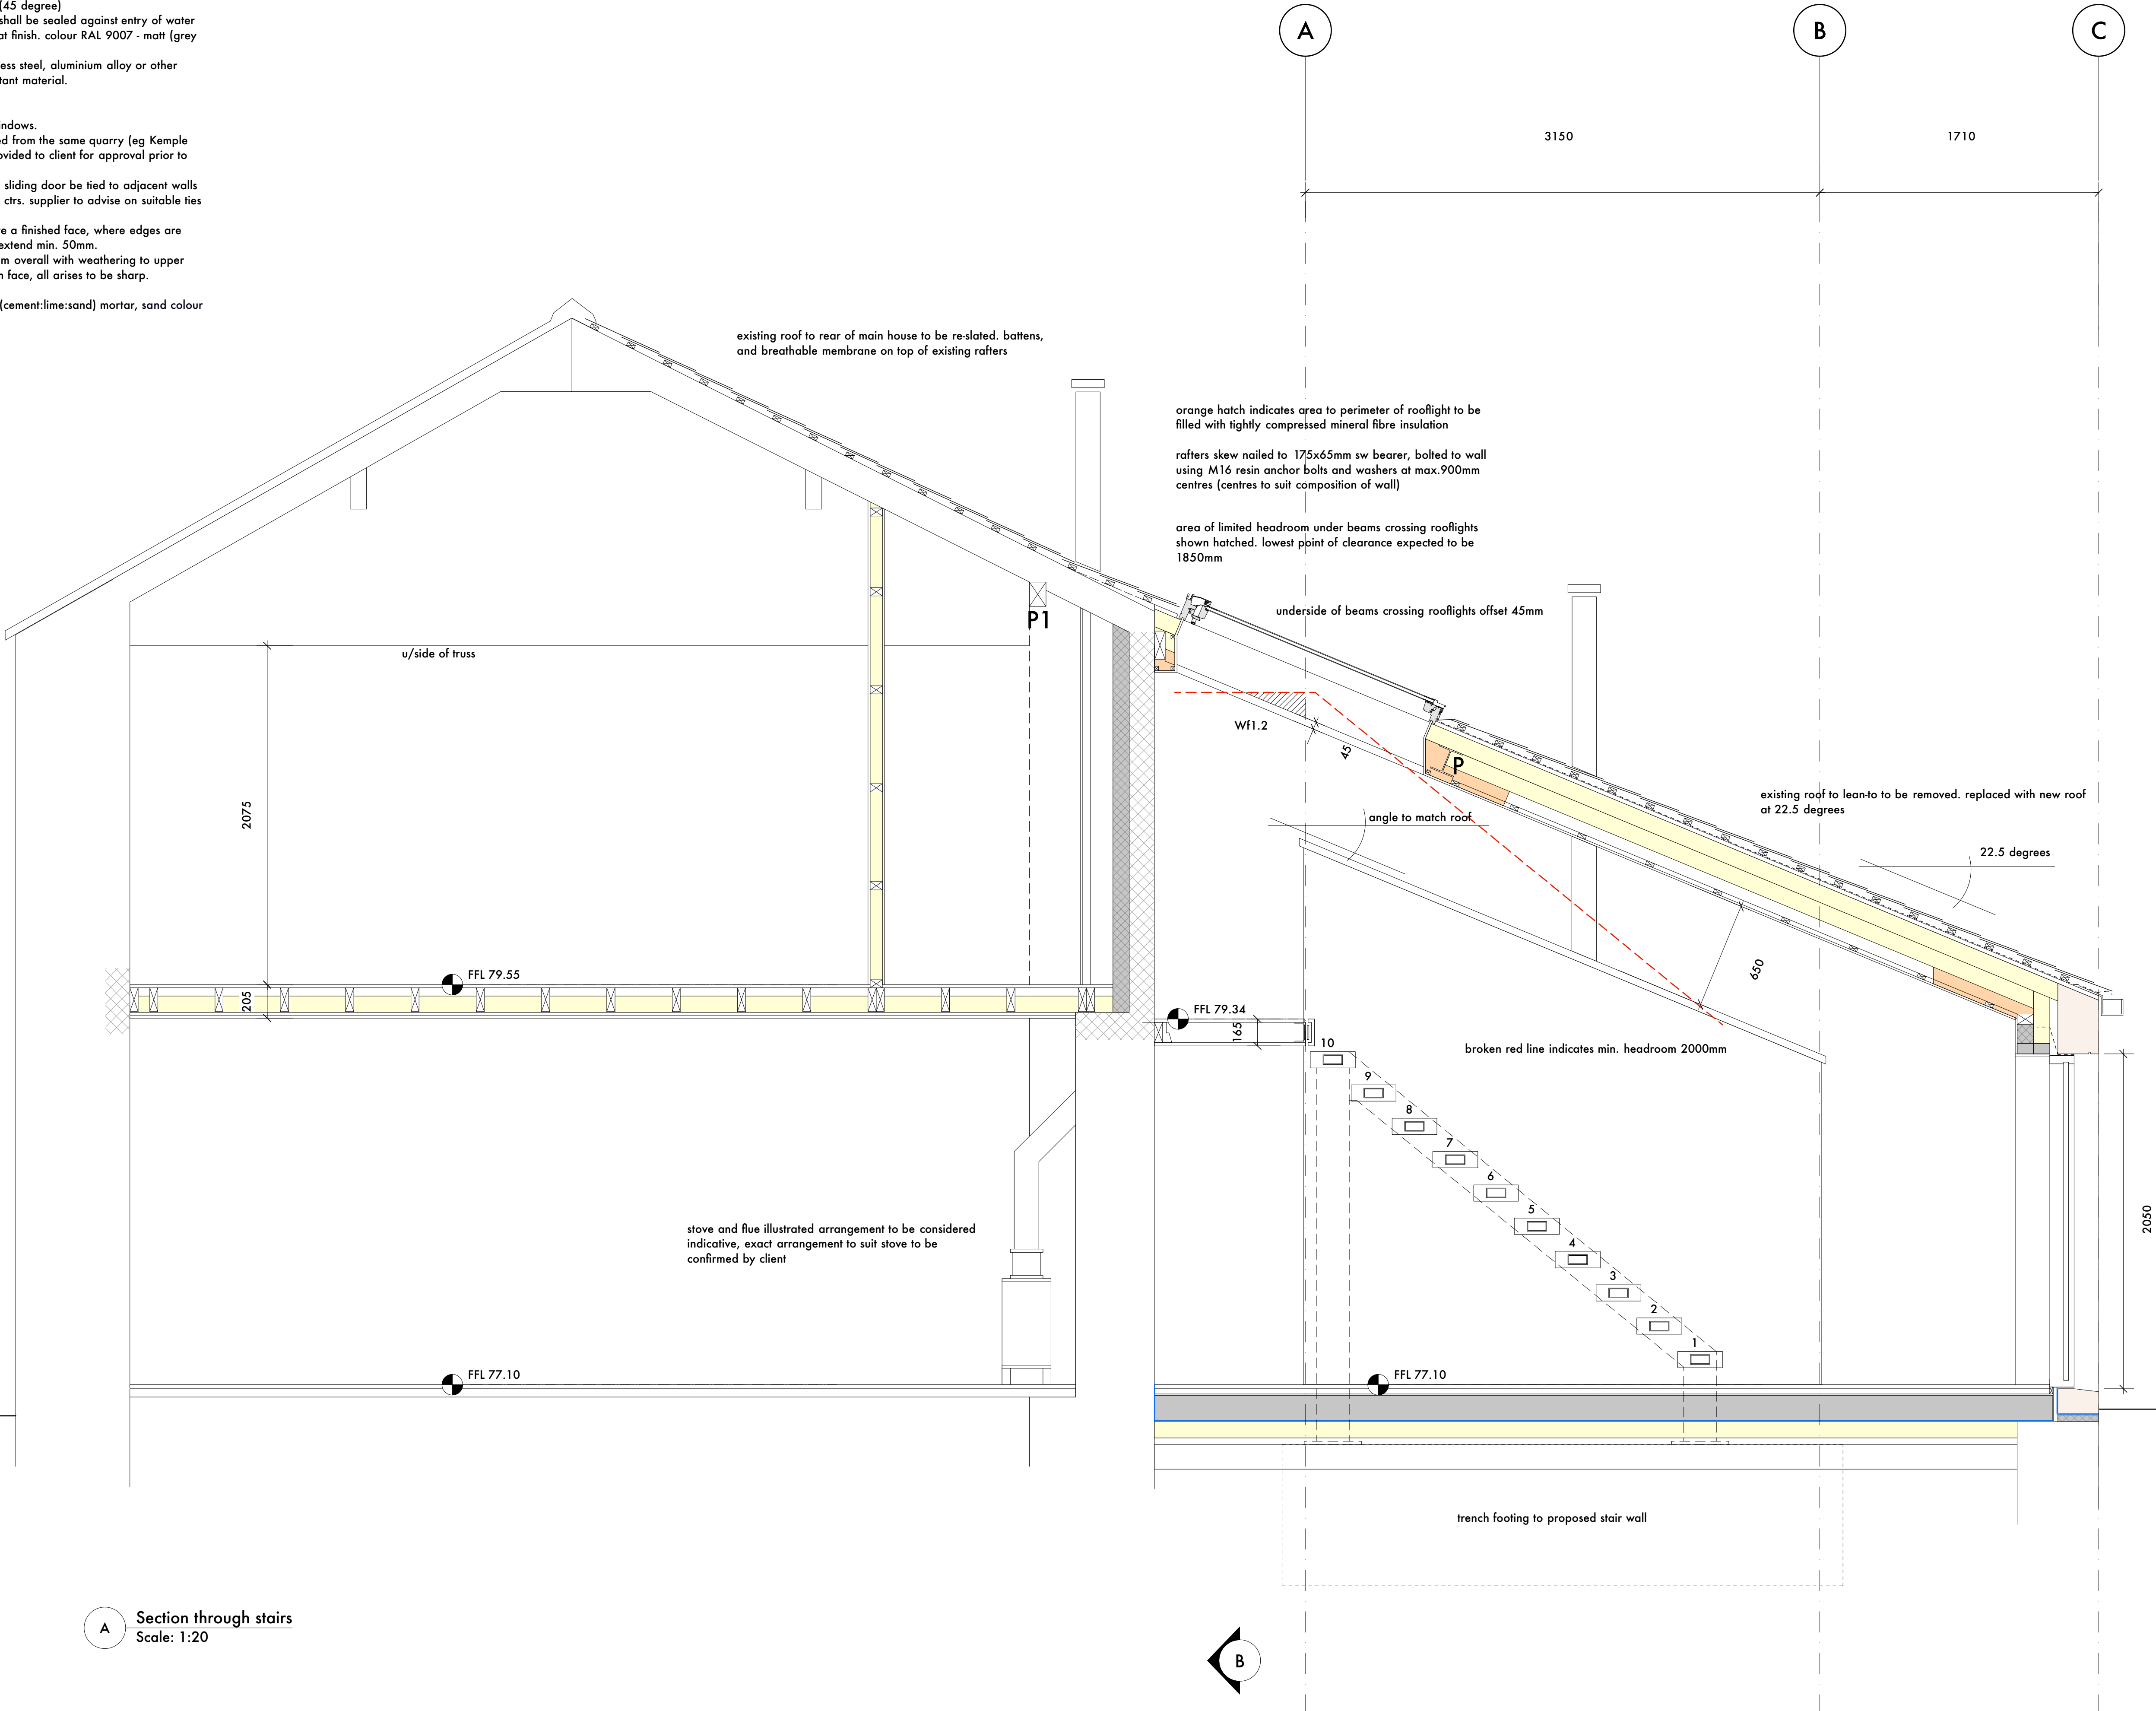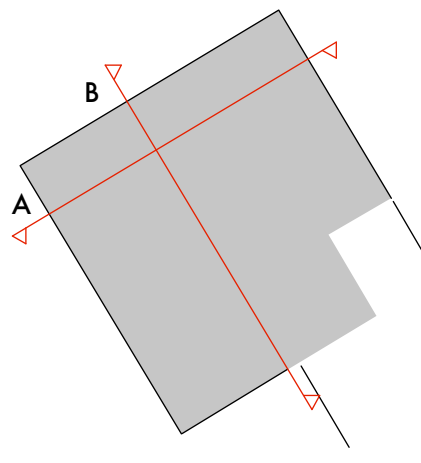

A Section through stairs
Scale: 1:20



A Issued for information June 2017

stanton andrews
architects

44 york street
clitheroe
BB7 2DL

t 01200 444490
e mail@stantonandrews.co.uk
w stantonandrews.co.uk

Granham House Barn
Hothersall

Section A details

drg.no.	14.13 / PL03	rev.	A
drawn.	db	date.	June 2017
		scale.	1:20 @ A1