

SUSPENDED TIMBER FLOOR CONSTRUCTION

Floor to be constructed of 25mm thick T&G floor boards with a density of 15kg/m2 on 220 x 50mm gauged s/w floor joists (grade SC3) at 400mm centres. Joists spanning onto party wall are to be fixed with Catnic joist hangers built into brickwork. Ceiling to be 12mm plasterboard nailed to underside of joists with plaster skim finish. Lateral support to be provided at 2m centres with galvanised m/s straps type L 30 x 5mm extended across 3 joists. Catnic m/s herring bone strutting ref: HRB6, is to be provided along mid-span of floor joist, last joist to be packed off the brick/blockwork.

TOP WATER DRAINAGE

All top water drainage are to be 100mm underground PVC-U or Supersleeve with flexible joints piping to be laid at a minimum fall of 1:40. Drains passing under the building are to be protected by surrounded with 100mm (min) granular material and where passing through a wall a suitably sized lintel is to be provided over the opening ensuring that a 50mm space is maintained around the pipe. Openings must be masked to prevent fill. All underground drainage to comply with BS 8301 (1985). new gullies to be provided with rodding access, separate drainage systems are to be combined at the last manhole depending on existing drainage systems.

All waste pipes are to be a minimum of 38mm dia. to wash hand basins and sinks, pipes are to be fitted with 75mm deep seal traps or anti-vac traps if connected directly to a soil and vent pipe. 40mm waste pipes are to be provided to bath and showers. Soil and vent pipes are to be 100mm dia and terminated 1m above any opening windows adjacent to the stack, a suitable bird cage is to be fitted to the top of the stack. Alternativly an air admittance valve may be used above the last stack connection. All installations are to comply with the Approved Document Part H and BS

INTERNAL PARTITIONING


All non-load bearing partitions are to be constructed of 100 x 50mm s/w studding at 450mm centres on 100 x 75mm sole plate fixed to the floor. Partition to be insulated with Rockwool bats for sound insulation and covered with 12.5mm thick

GROUND FLOOR CONSTRUCTION (SOLID)


New ground floor to be construction, clean stone well compacted to form levels with sand blinding, 1200 gauge polythene DPM to be turned up at the edges and linked in to the DPC. kinkspan Kooltherm K3 board 150mm thick with a top layer of 1000 gauage DPM membrane, slab 200mm concrete C25 with one layer of A142 anti clacking steel reinforcement to be place 50mm from the

Insulation of the roof space is to be 100mm thick Rockwool mineral wool roll bats laid between ceiling joists over 12.5mm foil backed plasterboard, with a further 250mm fiberglass laid across-to give a total thickness of 350mm The insulation is to be extended over the timber wall plates off the internal wall maintaining a minimum 50mm air gap between the insulation and the sarking felt to ensure through ventilation of the roof space.

The new staircase shall comply with Part K of the Approved Document. The maximum rise and going for a private stair shall be any rise between 155mm and 220mm used with any going between 245mm and 260mm or any rise between 165mm and 200mm used with any going between 223mm and 300mm. The pitch of the staircase shall be no greater than 42 degrees, with a minimum headroom of 2m. The handrail is to be a minimum of 900mm high. Balustrades are to be 1m high and capable of resisting a horizontal force of at least 0.36KN/m for each meter length. Maximum openings in the balustrades shall be no greater than 100mm and rails are to be vertical so as not to allow children to readily climb the guarding. Guarding to external balconies and roof edges to be a minimum of 1100mm high and resist a horizontal force of 0.74KN/m.

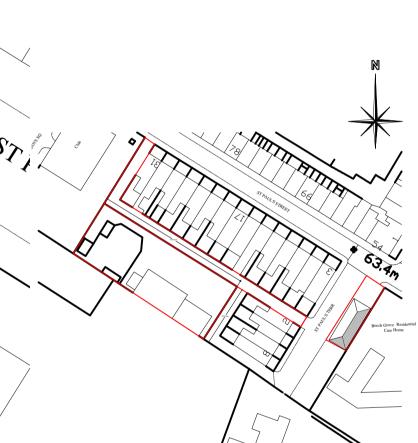



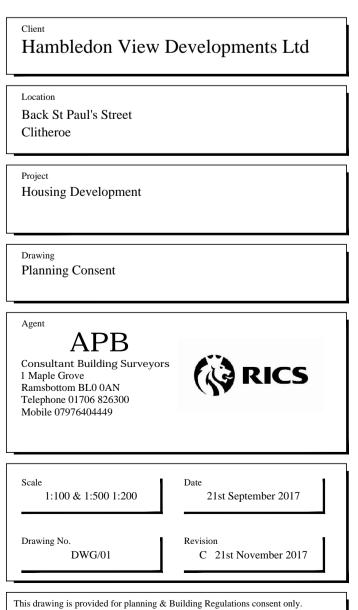

The contractor must check all dimensions on site before works are commenced. The contarctor must comply with all requirements of the Health & Safety Regulations. DO NOT SCALE THIS DRAWING Í'Ì