

MICHAEL LAMBERT ASSOCIATES

M.E.Lambert B.Sc.,C.Eng.,M.I.C.E.

Consultant- A.G.Morris B.Sc.,C.Eng.,M.I.C.E.,M.C.I.W.E.M.

**Pear Tree House
1 Partridge Close
Winsford
Cheshire
CW7 1PY
T/F 01606 862373**

Director of Community Services
Lancashire CC
PO Box 100
County Hall
Preston PR1 0LD

B2065
4/5/18
FAO Steven Warren, LLFA

Dear Sirs

Clitheroe Light Engineering- new building proposals- 3/2017/1020

We refer to your comments of 13/4/18 - onsite percolation tests have now been carried out and we attach:-

1. Test results and photos.
2. BRE 365 soakage calculations and Fadum chart.
3. Drainage layout with pipe sizes.
4. Exceedance diagram.
5. Floodplain volume compensation drawing.

The drainage hierarchy (1) of soakaway, watercourse, drainage system has been followed and the percolation test results (2) show ground with limited soakage. New surface water runoff will connect to United Utilities public surface water manhole 1105 and an exceedance diagram is attached (3) showing runoff routes over the roads into Mearley Brook. In terms of sustainable drainage calculations the BRE 365 procedure spreadsheet shows that a 20m length soakaway 0.8m sidewall depth can cope with 2.76m³ of runoff in 24 hours. A site for a soakaway is to the west of the new building and as soakage is limited the cellular crate surface water storage of 25m³ will be placed here to at least soak some runoff into the ground as well as provide storage. Flow calculations are new hard area 1000m² x 0.014 l/sec/m² for a 1 in 2 year storm (Building Regs Approved document H) giving 14 l/sec, a 1 in 30 year runoff rate is 14 x 1.9 growth factor = 27 l/sec, 1 in 100 year runoff rate 14 x 2.5 GF = 35 l/sec, 1 in 100 year + 30% CC = 45.5 l/sec. (4). The HR Wallingford printout shows the storage volume. Post consent, detailed Microdrainage calculations and contract drawings showing drainage, slab levels, and road levels will be prepared for Building Regulations submission.

Yours faithfully



M.E.Lambert

CONSULTING CIVIL ENGINEERS

VAT reg 674 6275 04 Emails- floodriskengineer@gmail.com

Workcentres at Winsford & Waterfoot

sudsenigneers@gmail.com

Roads/rivers/river modelling/sustainable drainage/attenuation/ wetlands/ development infrastructure/feasibility

Test pits dug out and tested by CW/AD/DJ 1/5/18

Clitheroe Light Engineering Water drainage test



PIT 2 LOCATION

Dug out to 1.600mm deep .

1500l of water was poured into the hole at 11.19am.

The hole never filled more than 800mm high whilst the water was being poured into the hole



Timed checks
that have taken
place:

1/5/18

11.20am

@800mm

12.30pm

@510mm

1.30pm

@480mm

2.30pm

@440mm

3.30pm

@400mm

4.30pm

@380mm

19.30pm

@300mm

20.30pm

@255mm

2/5/18

06.00am Empty



Time period	drop
1	290
1	30
1	40
1	40
1	20
3	80
1	45
9.5	255





PIT 1 LOCATION

Dug out to 1.500mm deep .
1500l of water was poured into the hole at 09.33am.
The hole never filled more than 600mm high whilst the water was being poured into the hole

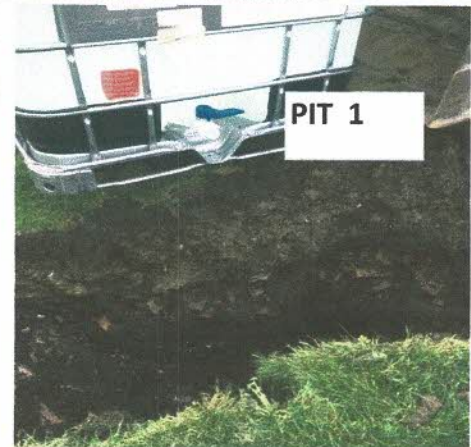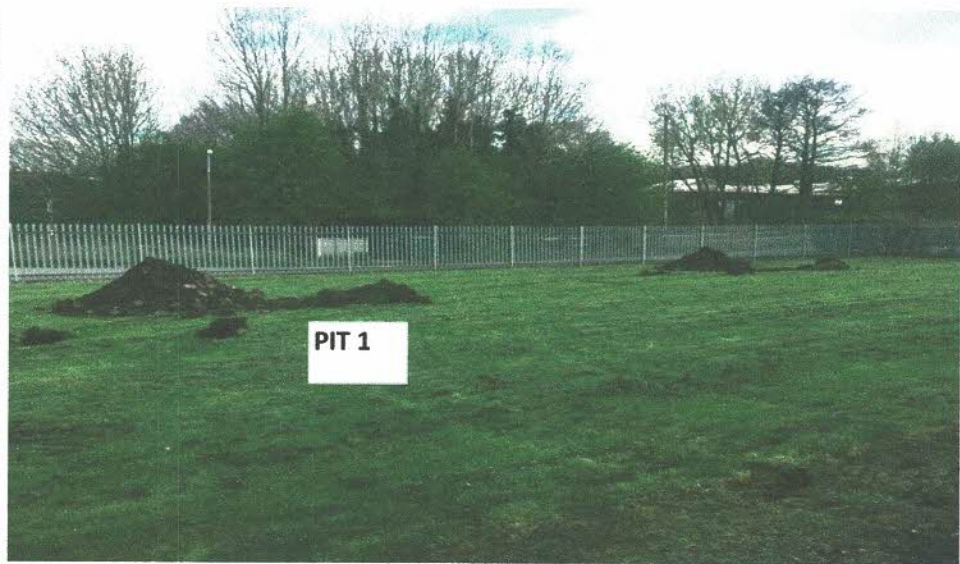

Timed checks that
have taken place:

	Time period	drop
1/5/18		
09.33am		
@600mm		
10.33pm	1	360
@240mm		
11.33pm	1	65
@175mm		
12.33pm	1	30
@145mm		
1.33pm	1	45
@100mm		
2.30pm	1	40
@60mm		
3.30pm	1	15
@45mm		
4.30pm	1	35
@10mm		
7.30pm	3	10
Fmntv		

Table 11.1
Permeability and Drainage Characteristics of Soils*

		Coefficient of Permeability k in cm per sec (log scale)													
		10 ²	10 ¹	1.0	10 ⁻¹	10 ⁻²	10 ⁻³	10 ⁻⁴	10 ⁻⁵	10 ⁻⁶	10 ⁻⁷	10 ⁻⁸	10 ⁻⁹		
		Good					Poor			Practically Impervious					
Soil types	Drainage	Clean gravel	Clean sands, clean sand and gravel mixtures					Very fine sands, organic and inorganic silts, mixtures of sand silt and clay, glacial till, stratified clay deposits, etc.			"Impervious" soils, e.g., homogeneous clays below zone of weathering				
								"Impervious" soils modified by effects of vegetation and weathering							
Direct determination of k	Direct testing of soil in its original position—pumping tests. Reliable if properly conducted. Considerable experience required														
		Constant-head permeameter. Little experience required													
Indirect determination of k		Falling-head permeameter. Reliable. Little experience required					Falling-head permeameter. Unreliable. Much experience required				Falling-head permeameter. Fairly reliable. Considerable experience necessary				
		Computation from grain-size distribution. Applicable only to clean cohesionless sands and gravels					Computation based on results of consolidation tests. Reliable. Considerable experience required								

* After Casagrande and Fadum (1940).

K

Calculated by: michael lambert

Site name: upbrooks cle

Site location: clitheroe

Site coordinates

Latitude: 53.87501° N

Longitude: 2.37916° W

This is an estimation of the storage volume requirements that are needed to meet normal best practice criteria in line with Environment Agency guidance "Preliminary rainfall runoff management for developments", W5-074/A/TR1/1 rev. E (2012) and the SuDS Manual, C753 (Ciria, 2015). It is not to be used for detailed design of drainage systems. It is recommended that hydraulic modelling software is used to calculate volume requirements and design details before finalising the drainage scheme.

Reference: 6325598

Date: 2018-03-16T16:48:49

Methodology	FEH Statistical
-------------	-----------------

Site characteristics

Total site area (ha)	0.12
Significant public open space (ha)	0
Area positively drained (ha)	0.12
Pervious area contribution (%)	30
Impermeable area (ha)	0.1
Percentage of drained area that is impermeable (%)	83
Impervious area drained via infiltration (ha)	0
Return period for infiltration system design (year)	10
Impervious area drained to rainwater harvesting systems (ha)	0
Return period for rainwater harvesting system design (year)	10
Compliance factor for rainwater harvesting system design (%)	66
Net site area for storage volume design (ha)	0.12
Net impermeable area for storage volume design (ha)	0.1

Design criteria

Volume control approach	Use long term storage	
	Default	Edited
Climate change allowance factor	1.3	1.3
Urban creep allowance factor	1.1	1.1
Interception rainfall depth (mm)	5	5
Minimum flow rate (l/s)	5	5
Qmed estimation method	Calculate from BFI and SAAR	
BFI & SPR estimation method	Specify BFI and SPR manually	
	Default	Edited
Qmed (l/s)	1.66	--
Qbar / Qmed Conversion Factor	1.075	1.075
HOST class	---	N/A
BFI / BFIHOST	0.354	0.354
SPR / SPRHOST	0.41	0.41

Hydrology

	Default	Edited
SAAR (mm)	1241	1241
M5-60 Rainfall Depth (mm)	20	20
'r' Ratio M5-60/M5-2 day	0.3	0.3
Rainfall 100 yrs 6 hrs	70	
Rainfall 100 yrs 12 hrs	96.6	
FEH/FSR conversion factor	1.15	1.15
Hydrological region	10	
Growth curve factor: 1 year	0.87	0.87
Growth curve factor: 10 year	1.38	1.38
Growth curve factor: 30 year	1.7	1.7
Growth curve factor: 100 year	2.08	2.08

* Where rainwater harvesting or infiltration has been used for managing surface water runoff such that the effective impermeable area is less than 50 % of the 'area positively drained', the 'net site area' and the estimates of Qbar and other flow rates will have been reduced accordingly.

Site discharge rates	Default	Edited	Estimated storage volumes	Default	Edited
Qbar total site area (l/s)	--	1.79	Interception storage (m ³)	--	4
Qbar net site area (l/s)	--	1.79	Attenuation storage (m ³)	--	25
1 in 1 year (l/s)	--	5	Long term storage (m ³)	--	0
1 in 30 years (l/s)	--	5	Treatment storage (m ³)	--	12
1 in 100 years (l/s)	--	5	Total storage (excluding treatment) (m ³)	--	29

Phone: 0300-123-6780
Email: Suds@lancashire.gov.uk

Date: 13th April 2018

APPLICATION CONSULTATION RESPONSE

Application Number:	3/2017/1020
Location:	Unit A to C Up Brooks, Clitheroe, BB7 9SE 1 PL
Grid Ref:	E 375182, N 442128
Proposal:	Proposed new production unit

Thank you for inviting the Lead Local Flood Authority (LLFA) to comment on the above application. The Flood and Water Management Act 2010 sets out the requirement for LLFAs to manage 'local' flood risk within their area. 'Local' flood risk refers to flooding or flood risk from surface water, groundwater or from ordinary watercourses.

Comments provided in this representation, including conditions, are advisory and it is the decision of the Local Planning Authority (LPA) whether any such recommendations are acted upon. It is ultimately the responsibility of the Local Planning Authority to approve, or otherwise, any drainage strategy for the associated development proposal. The comments given have been composed based on the current extent of the knowledge of the LLFA and information provided with the application at the time of this response.

Lead Local Flood Authority Position

In the absence of adequate information to assess the principle of surface water drainage associated with the proposed development, we object to this application and recommend refusal of planning permission until further information has been submitted to the local planning authority.

Reason

The application lies within Flood Zone 2 and Flood Zone 3 defined by the Planning Practice Guidance as having a medium and high probability of flooding. Therefore the proposed scale of development may present risks of flooding on-site and/or off-site if surface water run-off is not effectively managed. The lack of the following detailed information in relation to surface water drainage means the LLFA cannot

assess whether the development proposal meets the requirements of Paragraph 103 of the NPPF or Paragraph 80 of Section 10 of the PPG in principle :

Hierarchy for Surface Water Disposal

- Evidence that the surface water run off is discharged as high as possible in the Planning Practice Guidance (PPG) drainage hierarchy

Site and Drainage Layout

- Proposed site plan showing exceedance routes and building slab level

Site investigation report, including the results for each SuDS feature of :

- Boreholes or Trial Pits
- Infiltration (Permeability) Testing
- Factual Ground Investigation Report (GIR)
- Geotechnical Design Report (GDR)

Drawings and Calculations

- Details of inlets, outlets and flow controls
- Long and cross section drawings of proposed drainage system(s), including design levels
- Details of appropriate water quality treatments

Sustainable Drainage System Flow Calculations (PDF files showing the input and output data for flow calculations) and Storm Simulation Plan for :

- 1 in 1 year;
- 1 in 2 year;
- 1 in 30 year and;
- 1 in 100 year + climate change as per latest EA guidance

Attenuation Volume Calculations

- Breakdown of attenuation volume calculations in oversize pipes, manholes and attenuation tank

The submission of basic information on how surface water is intended to be managed is vital if the local planning authority is to make informed planning decisions. In the absence of the above detailed information regarding surface water management, the flood risks resulting from the proposed development are unknown and this is therefore sufficient reason in itself for a refusal of planning permission.

Overcoming Our Objection : You can overcome our objection by submitting the following information :

1. Evidence that the Planning Practice Guidance for drainage hierarchy has been followed
2. Geotechnical site reports.

3. Detailed drainage drawings including plan showing exceedance routes.
4. Sustainable drainage system flow calculations.
5. Attenuation volume calculations.

We ask to be re-consulted following the submission of additional information addressing surface water drainage proposals. We will provide you with comments within 21 days of receiving formal re-consultation.

Yours faithfully,

Steven Warren
Lead Local Flood Authority