


COPING FORMED FROM STONE
ON SITE TO MATCH EXISTING
WALL FROM MIN 150MM BELOW
UPPER GARDEN LEVEL TO BE
FACED BOTH SIDES IN STONE
AND BE MIN 900MM ABOVE UPPER
GARDEN LEVEL

UPPER GARDEN LEVEL

EXISTING STONE MIN 150 THICK
USED TO FACE REATINING WALL
FROM LOWER GROUND LEVEL TO
UPPER GROUND LEVEL.

S/S WALL TIES TO TIE STONework
TO BLOCKWORK 450V AND 750H CENTRES
STONE WORK TO BE BUILT AND POINTED
IN LIME MORTAR

LOWER GARDEN LEVEL

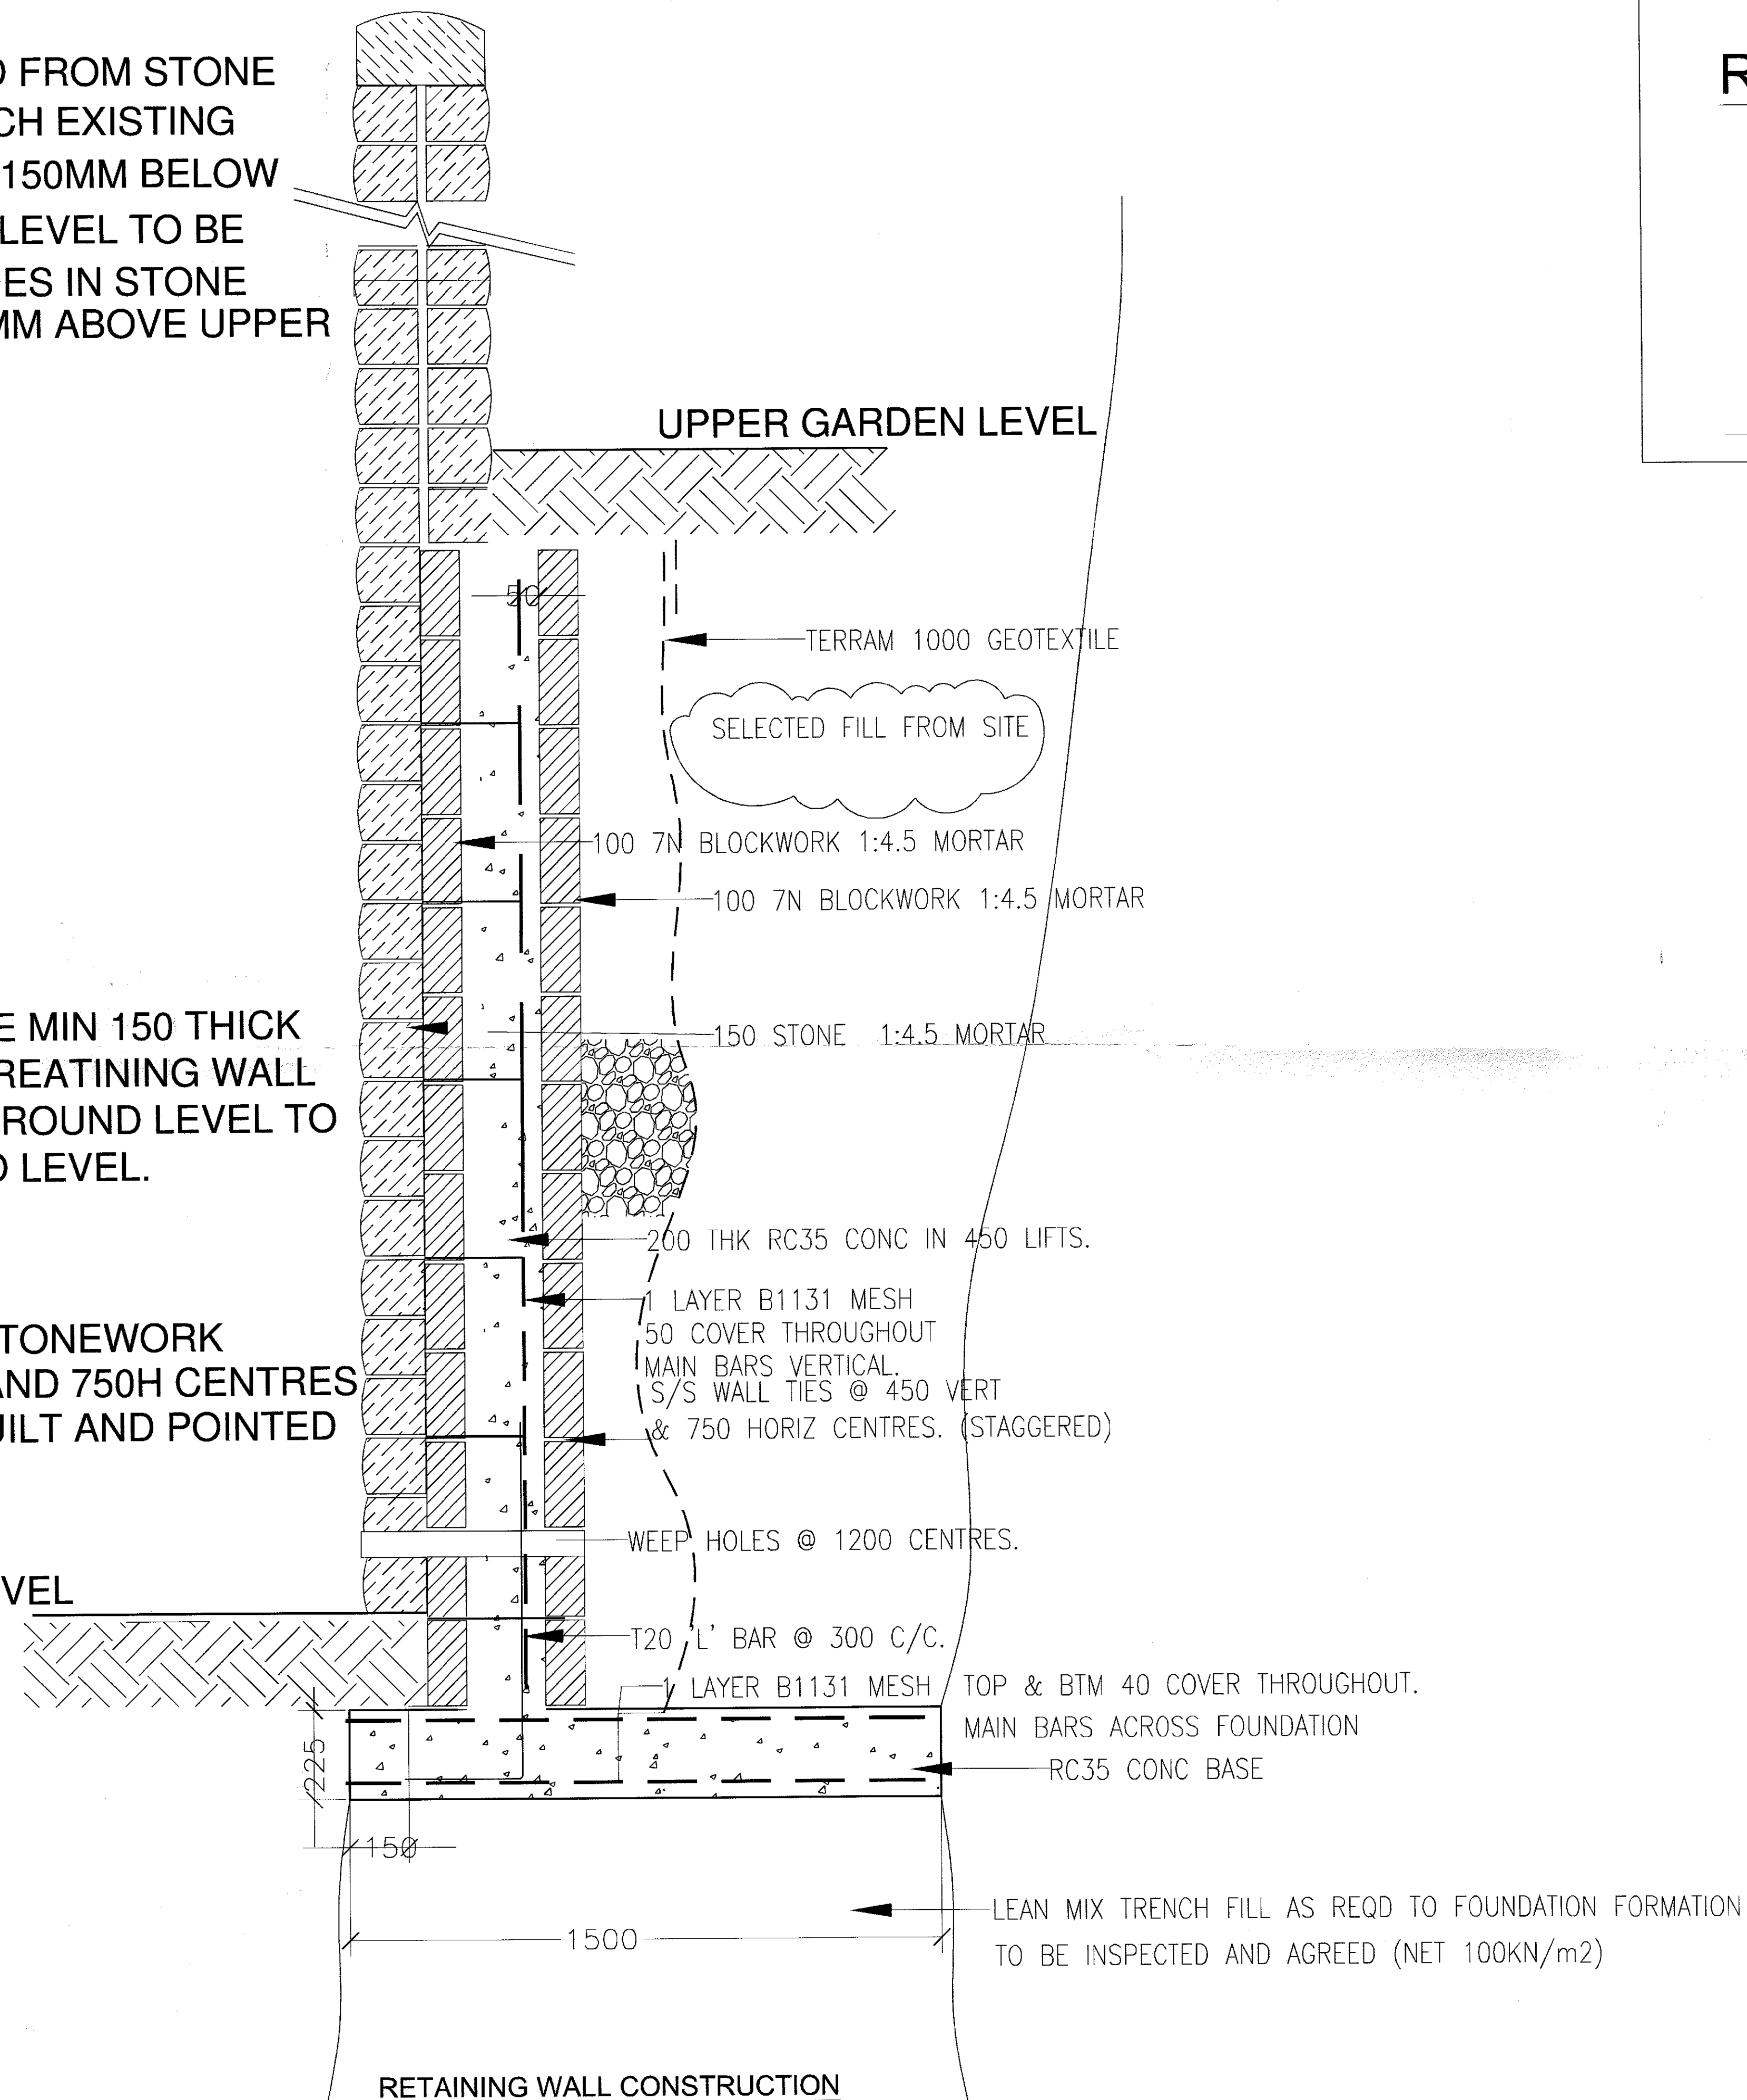

REINFORCEMENT QUANTITIES.

B1131 MESH FOUNDN	5 No SHEETS REQD (2.4x4.8M)
B1131 MESH FOUNDN	5 No SHEETS REQD (2.4x4.8M)
T20 STARTER BARS SHAPE CODE 11	40 REQUIRED

BASED ON WALL LENGTH OF 10m

Revision

320180775P

Client.

AJH ASSOCIATES.

Drawing Title.

RETAINING WALL DETAILS.

Foxx Limited.

Consulting Civil & Structural Engineers,
66-70 Park Hill Street, Bolton, BL1 4AR.
Tel: (01204) 362300
Fax: (01204) 399200
Email: info@foxx.co.uk

SCALE: 1:50

DATE: AUG 18

DRAWN: R.M.

CHECKED: N.T.

CONTRACT No:

F6966

DRAWING No:

RW1

PROPOSED RETAINING WALL AT ROCK HOUSE, CHURCH BROW, CLITHEROE.