


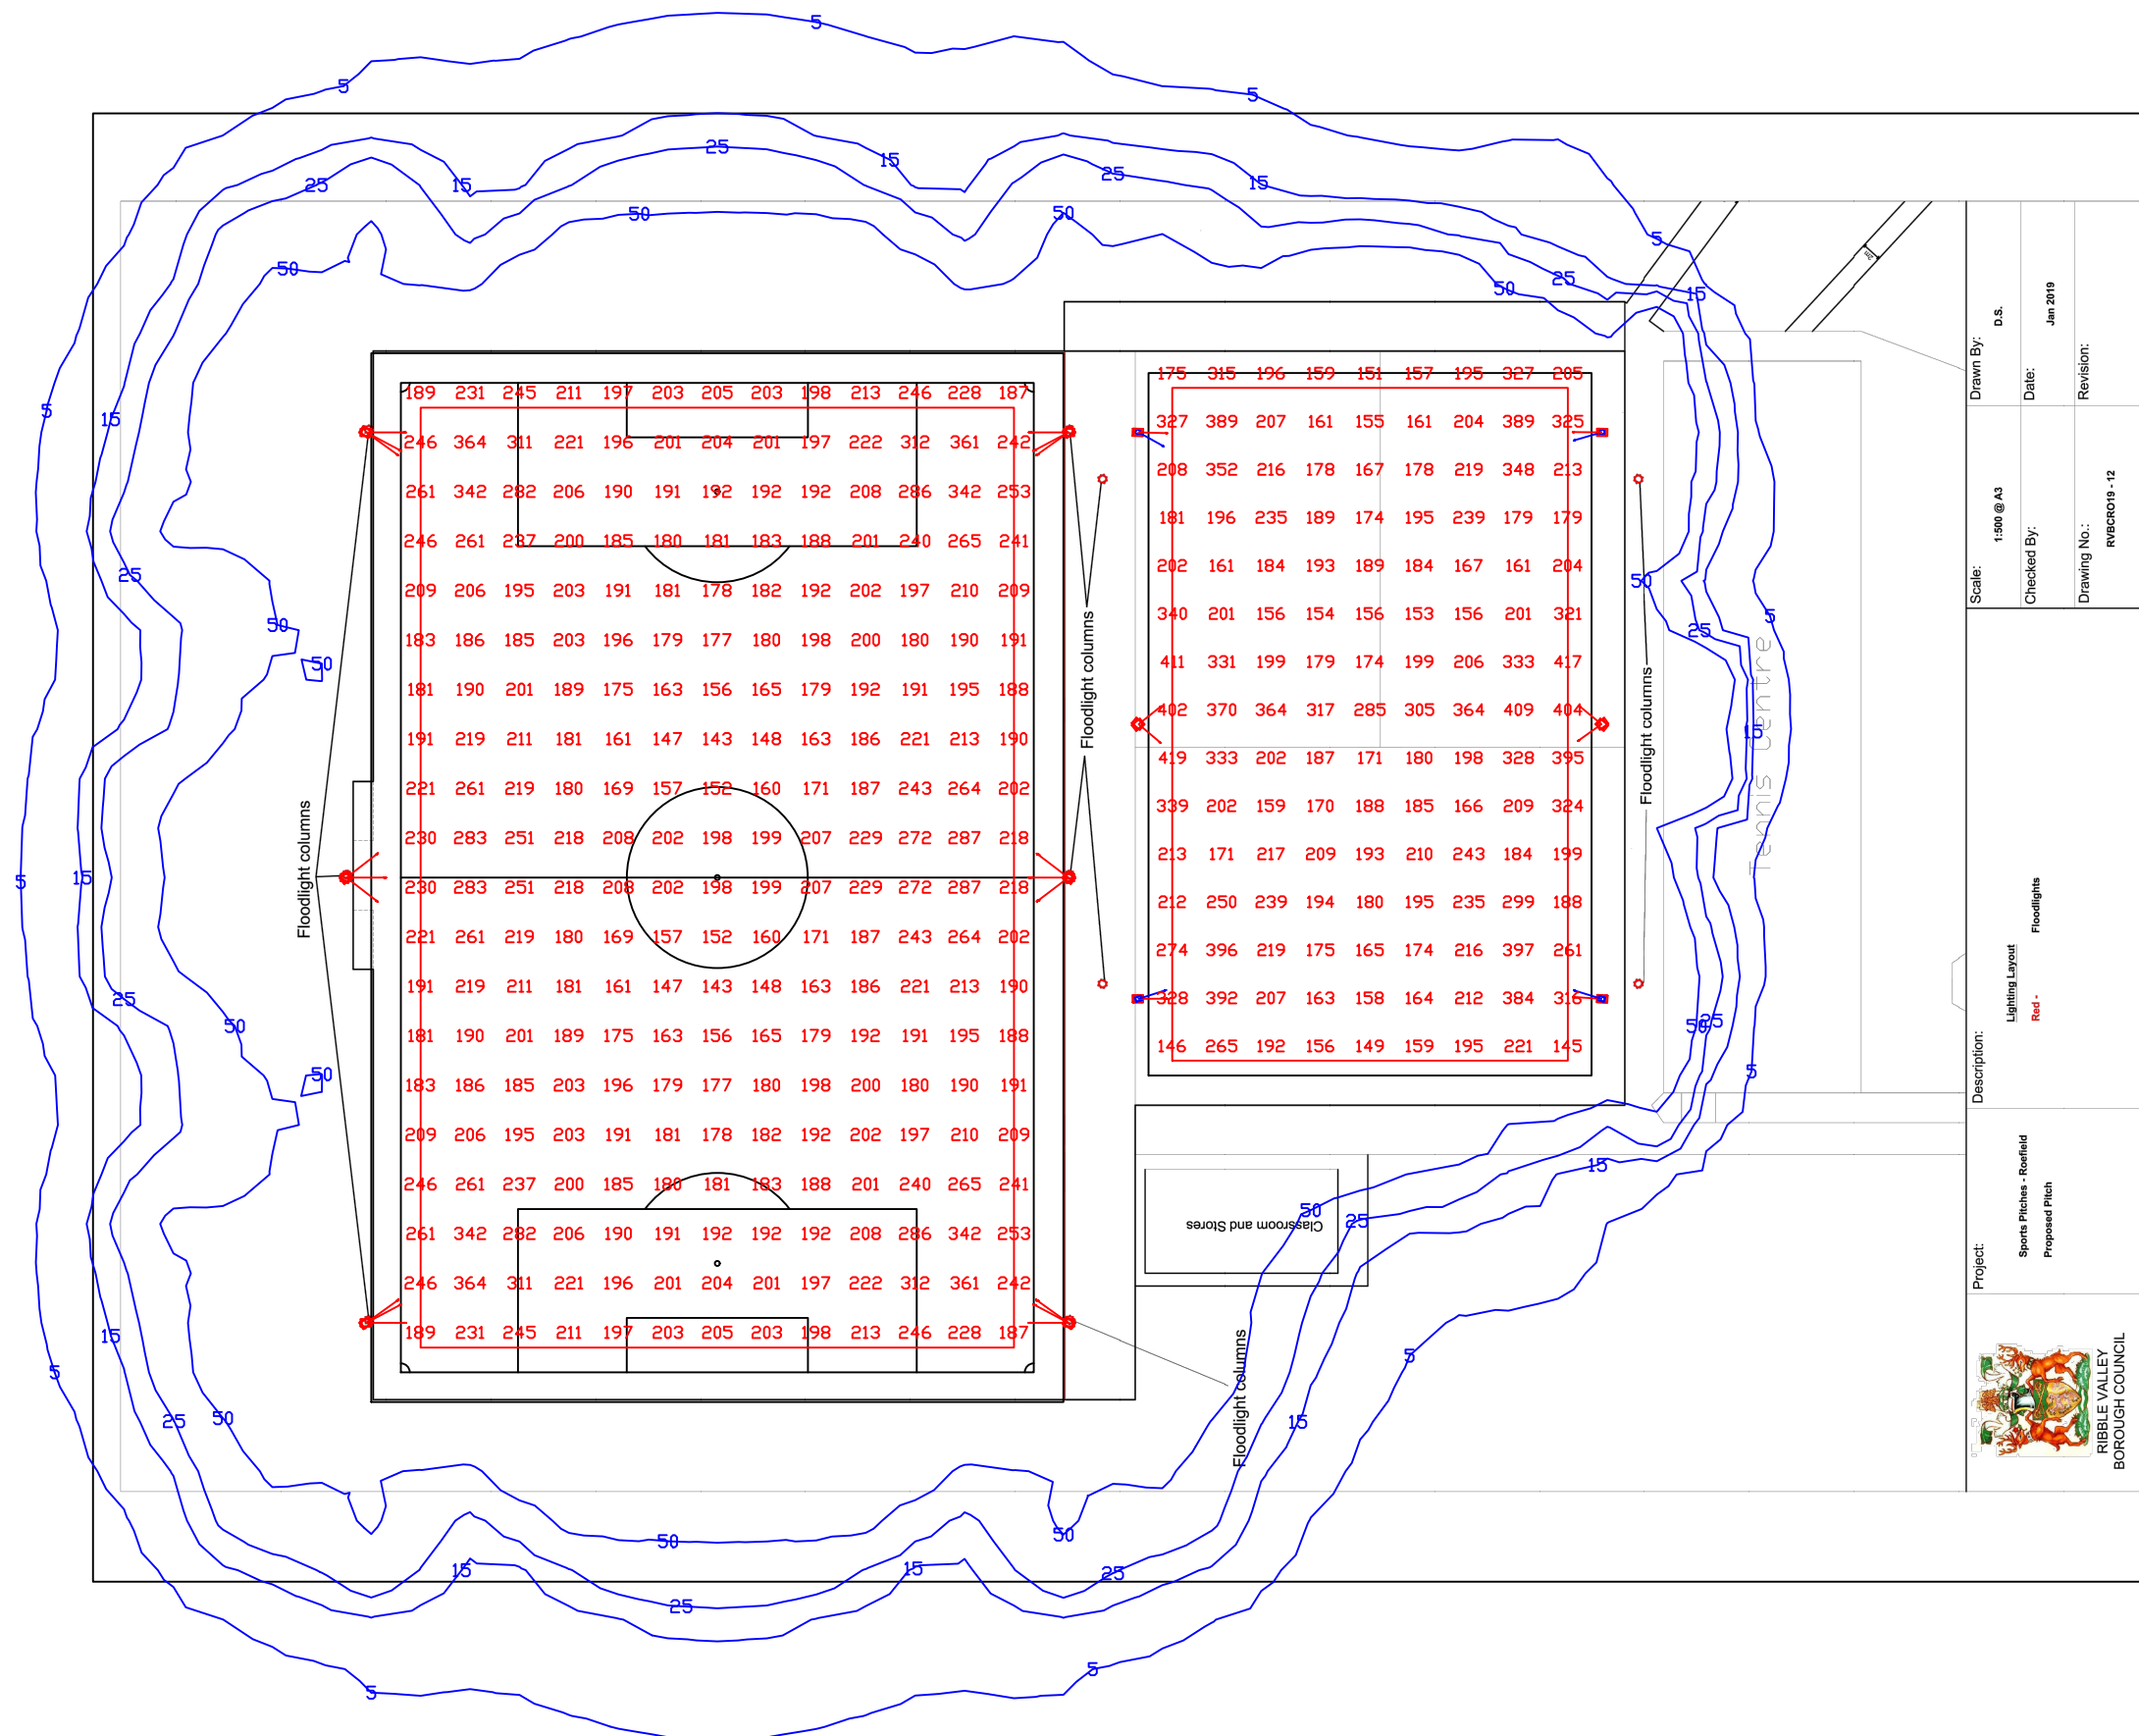

Notes Floodlighting Equipment 6 x 15m Masts (M1-M6) 6 x 8m Masts (M7-M10) Each carrying the following Floodlights :- M1-M6..... 3 x OSRAM LED FL 20 MAXI/PL44T M7,M9,M10,M12..... 1 x OSRAM LED FL 20 MAXI/PL44T 1 x OSRAM LED MIDI PL43 M8,M11..... 2 x OSRAM LED FL 20 MAXI/PL44T OSRAM LED LED 5000K / CRI >= 70 (120 000 INITIAL Lm) OSRAM LED (MIDI) LED 5000K / CRI >= 70 (38 700 INITIAL Lm) FOOTBALL PITCH Illuminance Levels Initial - (100hrs) E.i.ave = 211Lux Maintained - (4000hrs) E.i.ave = 200Lux Uniformity Emin/Eave = 0.67 MUGA Illuminance Levels Initial - (100hrs) E.i.ave = 234Lux Maintained - (4000hrs) E.i.ave = 222Lux Uniformity Emin/Eave = 0.60 Grid values in Lux(initial). Grid interval = 5m. Contour values in Lux (initial). Contours: 5, 15, 25, 50 Lux. Maintenance Factor = 0.95	
Project Eddisford Sports Complex	
www.halliday-lighting.co.uk	
Drawing Title Proposed floodlighting	
Drawn By (print) JS	Date 25/04/19
Project No 05434	Scale 1:750 @ A3
Drawing No HLS05434	Status Proposal