





DO NOT SCALE

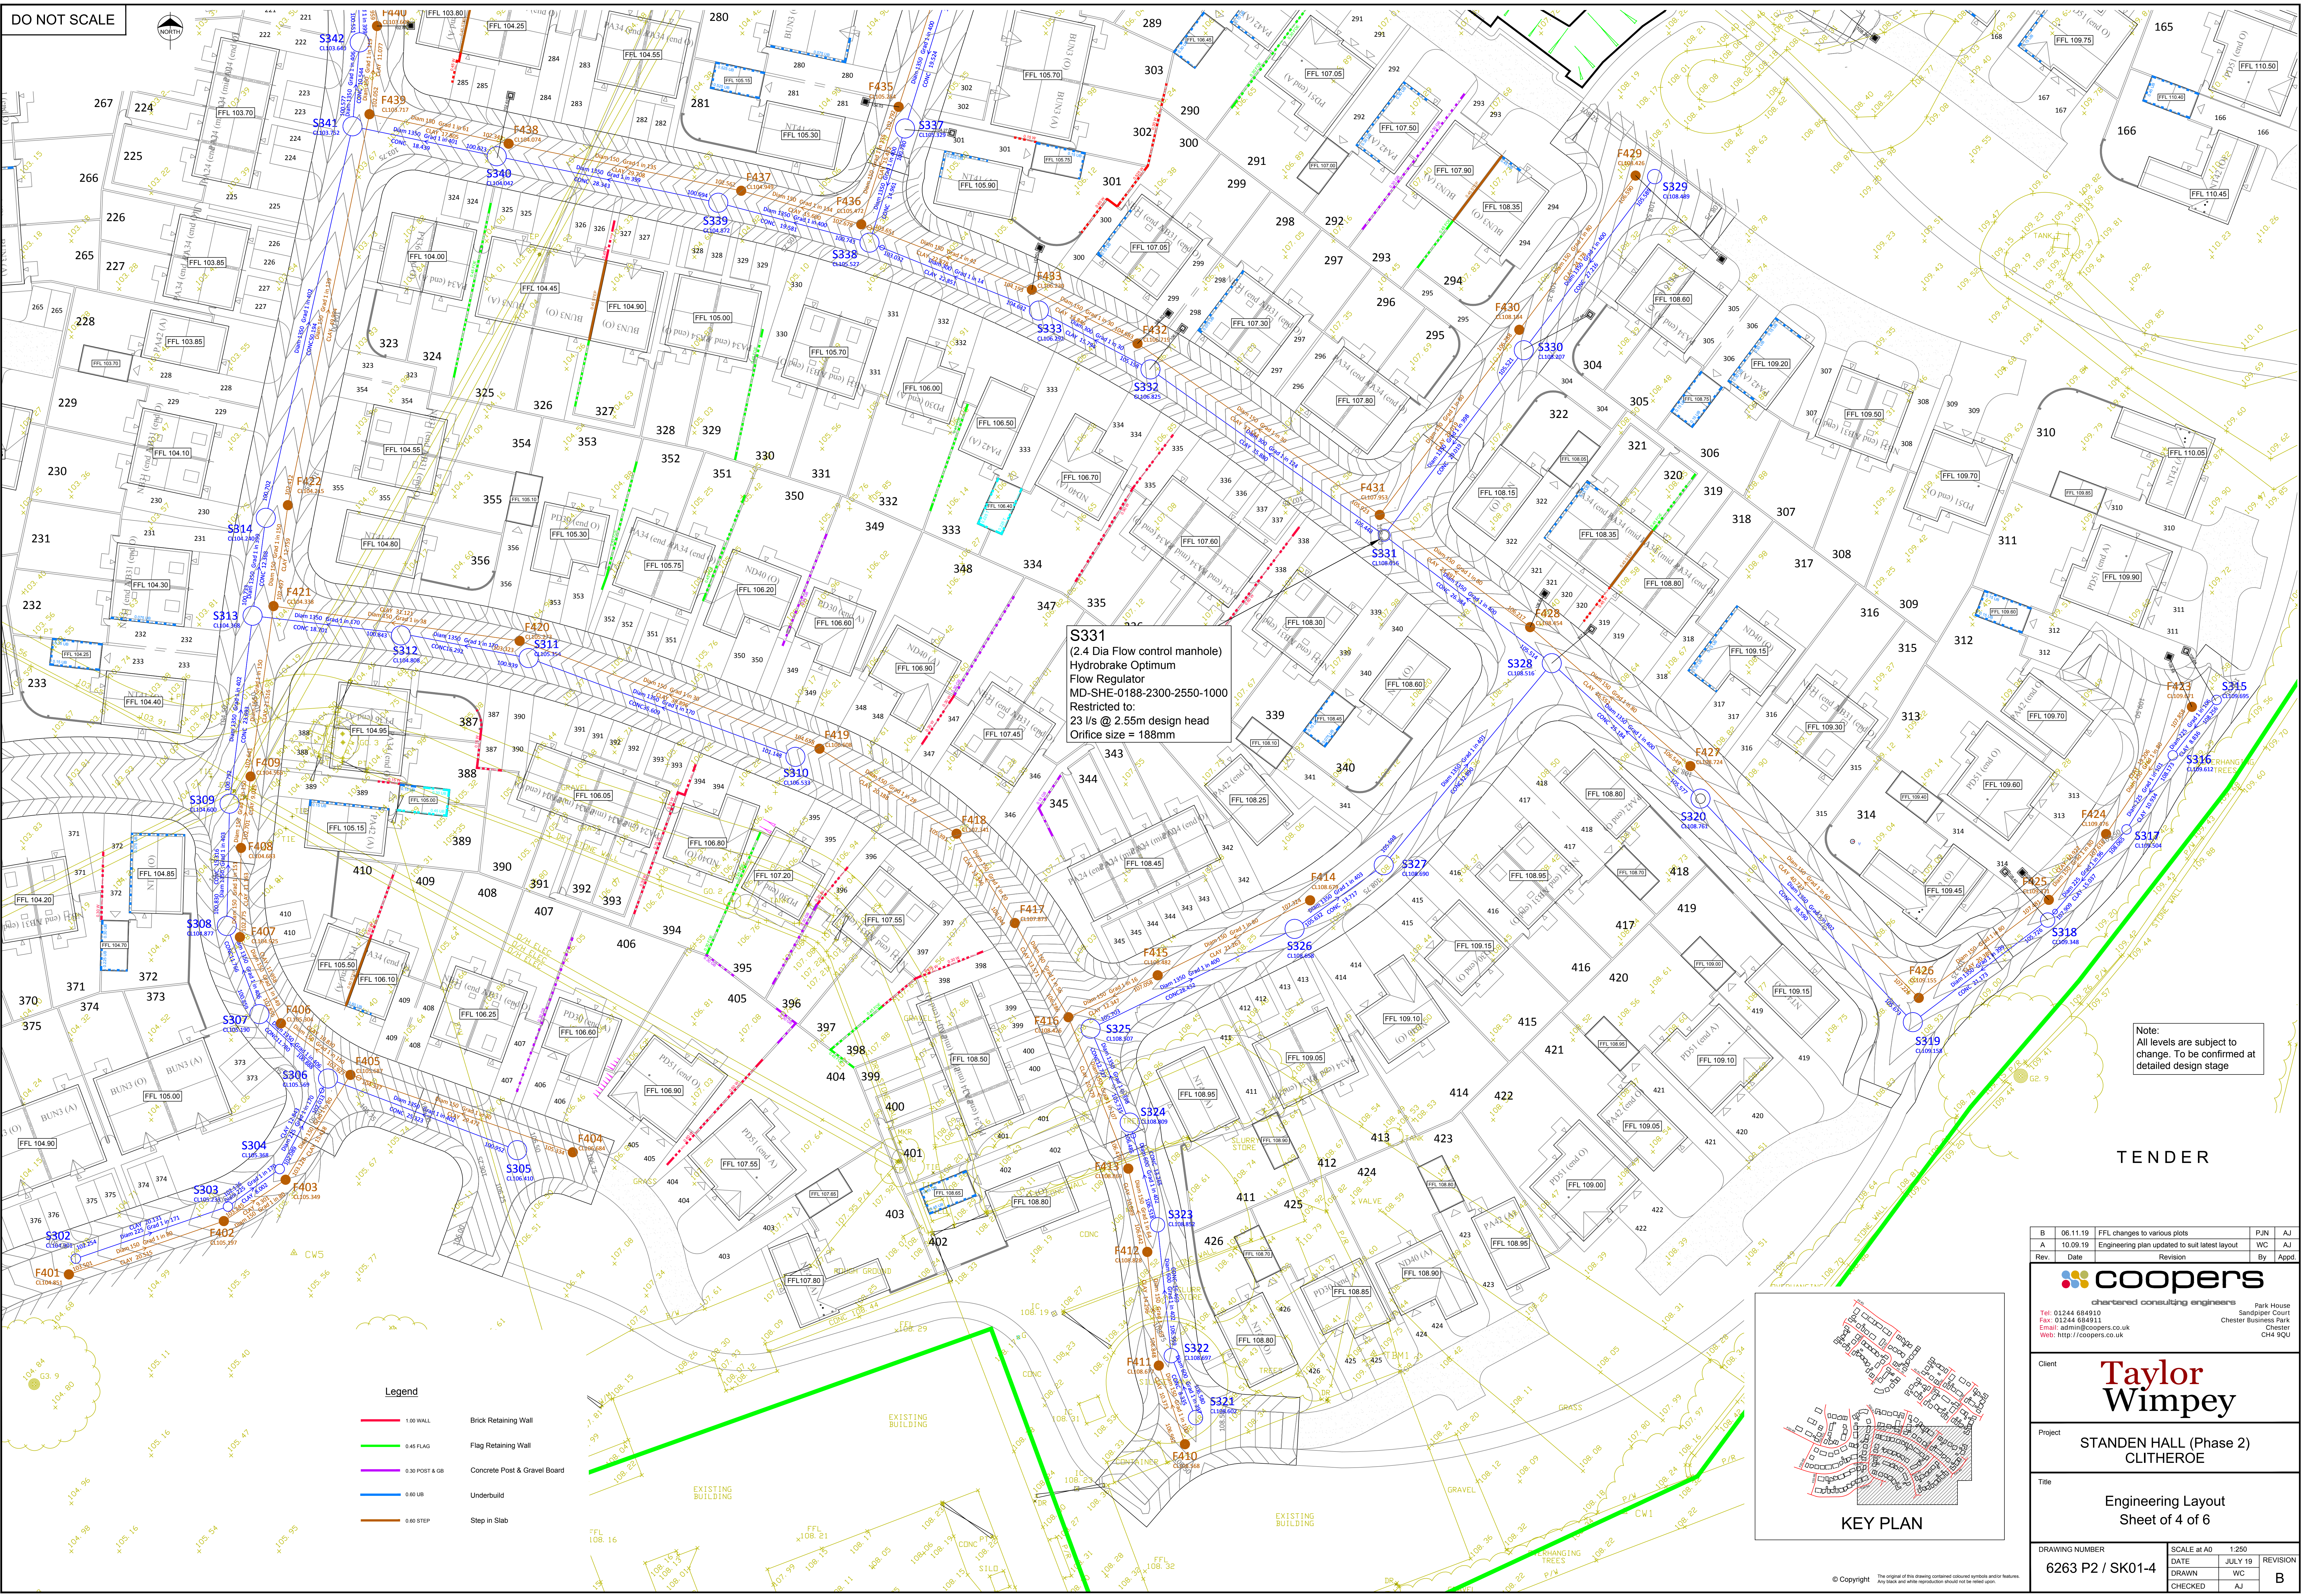

S331
(2.4 Dia Flow control manhole)
Hydrobrake Optimum
Flow Regulator
MD-SHE-0188-2300-2550-1000
Restricted to:
23 l/s @ 2.55m design head
Orifice size = 188mm

Note:
All levels are subject to
change. To be confirmed at
detailed design stage

- Legend**
- 1.00 WALL
 - 0.45 FLAG
 - 0.30 POST & OB
 - 0.00 UB
 - 0.00 STEP
 - Brick Retaining Wall
 - Flag Retaining Wall
 - Concrete Post & Gravel Board
 - Underbuild
 - Step in Slab

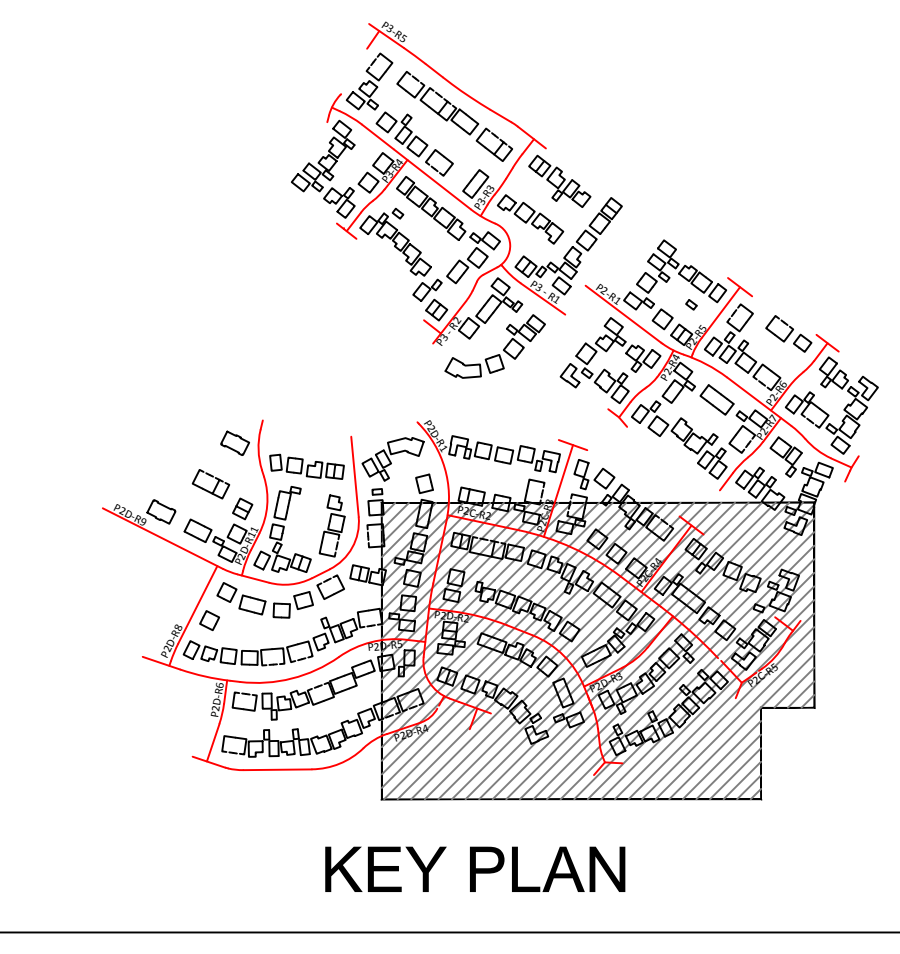

TENDER

B	06.11.19	FFL changes to various plots	PJN	AJ
A	10.09.19	Engineering plan updated to suit latest layout	WC	AJ
Rev	Date	Revision	By	Appd.
 chartered consulting engineers				
Client Taylor Wimpey				
Project STANDEN HALL (Phase 2) CLITHEROE				
Title Engineering Layout Sheet of 4 of 6				
DRAWING NUMBER 6263 P2 / SK01-4		SCALE at A0 1:250 DATE JULY 19 DRAWN WC CHECKED AJ REVISION B		