


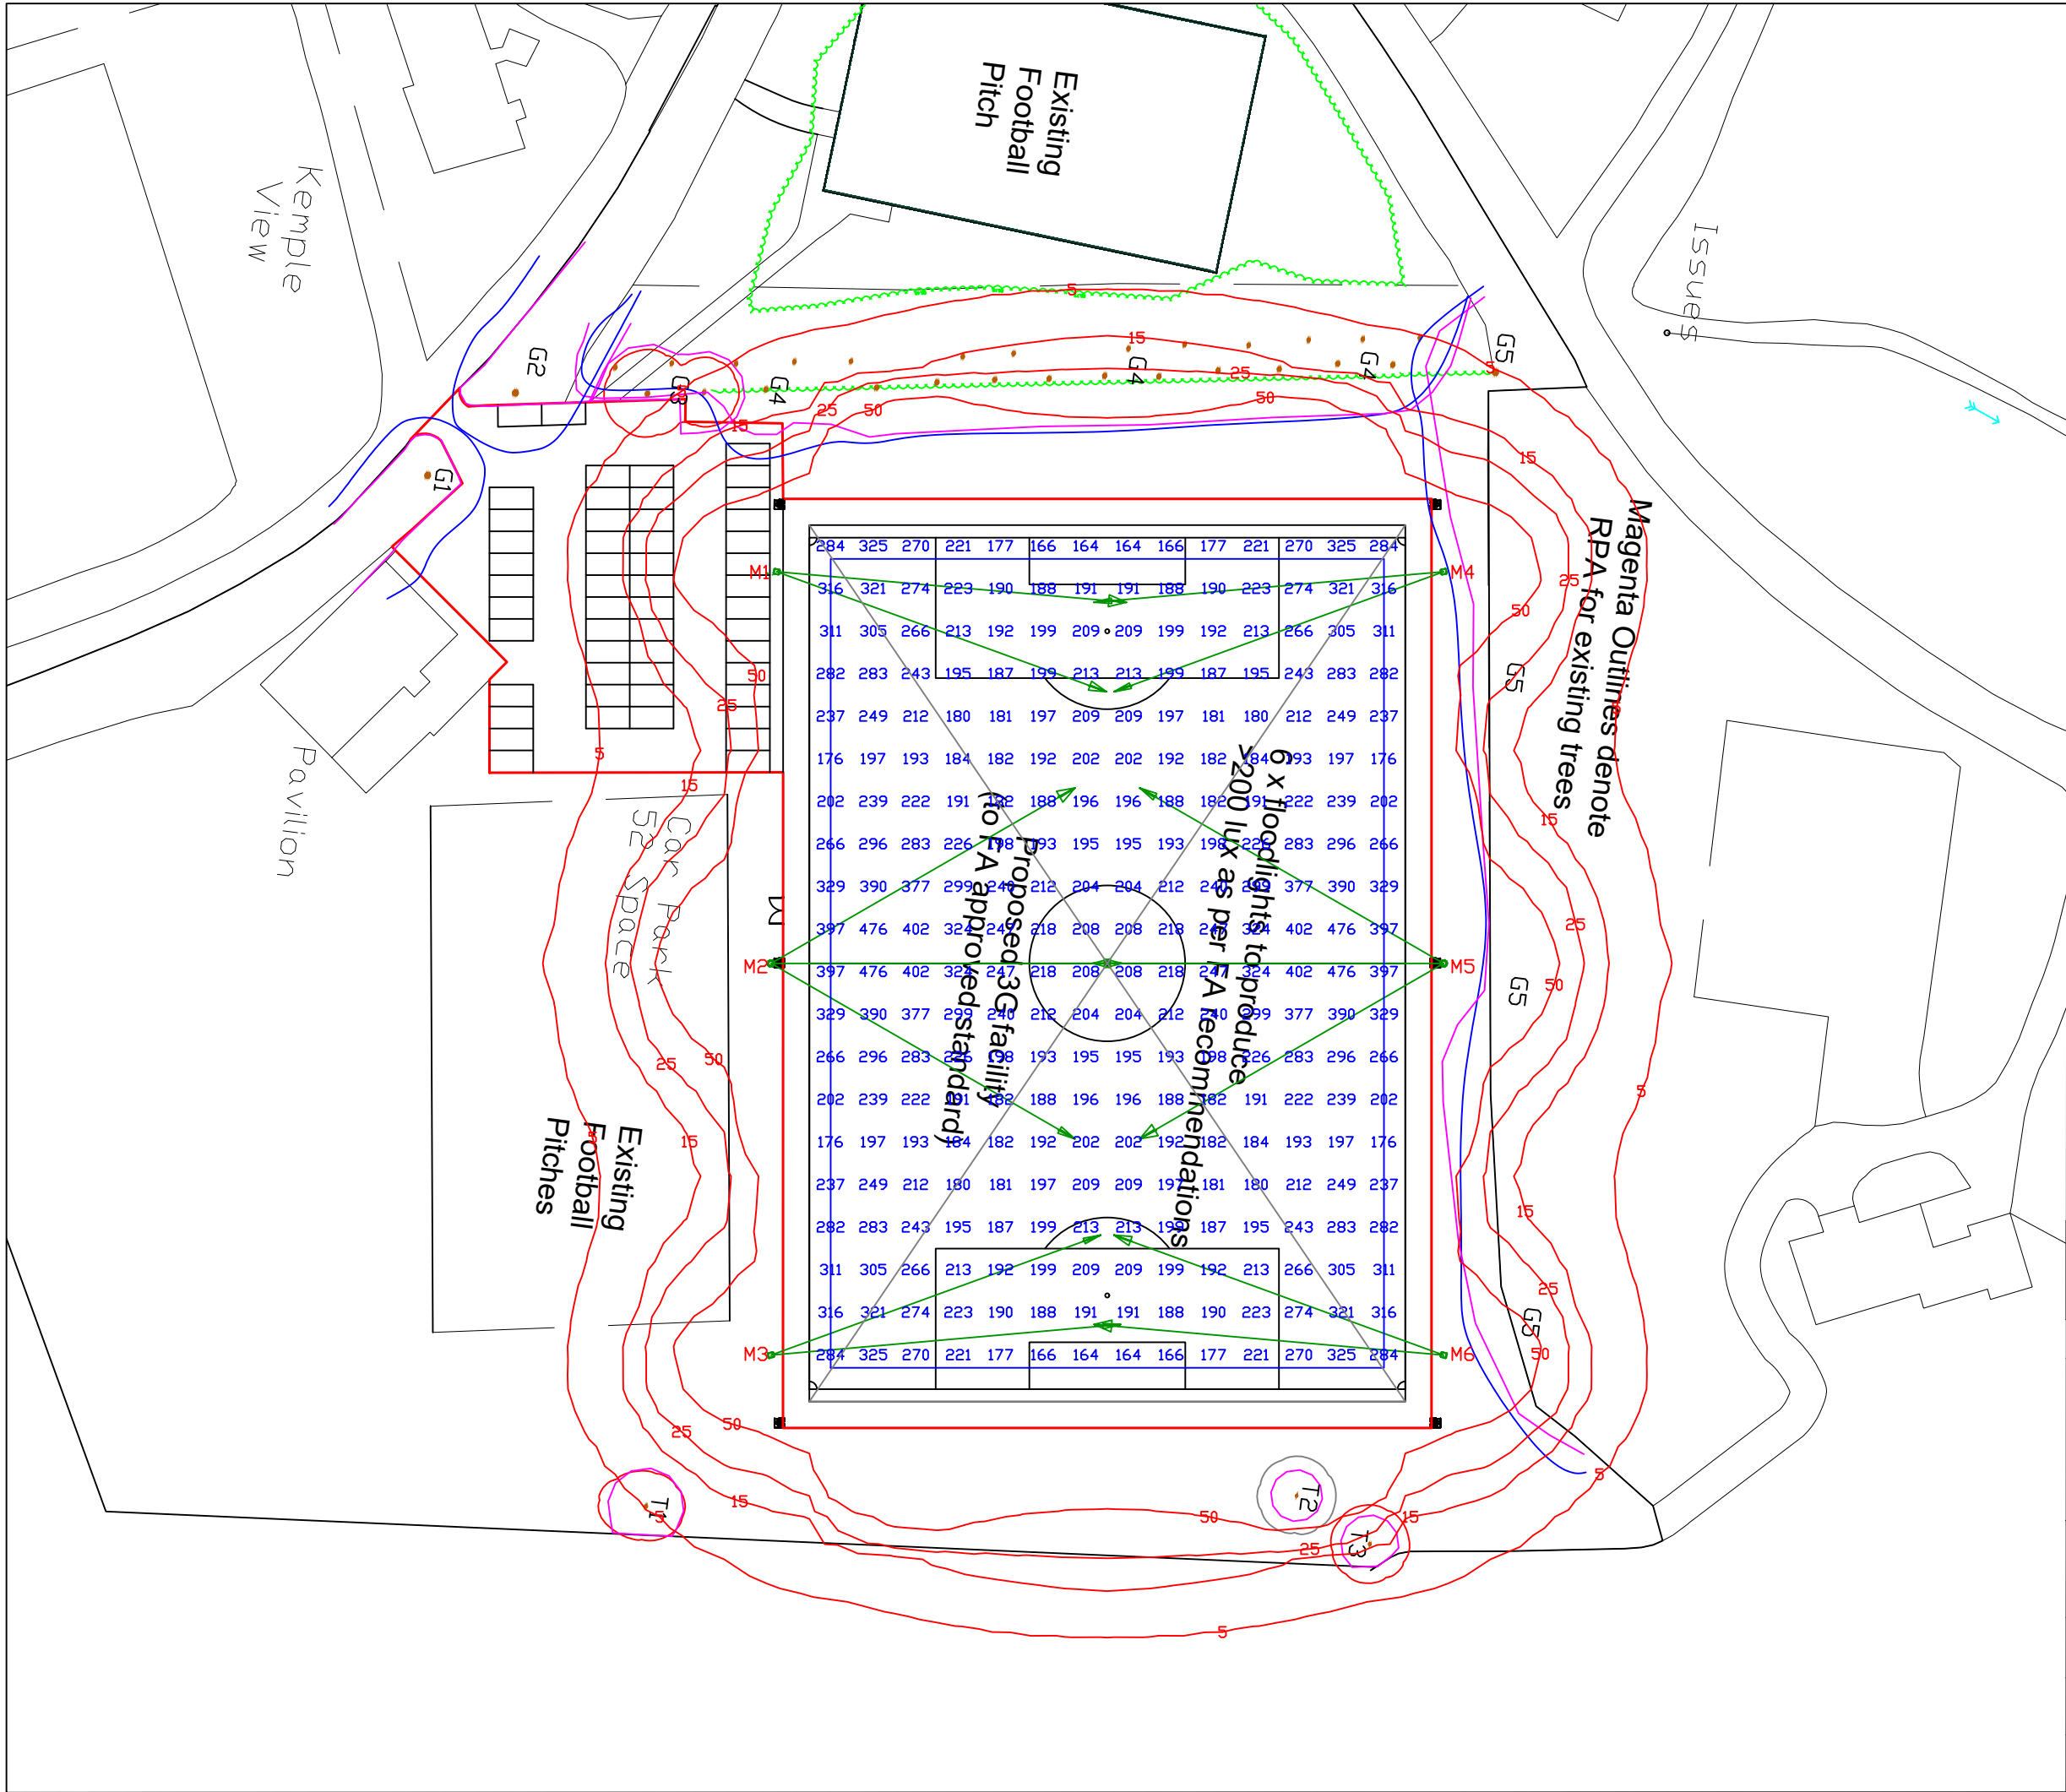

Notes

Floodlighting Equipment
6 x 15m Masts (M1-M6)
Each carrying the following Floodlights :-
M1,M3,M4,M6
.....2 x Philips BVP527 NB/A55
M2,M5
.....3 x Philips BVP527 NB/A55

Lamps = Philips LED

Illuminance Levels
Initial -
(100hrs) E.i.ave = 240Lux
Maintained -
(4000hrs) E.i.ave = 216Lux

Uniformity
Emin/Eave = 0.68

Grid values in Lux (initial).
Grid interval = 5m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90

HALLIDAY LIGHTING

www.halliday-lighting.co.uk

Project
Langho Sports and Social Club

Drawing Title
Proposed floodlighting

Drawn By (print) JM	Date 04/06/2020
Project No 1257	Scale 1:750 @ A3
Drawing No HLS1257	Status Proposal