


Exg. Electric Main feed from Sub-station at Woodfield

GENERAL NOTES.

1. No. Lighting Columns to have a height of 6.0m above ground level and have an external diameter of 90mm. Construction of galvanised steel.
2. Cable to be 4mm 3 core steel wire armoured laid within PVC ducting. Depth of cable below ground level to be 0.5m.

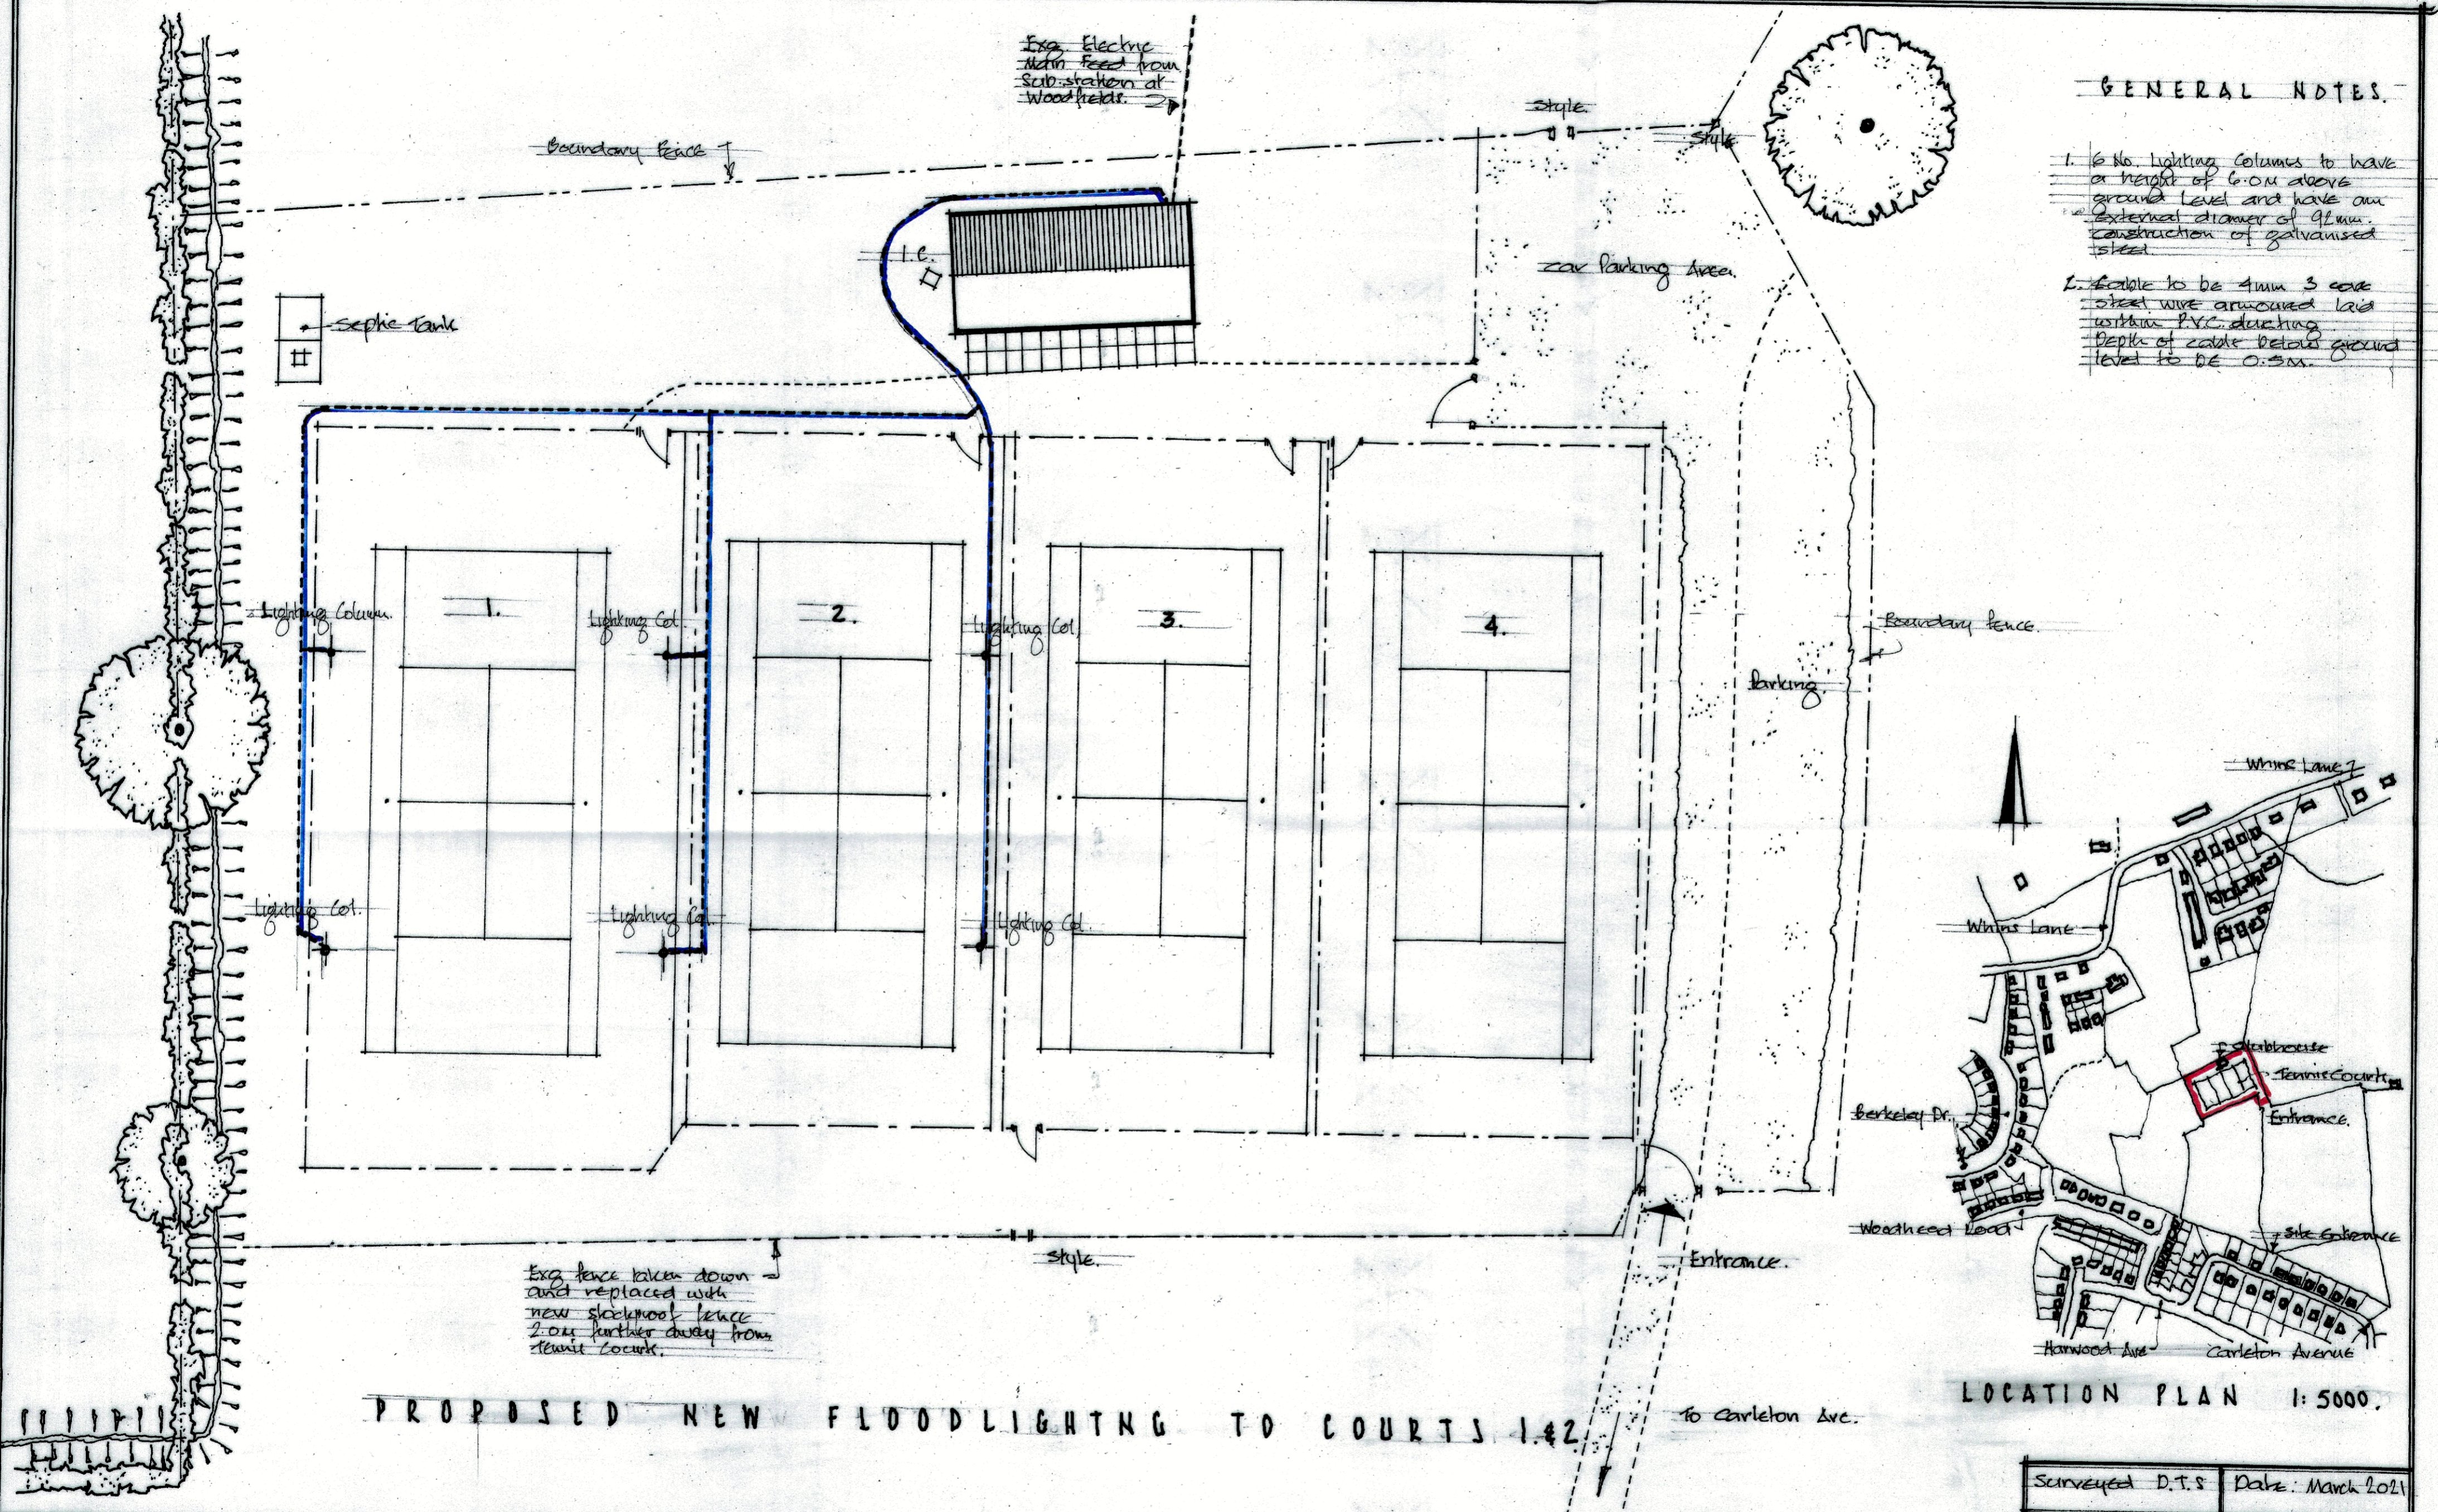

Exg fence taken down and replaced with new stockpool fence 2.0m further away from tennis courts.

PROPOSED NEW FLOODLIGHTING TO COURTS 1, 2, 3, 4

LOCATION PLAN 1:5000.

Surveyed D.T.S.	Date: March 2021
Drawn D.T.S.	Scale 1:200

READ AND SIMONSTONE COMMUNITY TENNIS CLUB.