


Centre : X : 367854 Y : 442026

Date : 04/04/2024

Scale Approx : 2095

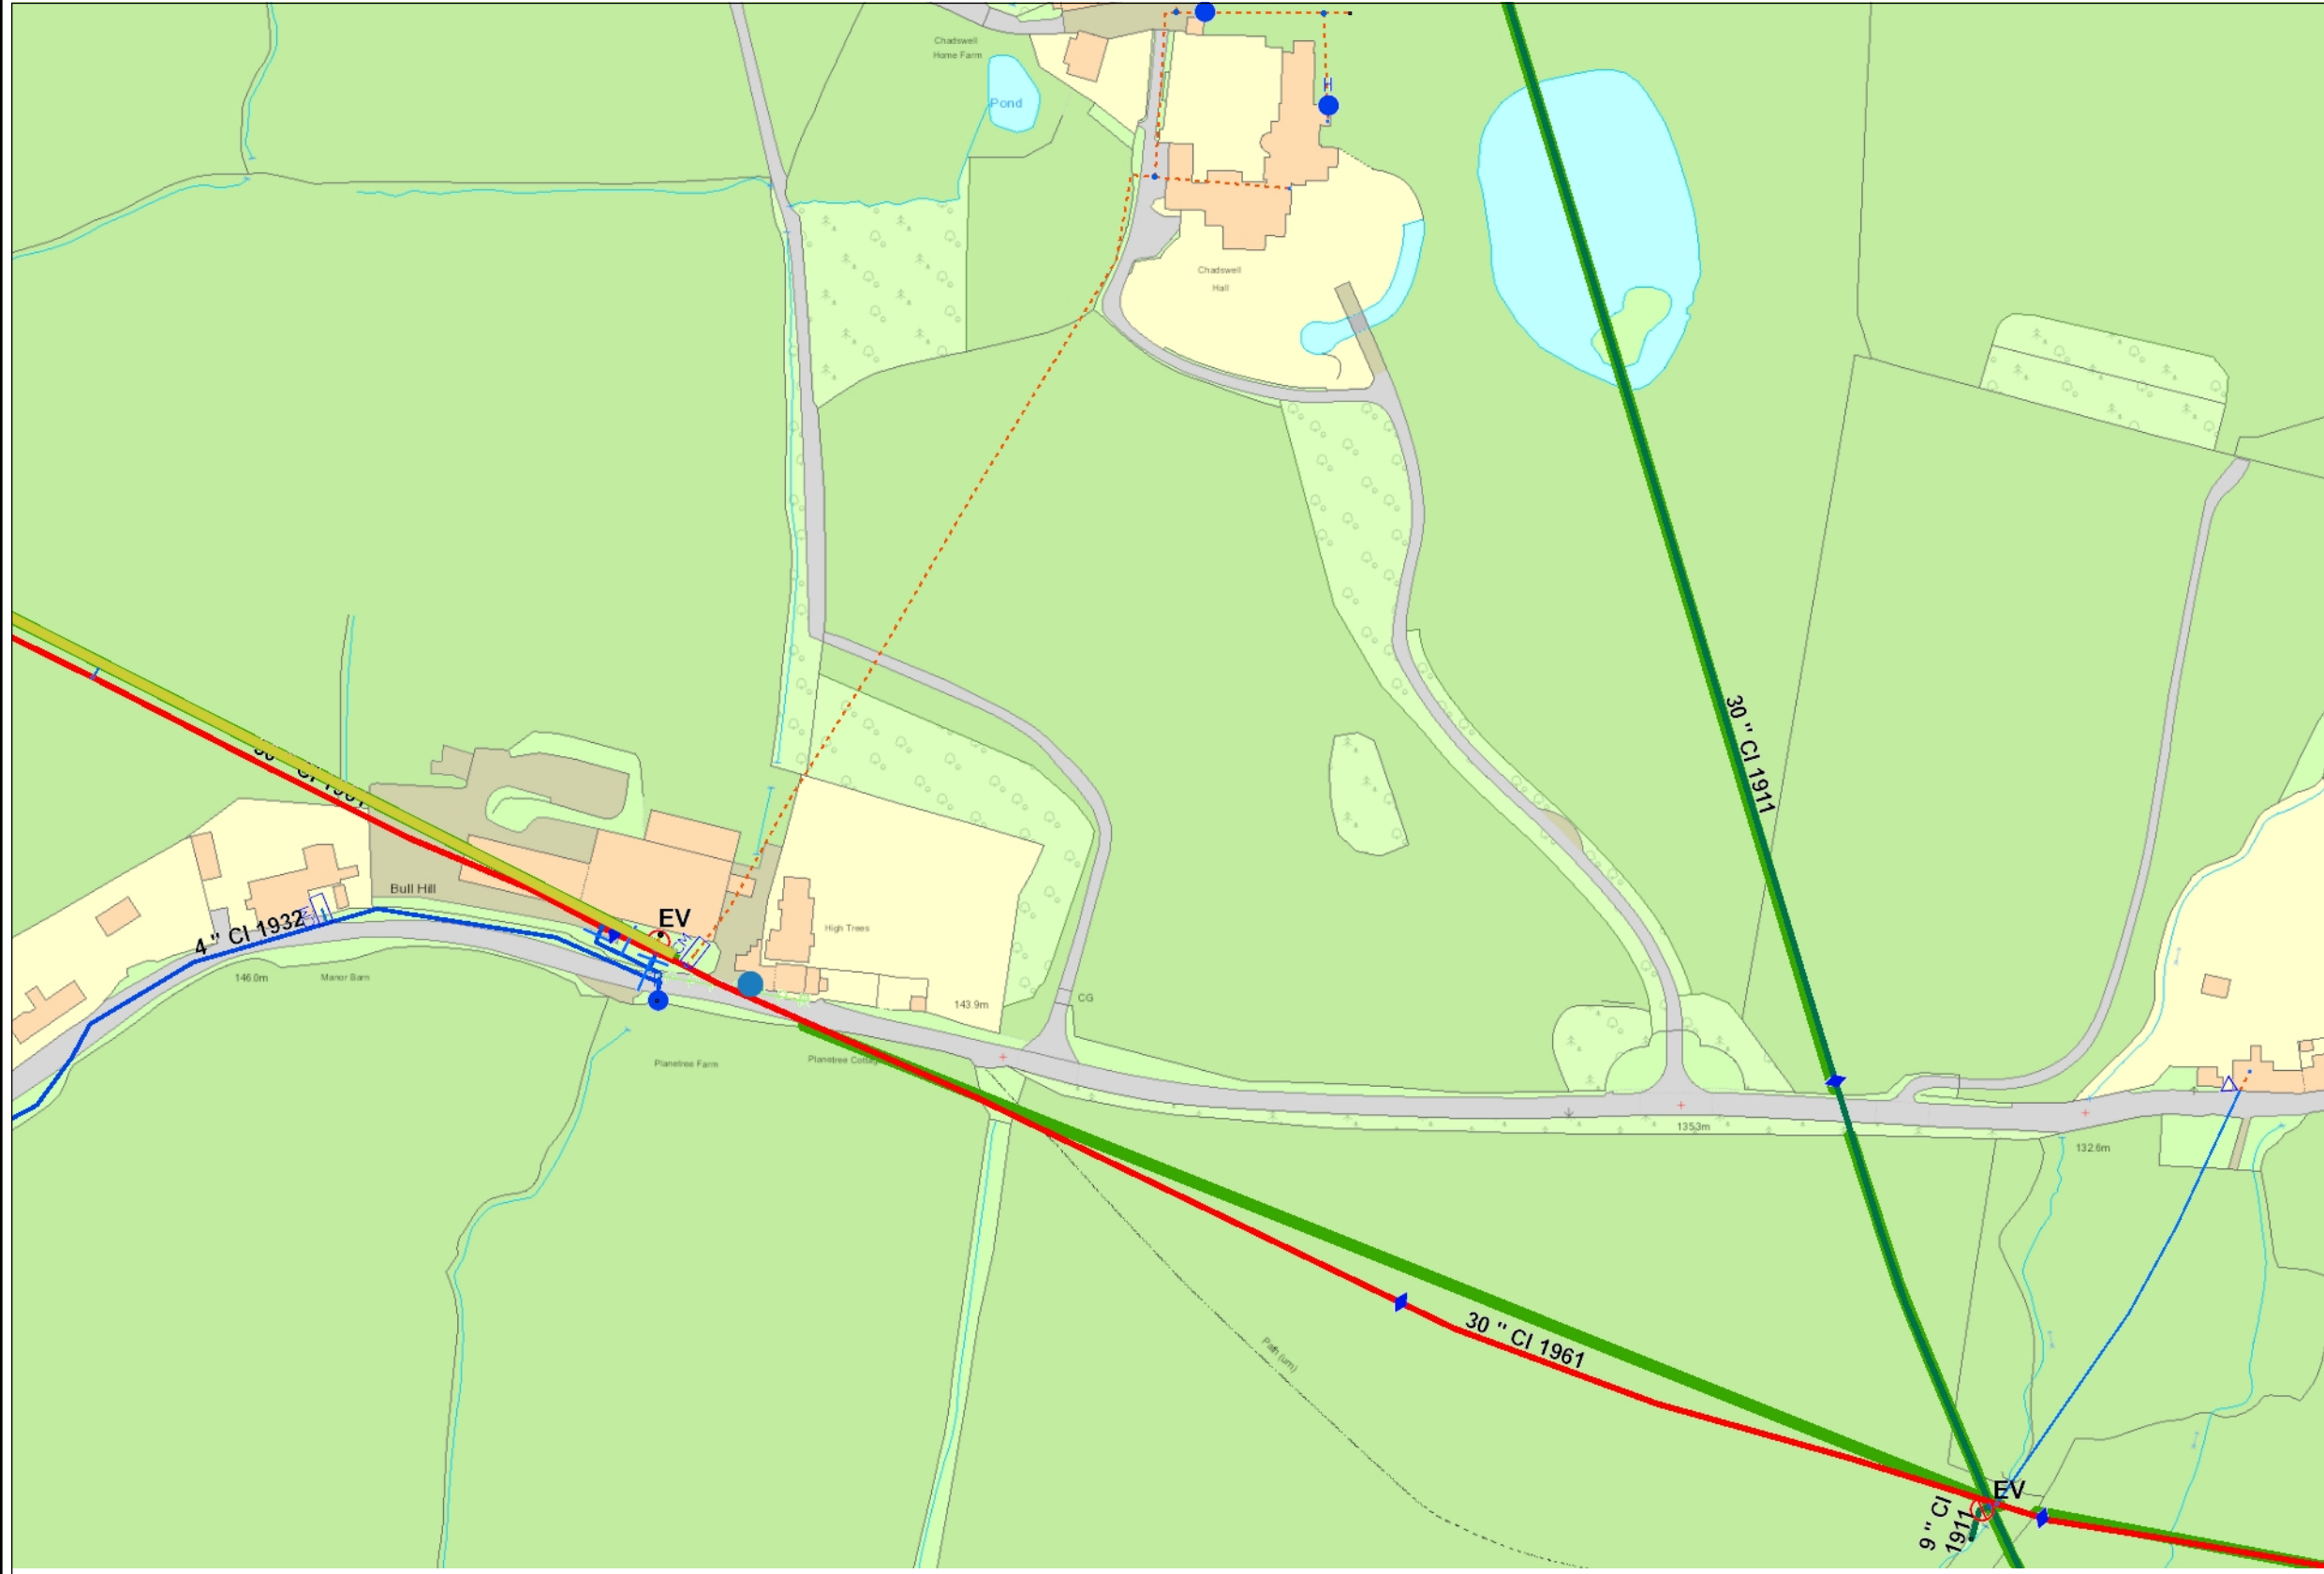

### LEGEND

- |  |           |  |      |  |                    |
|--|-----------|--|------|--|--------------------|
|  | Abandoned |  | Live |  | Distribution Main  |
|  |           |  |      |  | Trunk Main         |
|  |           |  |      |  | Comms Pipe         |
|  |           |  |      |  | Private Pipe       |
|  |           |  |      |  | Raw Water          |
|  |           |  |      |  | LDTM Raw Water     |
|  |           |  |      |  | LDTM Treated Water |
- 
- Air Valve
  - AC Valve, Open
  - AC Valve, Closed
  - Stop Tap
  - Flow Meter
  - Domestic Meter
  - Commercial Meter
  - Pump
  - Non Return Valve
  - Pressure Management Valve
  - Hydrant
  - Fire Hydrant
  - Bore Hole
  - Water Tower
  - Valve House
  - Pumping Station
  - Water Treatment Works
  - Supply Reservoir
  - Impounding Reservoir
  - Service Reservoir
  - Change of Characteristic

**DO NOT SCALE**

Approximate Scale 1 : 2095



**NOT FOR RESALE OR NON-APPROVED USE**

The position of the underground apparatus shown on this plan is approximate only and is given in accordance with the best information currently available. United Utilities Water will not accept liability for any loss or damage caused by the actual position being different from those shown.

