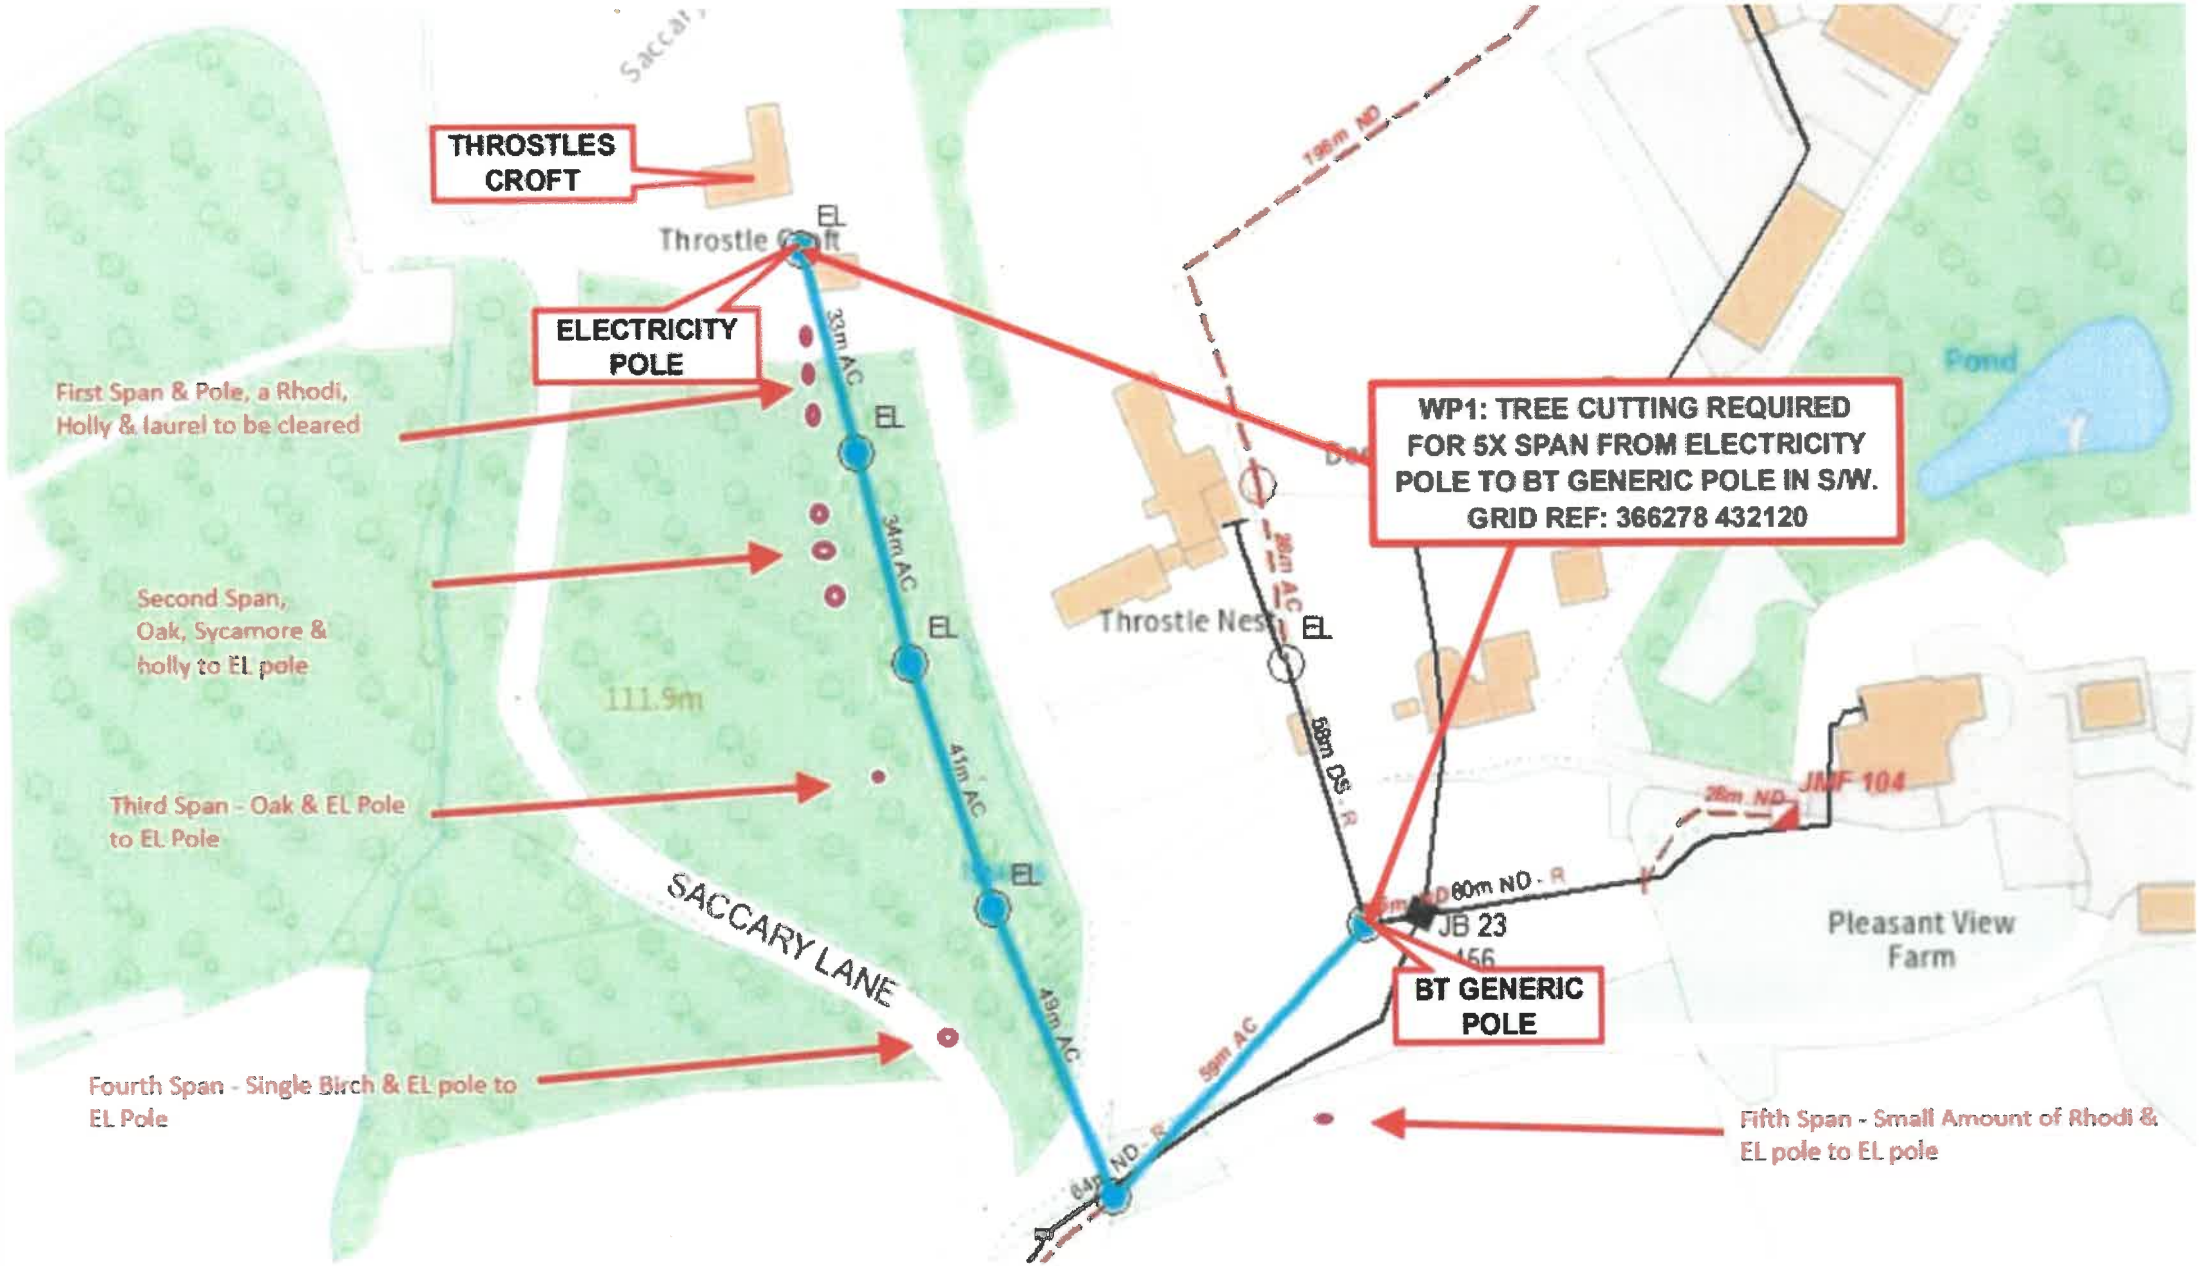
THROSTLES CROFT
ELECTRICITY POLE
First Span & Pole, a Rhodi, Holly & laurel to be cleared
Second Span, Oak, Sycamore & holly to EL pole
Third Span - Oak & EL Pole to EL Pole
Fourth Span - Single Birch & EL pole to EL Pole
Fifth Span - Small Amount of Rhodi & EL pole to EL pole
WP1: TREE CUTTING REQUIRED FOR 5X SPAN FROM ELECTRICITY POLE TO BT GENERIC POLE IN S/W. GRID REF: 366278 432120
BT GENERIC POLE
Throstle Croft
Throstle Nest
Pleasant View Farm
SACCARY LANE
Pond
111.9m
33m AC
34m AC
41m AC
49m AC
59m AC
58m DS - R
60m ND - R
196m ND
JB 23
JMF 104
EL