

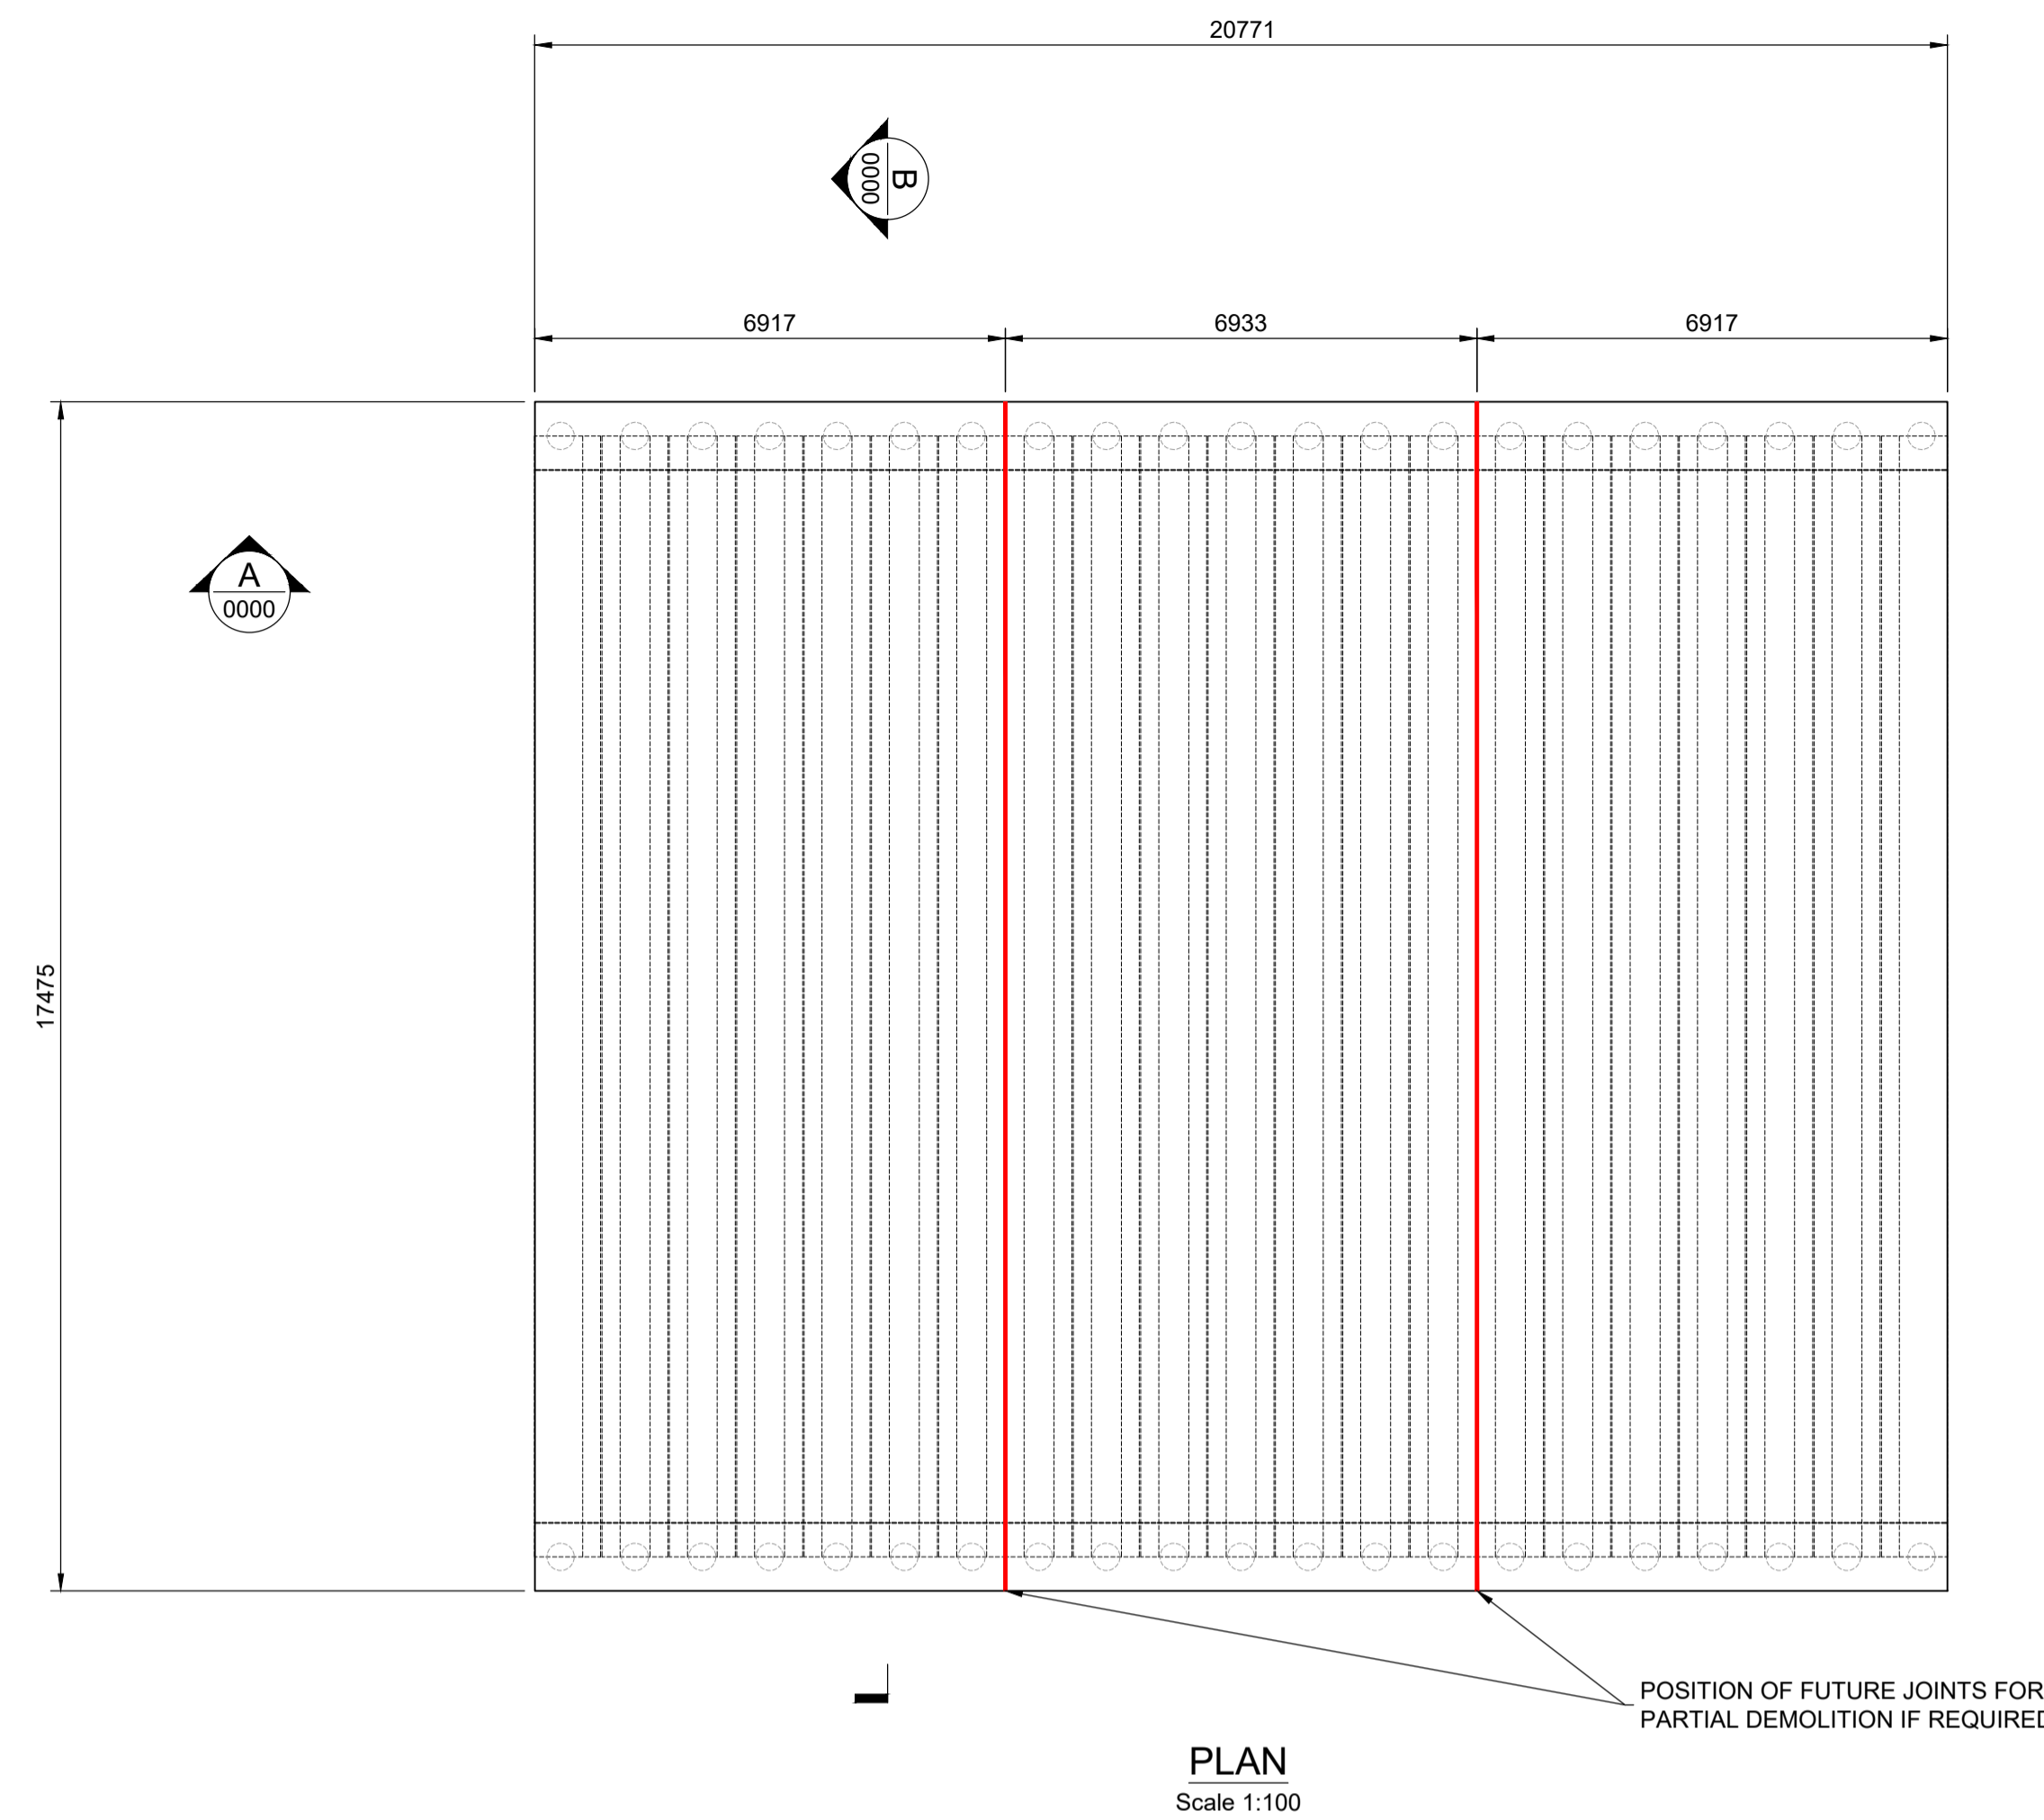
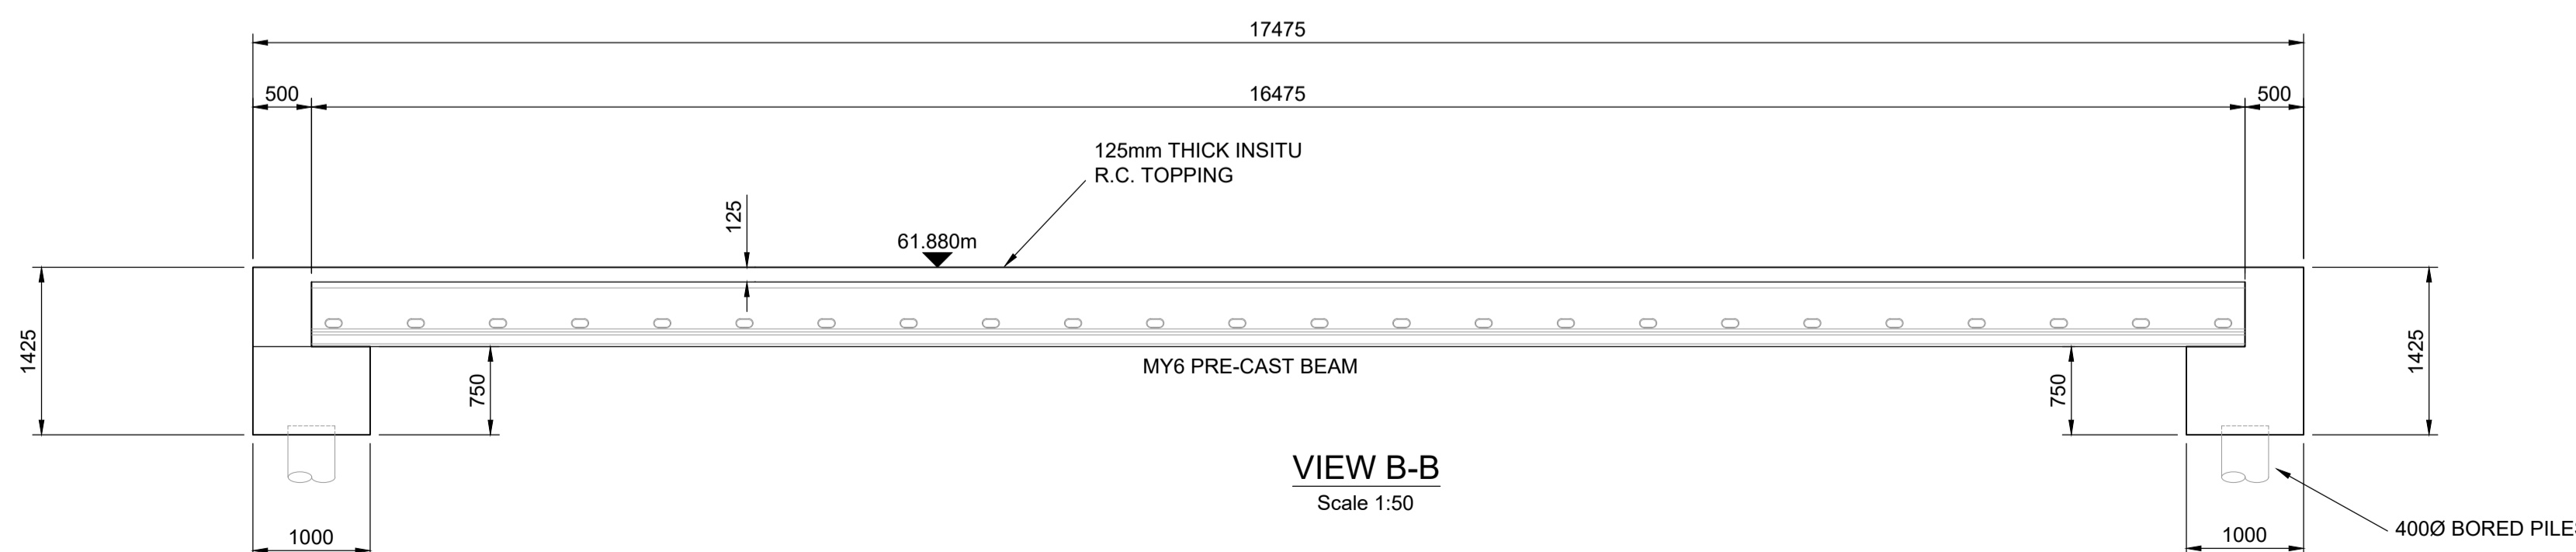
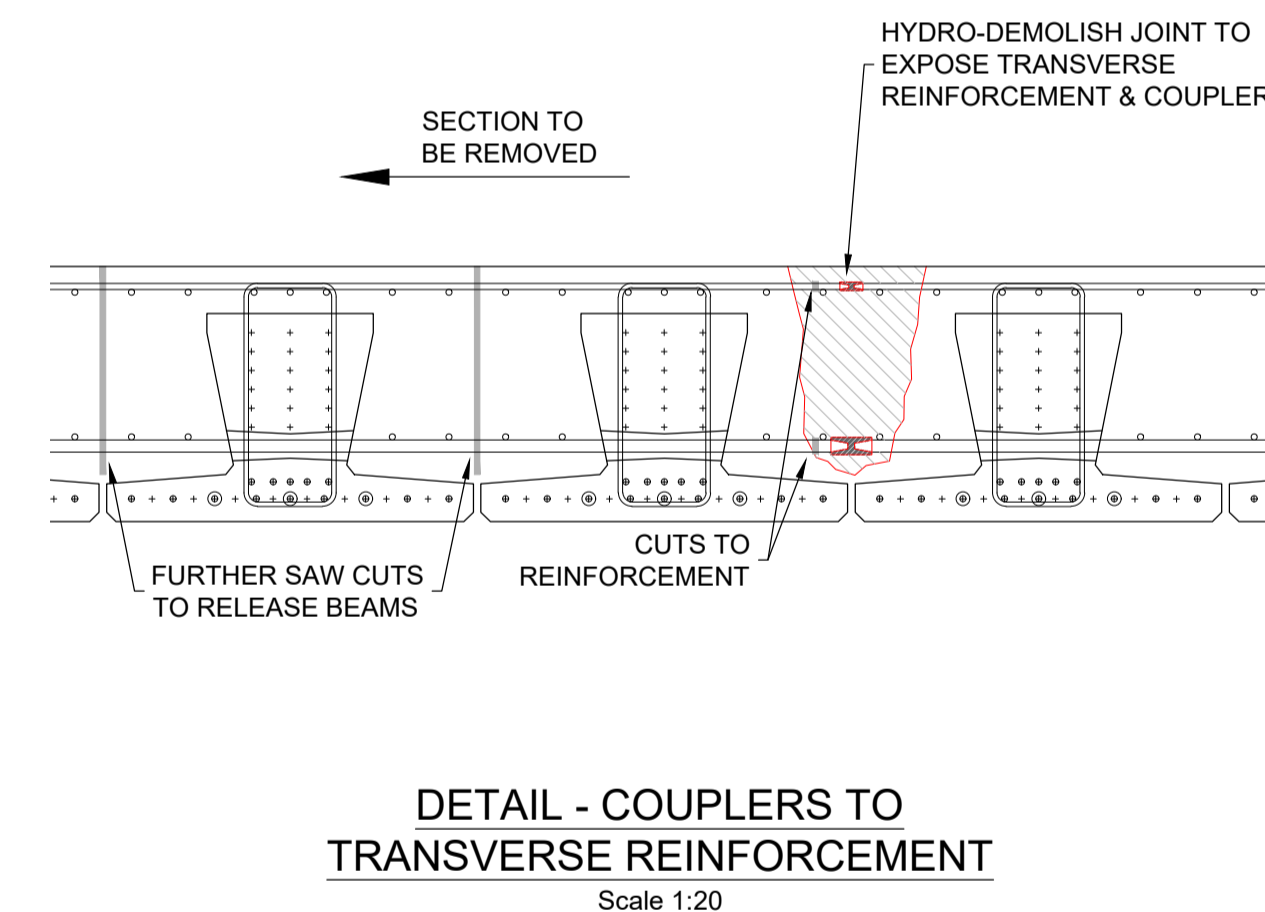


NOTES

1. See drawing 001 for all general notes.
2. To be read in conjunction with all drawings listed on drawing 001

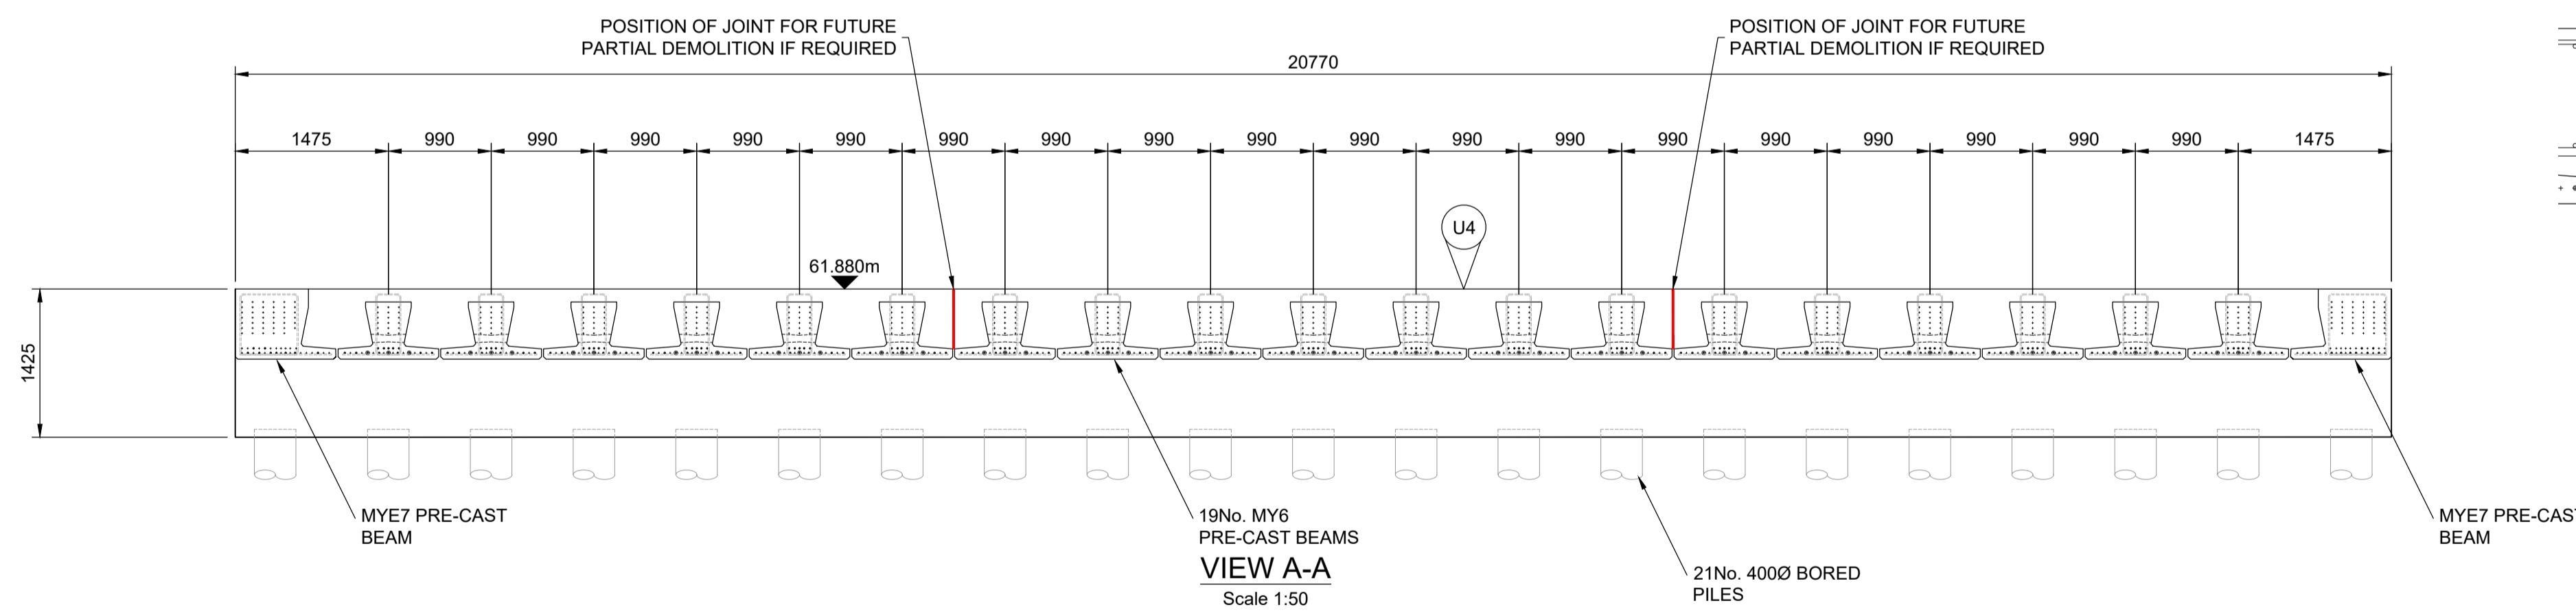

INSITU DECK:	PRE-STRESSED BEAMS:
STRUCTURAL CONCRETE SPECIFICATION FOR DESIGNED CONCRETE:	STRUCTURAL CONCRETE SPECIFICATION FOR DESIGNED CONCRETE:
A. TO CONFORM WITH BS EN 206-1 AND BS 8500-2	A. TO CONFORM WITH BS EN 206-1 AND BS 8500-2
B. COMPRESSIVE STRENGTH: C40/50	B. COMPRESSIVE STRENGTH: C50/60
C. MAXIMUM W/C RATIO: 0.45	C. MAXIMUM W/C RATIO: 0.35
D. MINIMUM CEMENT CONTENT: 340kg/m³	D. MINIMUM CEMENT CONTENT: 380kg/m³
E. DC-CLASS: N/A	E. DC-CLASS: N/A
F. CEMENT OR COMBINATION: IIB-V	F. CEMENT OR COMBINATION: IIB-V, IIIA
G. TARGET DENSITY CLASS: N/A	G. TARGET DENSITY CLASS: N/A
H. MAXIMUM AGGREGATE SIZE: 20mm	H. MAXIMUM AGGREGATE SIZE: 20mm
I. CHLORIDE CLASS: CL 0.40	I. CHLORIDE CLASS: CL 0.40
J. CONSISTENCE CLASS: TO BE SPECIFIED BY THE FABRICATOR	J. CONSISTENCE CLASS: TO BE SPECIFIED BY THE FABRICATOR
K. NOMINAL COVER TO BE 45mm	K. NOMINAL COVER TO BE 40mm
L. EXPOSURE CLASS: XC3/4 TO TOP FACE OF CONCRETE DECK	L. EXPOSURE CLASS: XD2 FOR BEAM SOFFIT XC3/4 FOR SIDES TO EDGE BEAMS

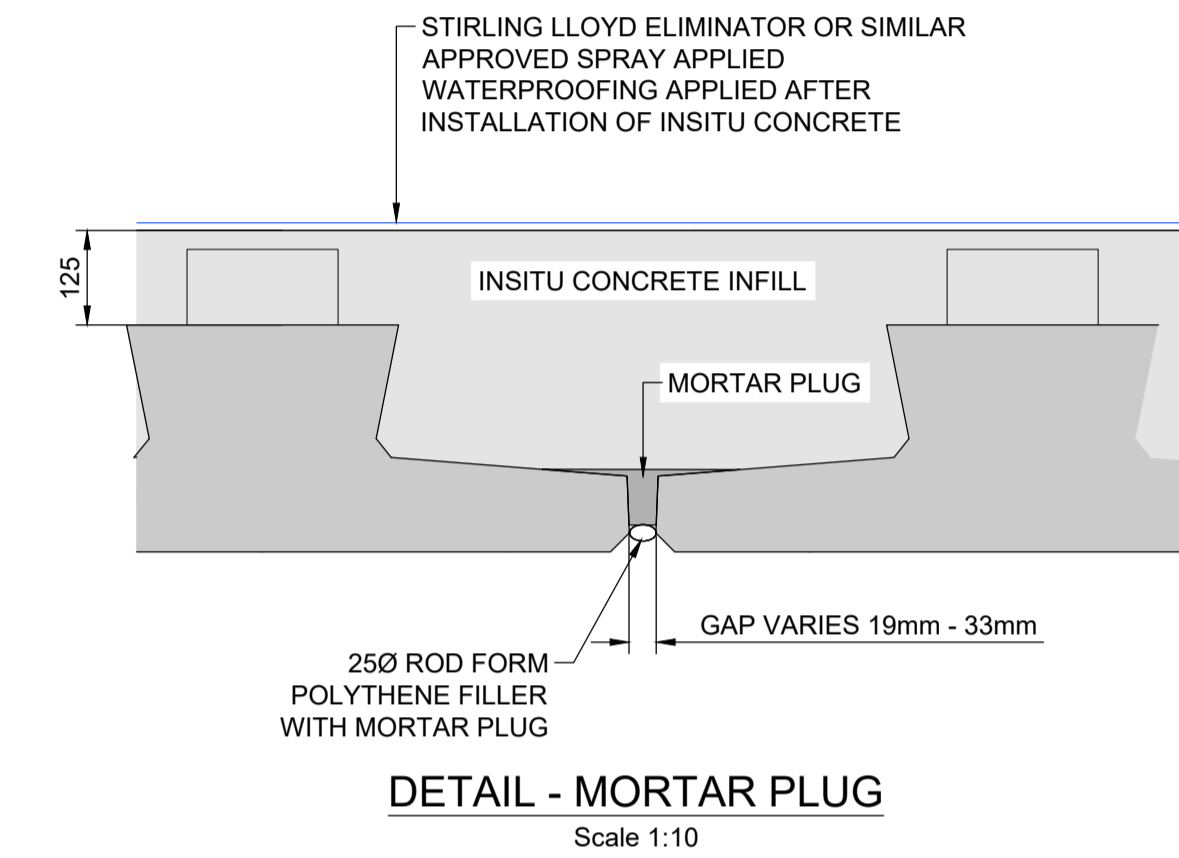

APPROVAL

REV	DESCRIPTION	BY	CHK	APP	DATE
B02	JOINTS ADDED	KB	JL	JL	09.03.22
B01	DETAILED DESIGN	WW	NC	JL	25.06.21

REVISION TABLE

HBPW
CONSULTING ENGINEERS

43 BRIDGEGATE
RETFORD
NOTTINGHAMSHIRE
DN22 7UX
TEL. (01777) 869896
www.hbpw.co.uk

CLIENT:

LOVELLS

CONTRACTOR:


LOVELLS

HBPW PROJECT NUMBER:
SL07119

PROJECT:
Whalley Aquaduct Crossing

DRAWING:
Deck General Arrangement

PROJECT ENGINEER: J.Livesey	DRAWN: K.Beishaw
CHECKED: N.Chia	APPROVED: J.Livesey
DATE: 17.06.2021	SCALE: As Shown
SIZE: A1	SUITABILITY: -
REVISION: B02	DOCUMENT REFERENCE NUMBER: 7119-HBPW-DRG-ECV-0103

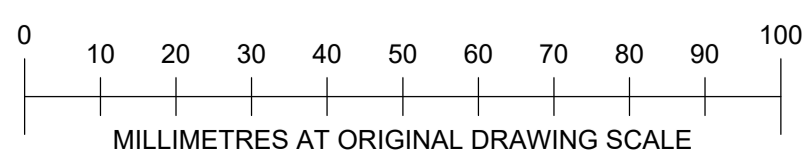

COPYRIGHT © HBPW LLP (2019)