


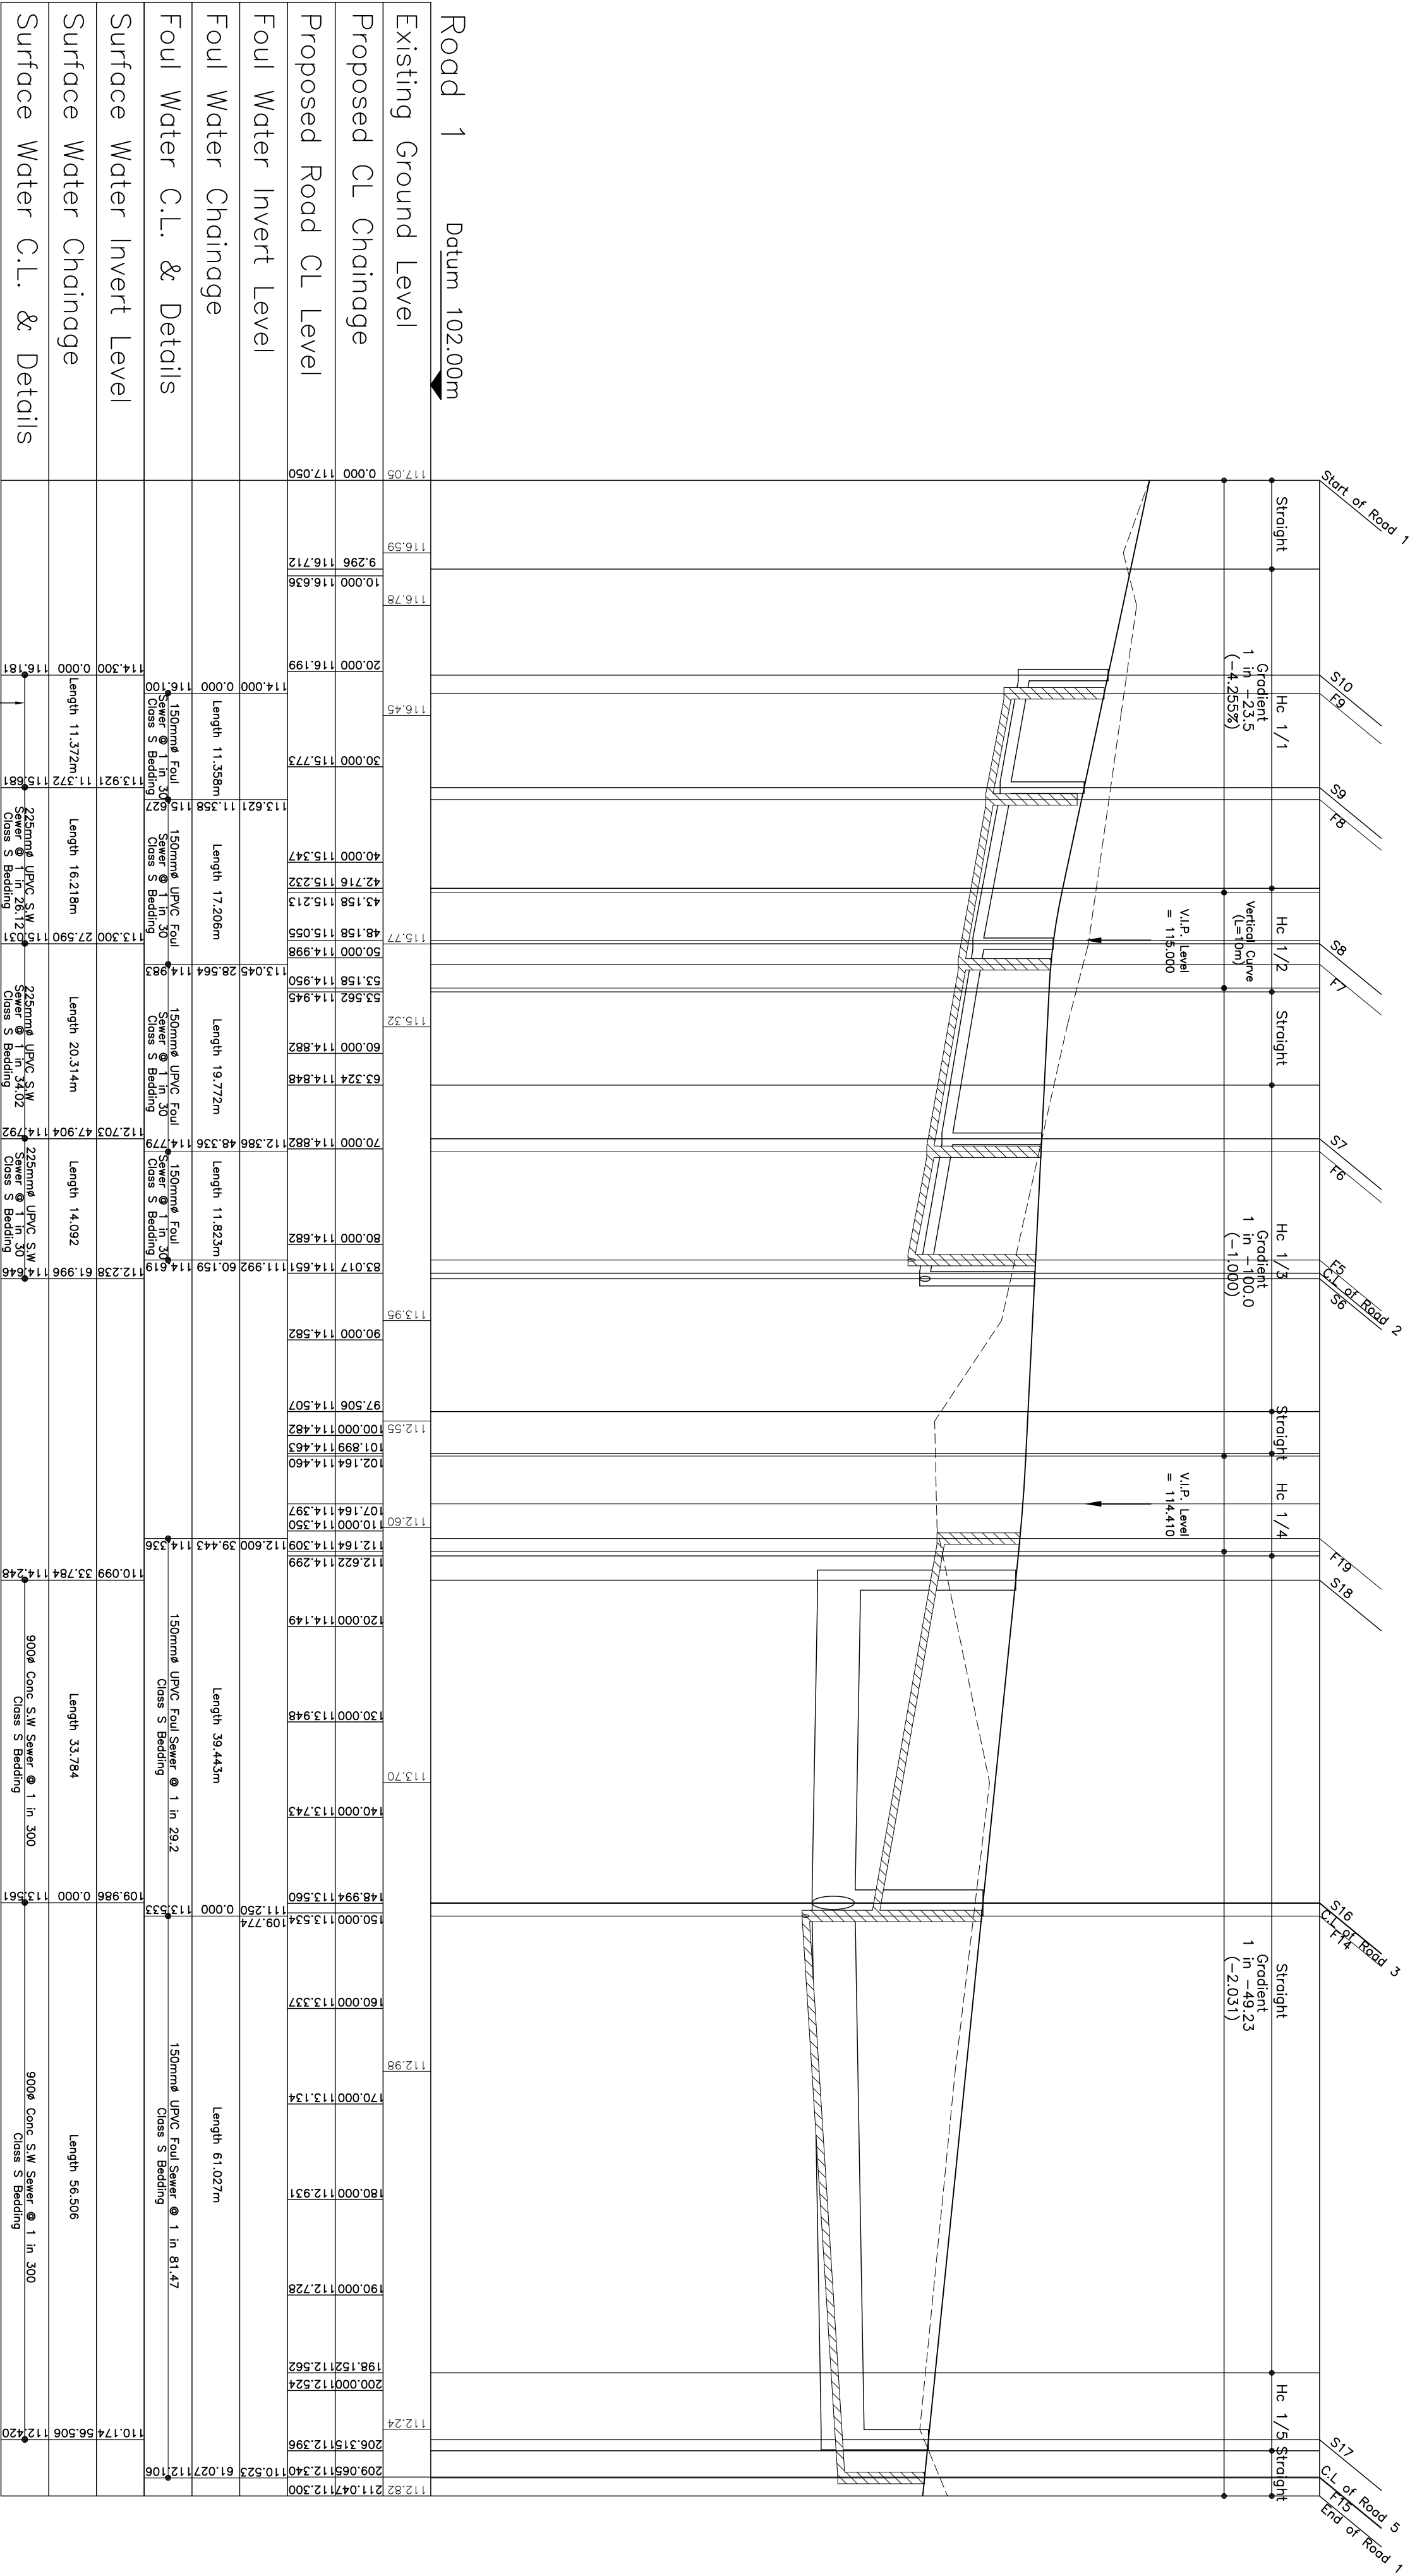

Longitudinal Section Road 1

NOTES

1. Setting out shall be undertaken using only the following instruments should not be scaled from this drawing.
2. All sewers and highway drainage shall be constructed in accordance with Sewers for Adoption 6th Edition and United Utilities Details & Guidelines.
3. A minimum 150mm Concrete Protection shall be provided to all sewers with cover of less than 1.2m in highway areas.
4. Sewers shall have a minimum cover of 0.9m.
5. Where 'Ultra Filtr' UPVC pipes (or similar approved) are used in adoptable drainage they shall be handled and laid in accordance with the specification and guidance issued by the High performance Pipe Association

6. A Class S Bed and surround must be used for such pipes. From the invert level to the top of the bed and surround shall be directed by the Highway Authority be a suitable granular material all in accordance with Sewers for adoption
7. Plastic pipes must comply with WIS 4-35-01

REVISIONS			
REV.	DATE	INT.	DETAILS
A	10/03/12	JCM	F10 removed.
B	20/03/12	JCM	F10 removed.
C	03/03/12	JCM	F10 removed.

North Point

Project

Dilworth Lane

Longridge

Client

Howland Homes

Drawn

JCM

Scale

1:500

Vert

1:100

Original Size

A1

Copyright Acknowledgement

© Crown Copyright

License No.

AL00017966

3 Worsley Court

MANCHESTER

M20 3NU

Tel: 0161 703 8801

Fax: 0161 702 8279

www.ironsidefarfar.co.uk

Engineers/Planners

Consultants

Landscapers/Architects

Graphic Design

EDINBURGH

BELSHILL

Drawing No.

3891/3/1

Revision

C