
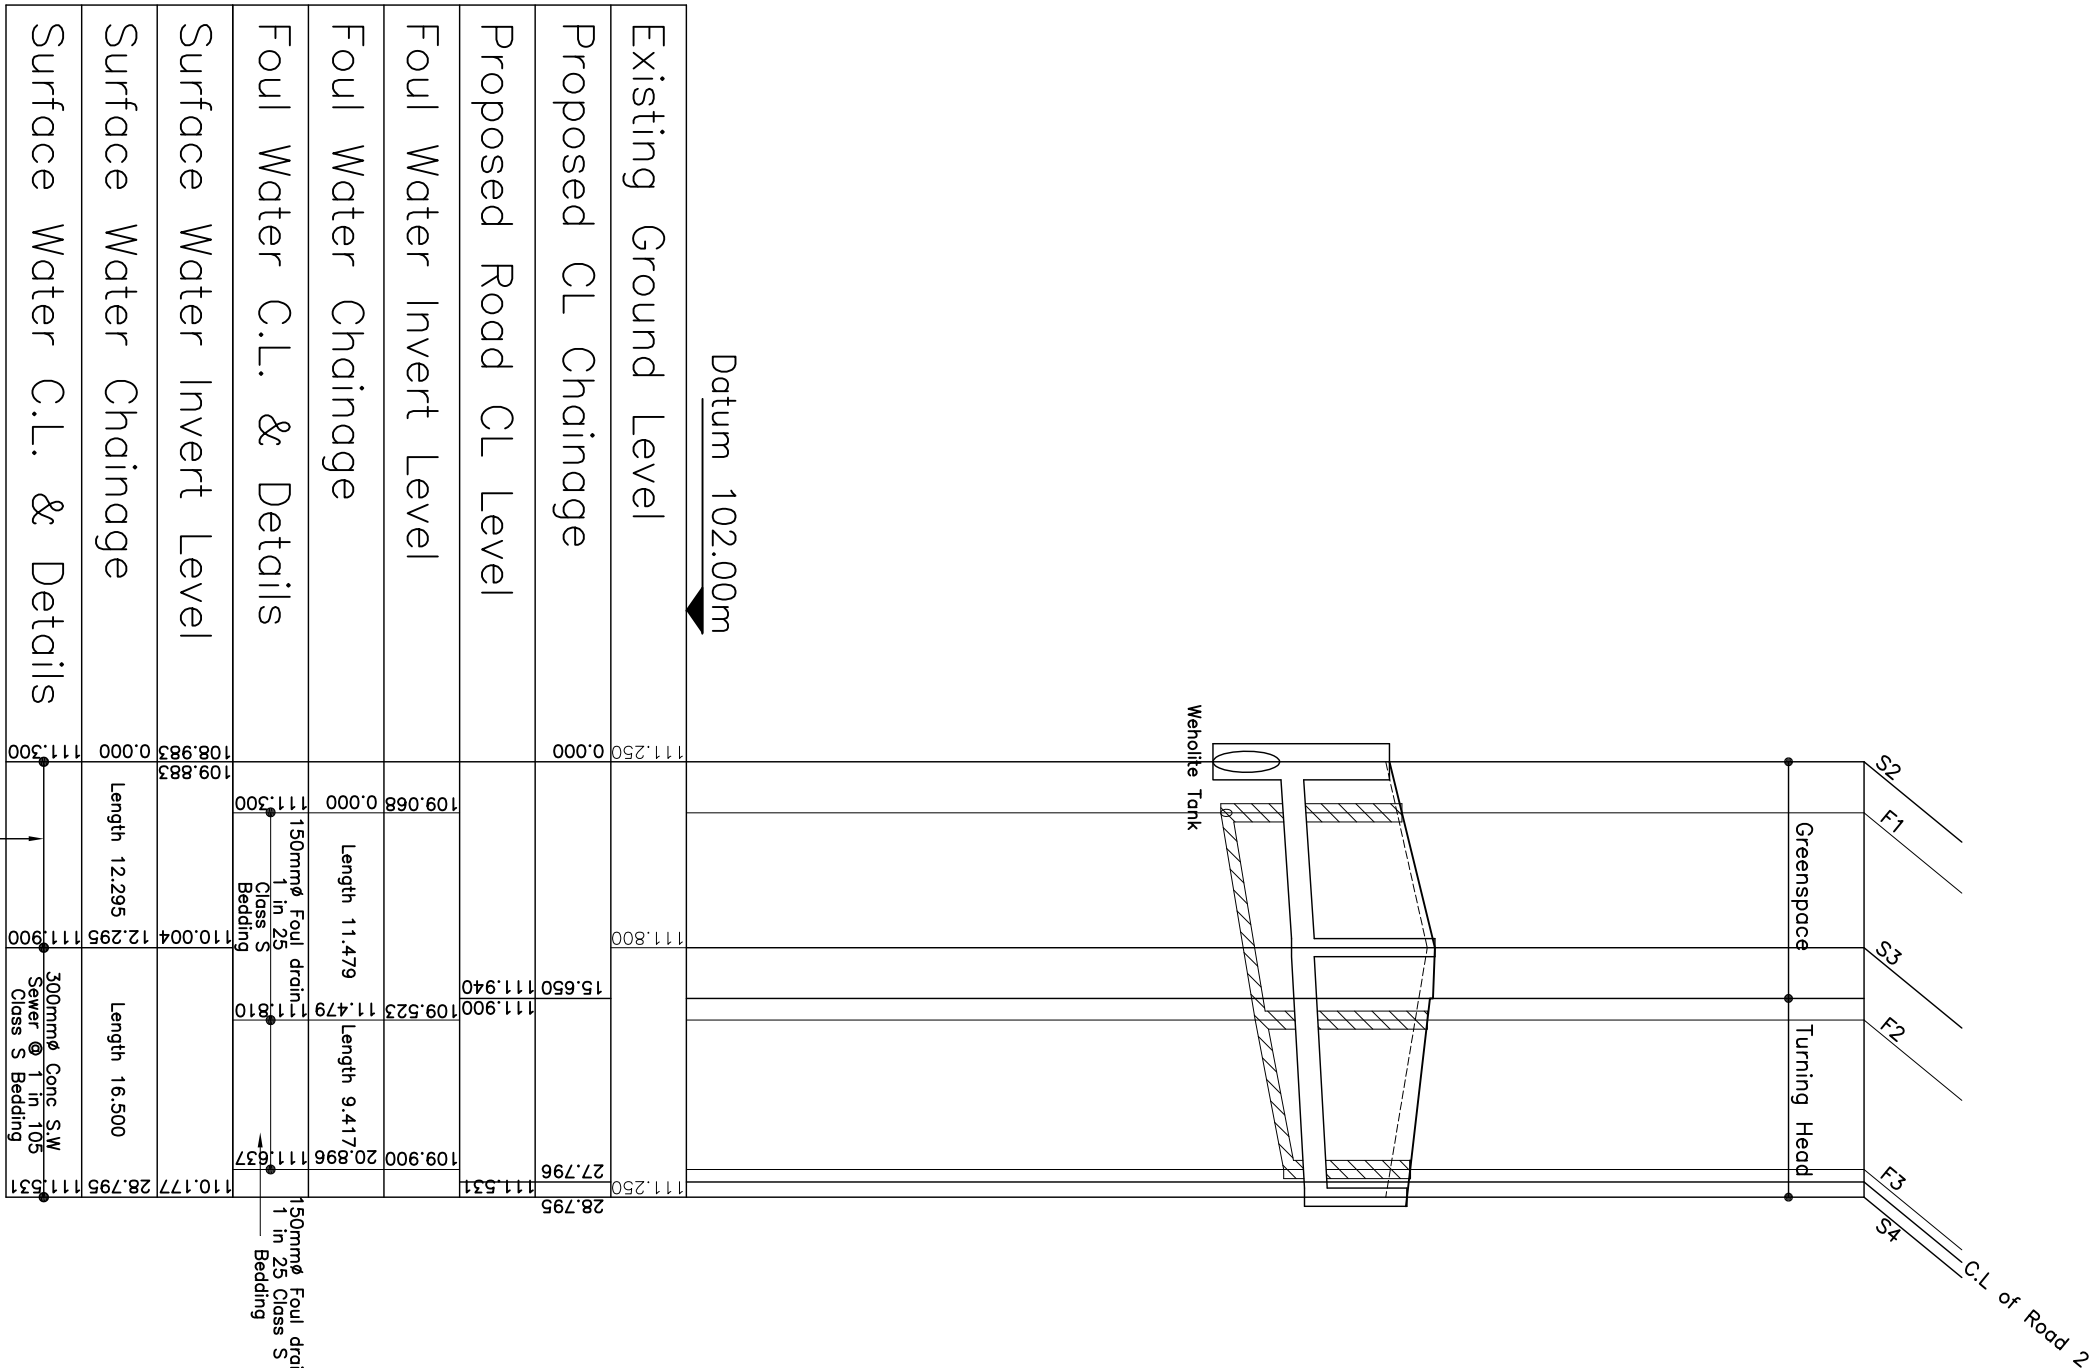
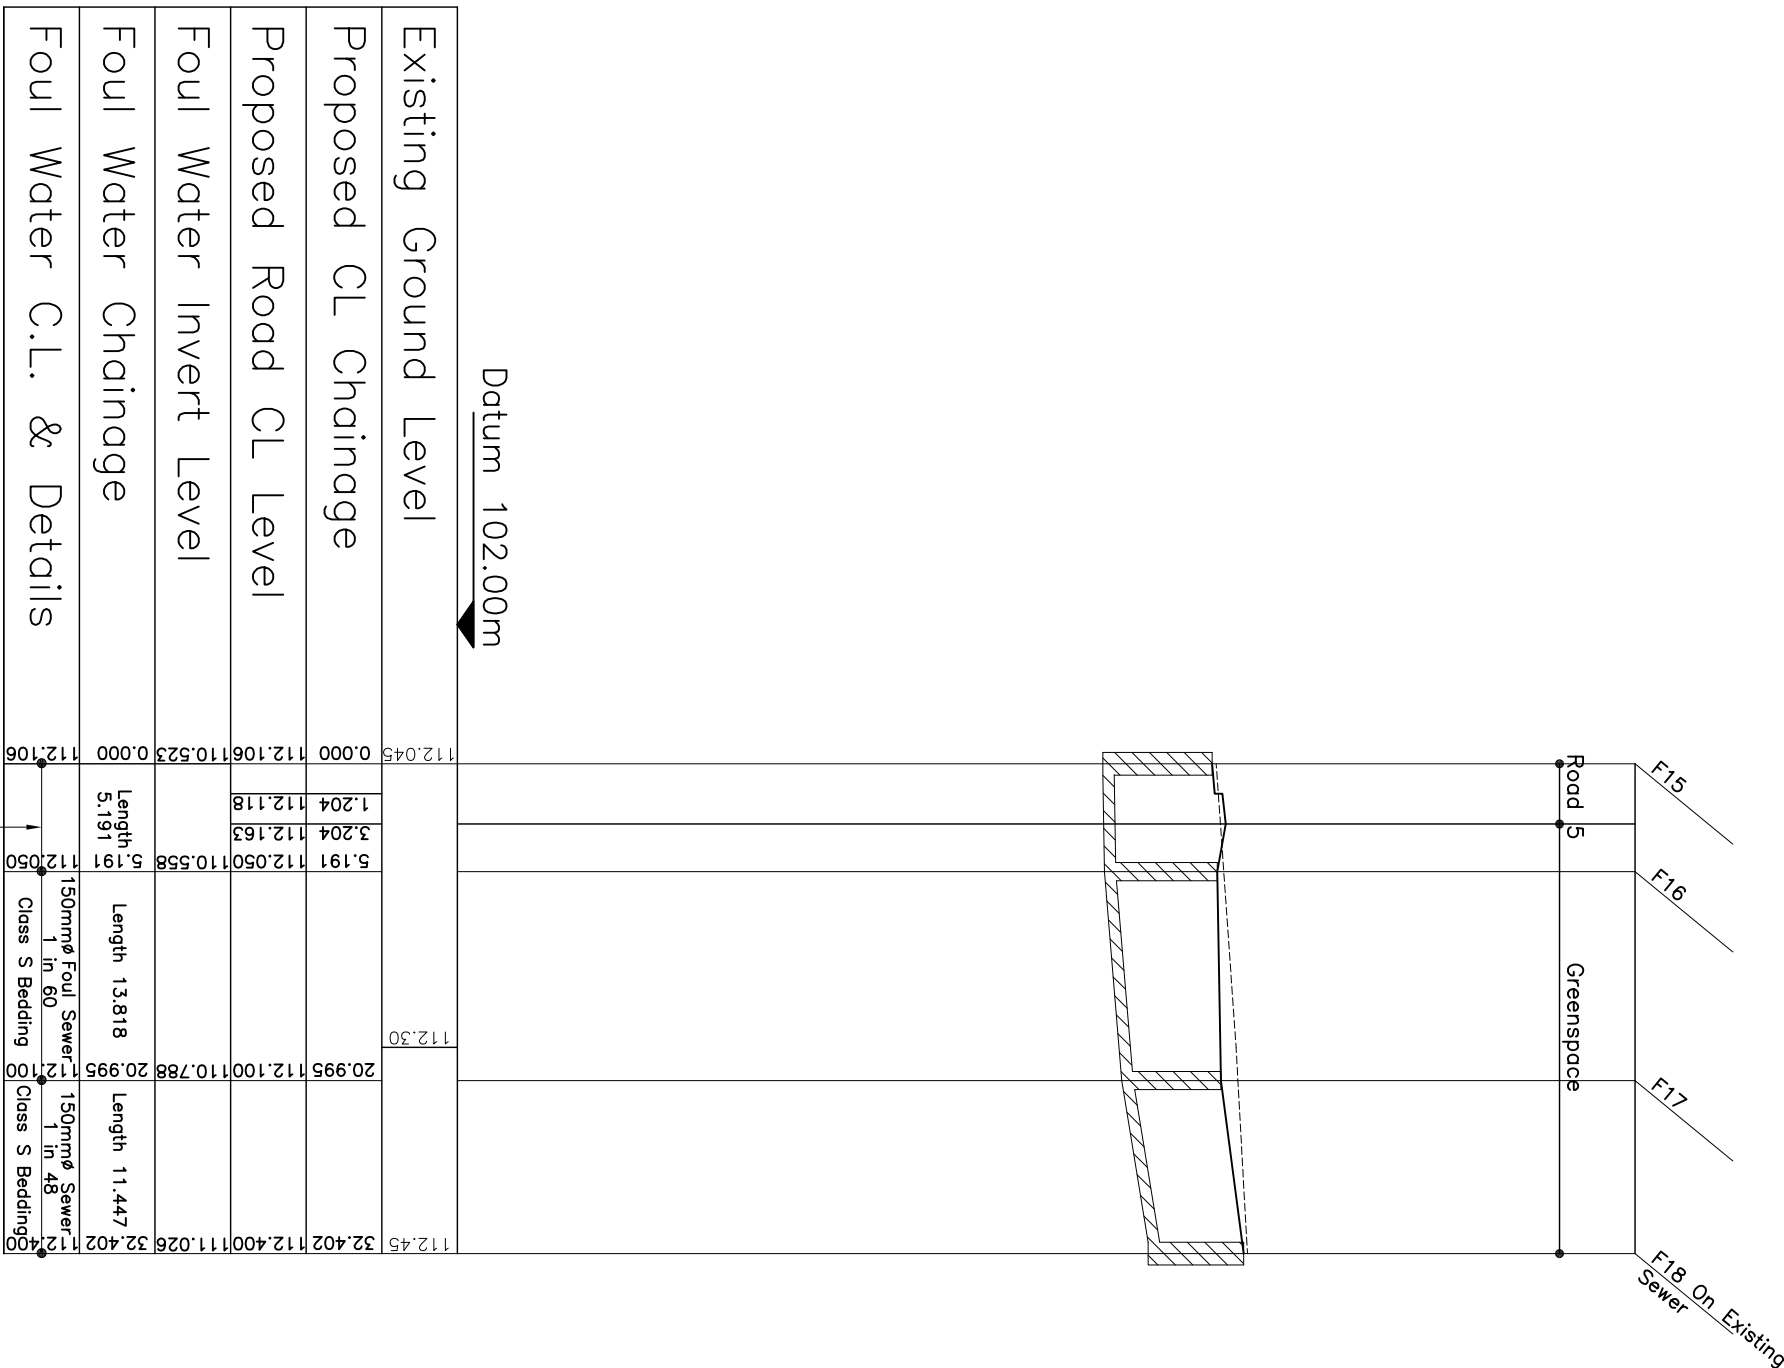


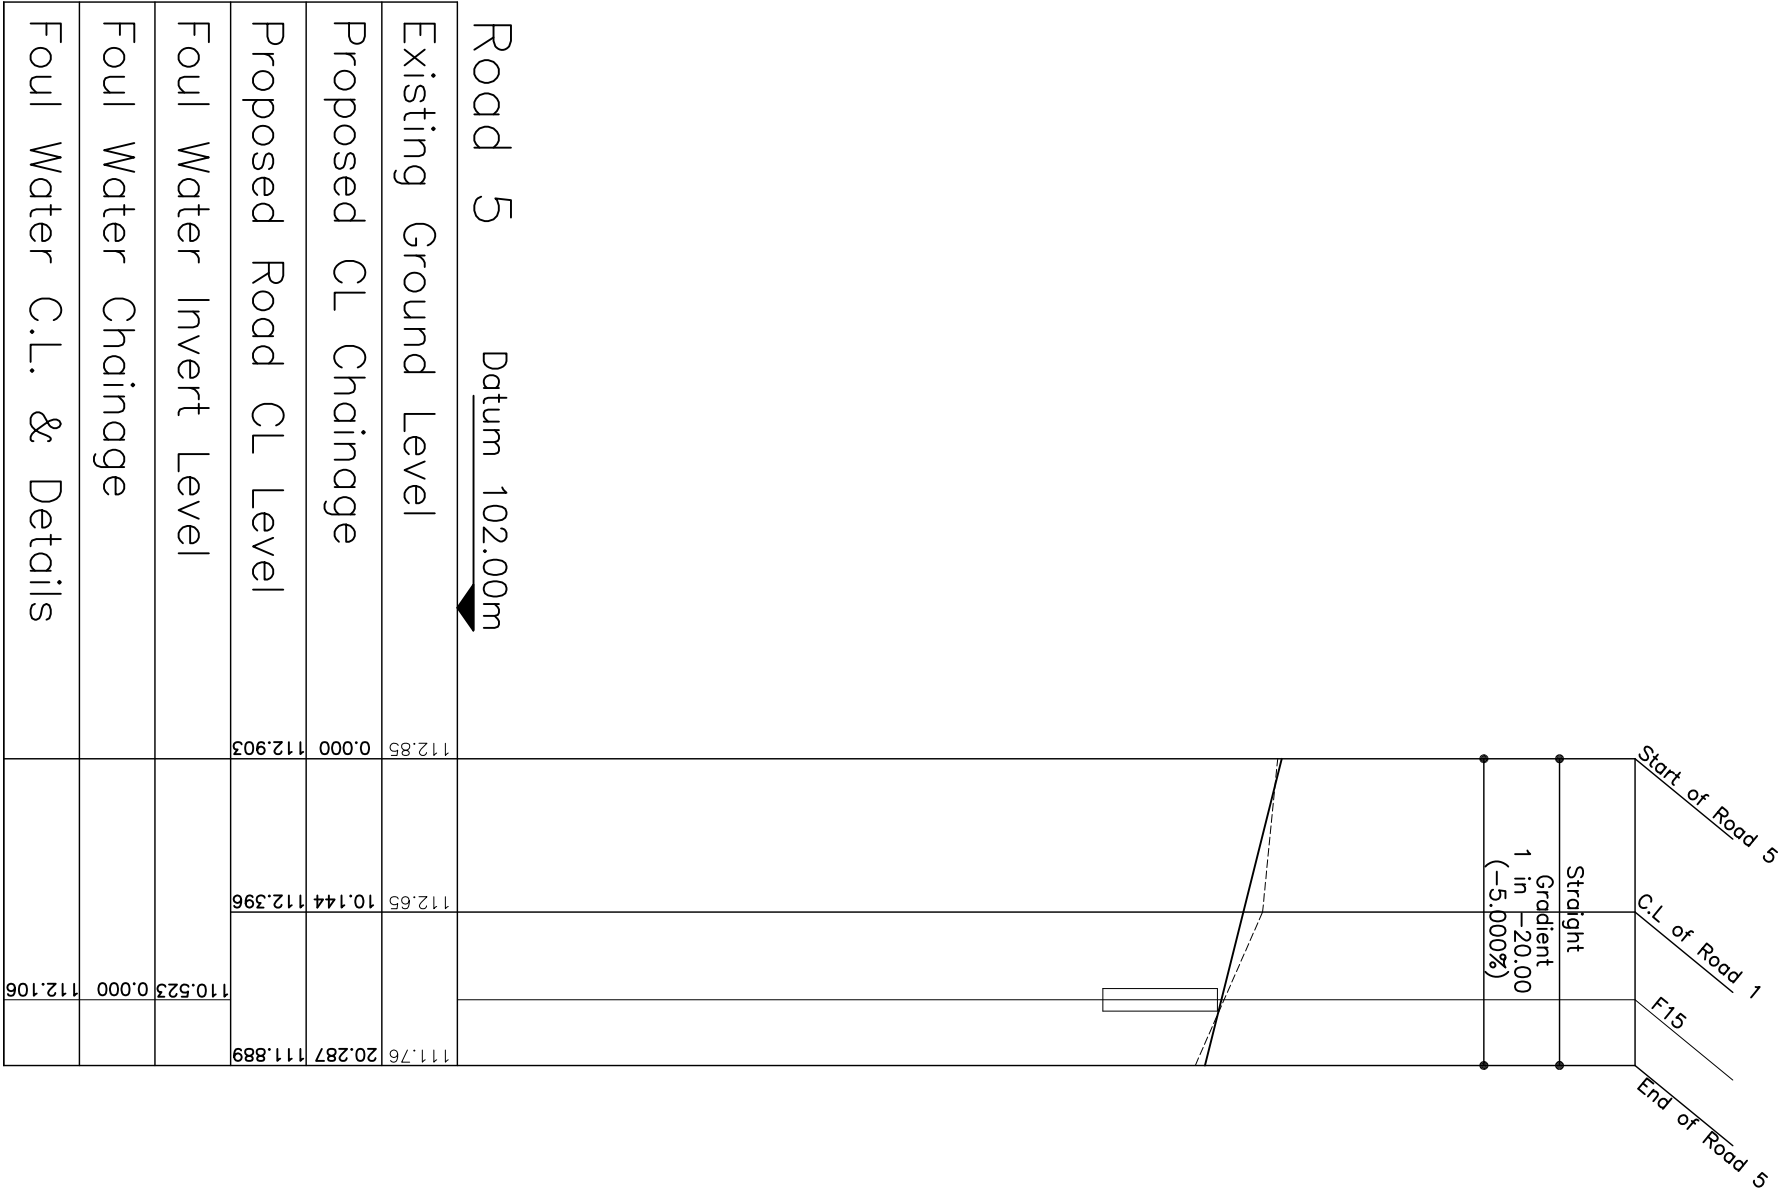

Longitudinal Section Road 5

Longitudinal Section F15-F18

Longitudinal Section S2-S4

NOTES

- Setting out shall be undertaken using only the approved instruments and methods specified in this drawing.
- All sewers and highway drainage shall be constructed in accordance with Sewers for Adoption 6th Edition and United Utilities Details & Guidelines.
- A minimum 150mm Concrete Protection shall be provided to all sewers with cover of less than 1.2m in highway areas.
- Sewers shall have a minimum cover of 0.9m.
- Where "Ultra Filtr" UPVC pipes (or similar approved) are used in adoptable drainage they shall still be handled and laid in accordance with the specification and guidance issued by the High performance Pipe Association

6. A Class S Bed and surround must be used for such pipes. From this drawing, the material shall be as directed by the Highway Authority be a suitable granular material all in accordance with Sewers for adoption
7. Plastic pipes must comply with WIS 4-35-01

REVISIONS		
REV.	DATE	INIT. DETAILS
A	10/03/12	JCM: Road 4 from section added to sheet 2, S2-S4 section added.
B	20/03/12	JCM: F15-F18 section updated
C	05/05/12	JCM: Preliminary removed

North Point		Project	Dilworth Lane Longridge
Client		Owner	Howland Homes
Quality Ass.		Drawn	SHD
Title		Checked By	Scale 1:500 Vert 1:100
3 Wembley Court MANCHESTER M20 3NU Tel: 0161 703 5801 Fax: 0161 702 5279 www.farrar.co.uk		Drawing No.	3891/3/3
EDINBURGH		Revision	C